Allen-Bradley

Compact™ I/O Thermocouple/mV Input Module

(Catalog Number 1769-IT6)

User Manual

Rockwell Automation

Important User Information

Because of the variety of uses for the products described in this publication, those responsible for the application and use of this control equipment must satisfy themselves that all necessary steps have been taken to assure that each application and use meets all performance and safety requirements, including any applicable laws, regulations, codes and standards.

The illustrations, charts, sample programs and layout examples shown in this guide are intended solely for purposes of example. Since there are many variables and requirements associated with any particular installation, Rockwell International Corporation does not assume responsibility or liability (to include intellectual property liability) for actual use based upon the examples shown in this publication.

Rockwell Automation publication SGI-1.1, *Safety Guidelines for the Application, Installation and Maintenance of Solid-State Control* (available from your local Rockwell Automation office), describes some important differences between solid-state equipment and electromechanical devices that should be taken into consideration when applying products such as those described in this publication.

Reproduction of the contents of this copyrighted publication, in whole or part, without written permission of Rockwell Automation, is prohibited.

Throughout this manual we use notes to make you aware of safety considerations:

ATTENTION

Identifies information about practices or circumstances that can lead to personal injury or death, property damage or economic loss

Attention statements help you to:

- identify a hazard
- avoid a hazard
- recognize the consequences

IMPORTANT Identifies information that is critical for successful application and understanding of the product.

MicroLogix, RSLogix, and RSLinx are trademarks of Rockwell Automation.
RSLogix and RSNetworx are trademarks of Rockwell Software.

Belden is a trademark of Belden, Inc.

Preface

Who Should Use This Manual P-1
How to Use This Manual P-1
- Manual Contents P-1
- Related Documentation P-2

Conventions Used in This Manual P-2
Rockwell Automation Support P-3
- Local Product Support P-3
- Technical Product Assistance P-3
- Your Questions or Comments on the Manual P-3

Chapter 1

Overview

General Description 1-1
- Thermocouple/mV Inputs and Ranges 1-1
- Data Formats 1-2
- Filter Frequencies 1-2
- Hardware Features 1-2
- General Diagnostic Features 1-4

System Overview 1-4
- System Operation 1-4
- Module Operation 1-4
- Module Field Calibration 1-5

Chapter 2

Quick Start for Experienced Users

Before You Begin 2-1
Required Tools and Equipment 2-1
What You Need To Do 2-2

Chapter 3

Installation and Wiring

Compliance to European Union Directives 3-1
- EMC Directive 3-1
- Low Voltage Directive 3-1

Power Requirements 3-2
General Considerations 3-2
- Hazardous Location Considerations 3-2
- Prevent Electrostatic Discharge 3-3
- Remove Power 3-3
- Selecting a Location 3-3

System Assembly 3-4
Mounting 3-6
- Minimum Spacing 3-6
- Panel Mounting 3-6
- DIN Rail Mounting 3-7

Replacing a Single Module within a System 3-7

Field Wiring Connections 3-8
System Wiring Guidelines 3-8
Terminal Door Label 3-10
Removing and Replacing the Terminal Block 3-10
Wiring the Finger-Safe Terminal Block 3-11
Wiring the Module 3-12
Wiring Diagram 3-13
Cold Junction Compensation 3-13
Calibration 3-14

Chapter 4

Module Data, Status, and Channel Configuration

Module Memory Map 4-1
Accessing Input Image File Data 4-2
Input Data File 4-2
Input Data Values 4-2
General Status Bits (S0 to S7) 4-2
Open-Circuit Flag Bits (OC0 to OC7) 4-3
Over-Range Flag Bits (O0 to O7) 4-3
Under-Range Flag Bits (U0 - U7) 4-4
Configuring Channels 4-4
Configuration Data File 4-5
Channel Configuration 4-6
Enabling or Disabling a Channel (Bit 15) 4-7
Selecting Data Formats (Bits 14 through 12) 4-7
Selecting Input Type (Bits 11 through 8) 4-9
Selecting Temperature Units (Bit 7) 4-10
Determining Open-Circuit Response (Bits 6 and 5) 4-10
Selecting Input Filter Frequency (Bits 2 through 0) 4-11
Selecting Enable/Disable Cyclic Calibration (Word 6, Bit 0) 4-14
Determining Effective Resolution and Range 4-14
Determining Module Update Time 4-33
Effects of Autocalibration on Module Update Time 4-34
Calculating Module Update Time 4-35
Impact of Autocalibration on Module Startup During Mode Change 4-37

Chapter 5

Diagnostics and Troubleshooting

Safety Considerations 5-1
Indicator Lights 5-1
Stand Clear of Equipment 5-1
Program Alteration 5-2
Safety Circuits 5-2
Module Operation vs. Channel Operation 5-2
Power-up Diagnostics 5-2

Channel Diagnostics 5-3
Invalid Channel Configuration Detection 5-3
Over- or Under-Range Detection 5-3
Open-Circuit Detection 5-3
Non-critical vs. Critical Module Errors 5-4
Module Error Definition Table 5-4
Module Error Field 5-4
Extended Error Information Field. 5-5
Error Codes 5-6
Module Inhibit Function 5-8
Contacting Rockwell Automation 5-8

Appendix A

Specifications

General Specifications A-1
Input Specifications A-2
Repeatability at 25°C (77°F) A-3
Accuracy A-4
Accuracy Versus Thermocouple Temperature and Filter Frequency A-5
Temperature Drift. A-23

Appendix B

Two's Complement Binary Numbers

Positive Decimal Values B-1
Negative Decimal Values B-2

Appendix C

Thermocouple Descriptions

International Temperature Scale of 1990 . . . . . C-1
Type B Thermocouples C-1
Type E Thermocouples. C-3
Type J Thermocouples C-5
Type K Thermocouples C-6
Type N Thermocouples C-8
Type R Thermocouples C-10
Type S Thermocouples. C-11
Type T Thermocouples C-13
References C-16

Appendix D

Using Thermocouple Junctions

Using a Grounded Junction Thermocouple D-1
Using an Ungrounded (Isolated) Junction Thermocouple . . D-2
Using an Exposed Junction Thermocouple D-3

Module Configuration Using MicroLogix 1500 and RSLogix 500

Appendix E

Module Addressing E-1
1769-IT6 Configuration File E-2
Configuring the 1769-IT6 in a MicroLogix 1500 System E-3

Configuring Your 1769-IT6 Module with the Generic Profile for CompactLogix Controllers in RSLogix 5000

Appendix F

Configuring I/O Modules F-4
Configuring a 1769-IT6 Thermocouple Module F-6

Configuring Your 1769-IT6 Module in a Remote DeviceNet System with a 1769-ADN DeviceNet Adapter

Appendix G

Configuring the 1769-IT6 . . . . . G-4

Glossary

Index

Read this preface to familiarize yourself with the rest of the manual. This preface covers the following topics:

- who should use this manual
- how to use this manual
- related publications
- conventions used in this manual
- Rockwell Automation support

Who Should Use This Manual

Use this manual if you are responsible for designing, installing, programming, or troubleshooting control systems that use Allen-Bradley Compact™ I/O and/or compatible controllers, such as MicroLogix 1500 or CompactLogix.

How to Use This Manual

As much as possible, we organized this manual to explain, in a task-by-task manner, how to install, configure, program, operate and troubleshoot a control system using the 1769-IT6.

Manual Contents

If you want...	See
An overview of the thermocouple/mV input module	Chapter 1
A quick start guide for experienced users	Chapter 2
Installation and wiring guidelines	Chapter 3
Module addressing, configuration and status information	Chapter 4
Information on module diagnostics and troubleshooting	Chapter 5
Specifications for the input module	Appendix A
Information on understanding two's complement binary numbers	Appendix B
Thermocouple descriptions	Appendix C
Information on using the different types of thermocouple junctions	Appendix D
Configuration Using MicroLogix 1500 and RSLogix 500	Appendix E
Configuration Using CompactLogix and RSLogix 5000	Appendix F
Configuration Using 1769-ADN DeviceNet Adapter and RSNetworx	Appendix G
Definitions of terms used in this manual	Glossary

Related Documentation

The table below provides a listing of publications that contain important information about MicroLogix 1500 systems.

For	Read this document	Document number
A user manual containing information on how to install, use and program your MicroLogix 1500 controller	MicroLogix™ 1500 User Manual	1764-UM001A-US-P
An overview of 1769 Compact Discrete I/O modules	1769 Compact Discrete Input/Output Modules Product Data	1769-2.1
An overview of the MicroLogix 1500 System, including 1769 Compact I/O.	MicroLogix™ 1500 System Overview	1764-SO001B-EN-P
An overview of Compact™ I/O.	Compact™ I/O System Overview	1769-SO001A-EN-P
A user manual that contains information on installing, using, and programming CompactLogix controllers.	CompactLogix User Manual	1769-UM007B-EN-P
In-depth information on grounding and wiring Allen-Bradley programmable controllers.	Allen-Bradley Programmable Controller Grounding and Wiring Guidelines	1770-4.1

If you would like a manual, you can:

- download a free electronic version from the internet at **www.theautomationbookstore.com**
- purchase a printed manual by:
  - contacting your local distributor or Rockwell Automation representative
  - visiting **www.theautomationbookstore.com** and placing your order
  - calling 1.800.963.9548 (USA/Canada) or 001.330.725.1574 (Outside USA/Canada)

Conventions Used in This Manual

The following conventions are used throughout this manual:

- Bulleted lists (like this one) provide information not procedural steps.
- Numbered lists provide sequential steps or hierarchical information.
- *Italic* type is used for emphasis.
- Text in this `font` indicates words or phrases you should type.

Rockwell Automation Support

Rockwell Automation offers support services worldwide, with over 75 Sales/Support Offices, 512 authorized distributors and 260 authorized Systems Integrators located throughout the United States alone, plus Rockwell Automation representatives in every major country in the world.

Local Product Support

Contact your local Rockwell Automation representative for:

- sales and order support
- product technical training
- warranty support
- support service agreement

Technical Product Assistance

If you need to contact Rockwell Automation for technical assistance, please review the information in Chapter Chapter 5, *Diagnostics and Troubleshooting* first. Then call your local Rockwell Automation representative.

Your Questions or Comments on the Manual

If you find a problem with this manual, please notify us. If you have any suggestions for how this manual could be made more useful to you, please contact us at the address below:

Rockwell Automation
Automation Control and Information Group
Technical Communication, Dept. A602V
P.O. Box 2086
Milwaukee, WI 53201-2086

Overview

This chapter describes the 1769-IT6 Thermocouple/mV Input Module and explains how the module reads thermocouple or millivolt analog input data. Included is information about:

- the module's hardware and diagnostic features
- an overview of system and module operation
- compatibility

General Description

The thermocouple/mV input module supports thermocouple and millivolt signal measurement. It digitally converts and stores thermocouple and/or millivolt analog data from any combination of up to six thermocouple or millivolt analog sensors. Each input channel is individually configurable via software for a specific input device, data format and filter frequency, and provides open-circuit, over-range and under-range detection and indication.

Thermocouple/mV Inputs and Ranges

The table below defines thermocouple types and their associated full-scale temperature ranges. The second table lists the millivolt analog input signal ranges that each channel will support. To determine the practical temperature range your thermocouple supports, see the specifications in Appendix A.

Thermocouple Type	°C Temperature Range	°F Temperature Range
J	-210 to +1200°C	-346 to +2192°F
K	-270 to +1370°C	-454 to +2498°F
T	-270 to +400°C	-454 to +752°F
E	-270 to +1000°C	-454 to +1832°F
R	0 to +1768°C	+32 to +3214°F
S	0 to +1768°C	+32 to +3214°F
B	+300 to +1820°C	+572 to +3308°F
N	-210 to +1300°C	-346 to +2372°F
C	0 to +2315°C	+32 to + 4199°F
CJC Sensor	0 to +85°C	+32 to +185°F

Millivolt InputType	Range
± 50 mV	-50 to +50 mV
± 100 mV	-100 to +100 mV

Data Formats

The data can be configured on board each module as:

- engineering units x 1
- engineering units x 10
- scaled-for-PID
- percent of full-scale
- raw/proportional data

Filter Frequencies

The module uses a digital filter that provides high frequency noise rejection for the input signals. The filter is programmable, allowing you to select from six different filter frequencies for each channel:

- 10 Hz
- 50 Hz
- 60 Hz
- 250 Hz
- 500 Hz
- 1000 Hz

Hardware Features

The module contains a removable terminal block. Channels are wired as differential inputs. Two cold junction compensation (CJC) sensors are attached to the terminal block to enable accurate readings from each channel. These sensors compensate for offset voltages introduced into the input signal as a result of the cold-junction where the thermocouple wires are connected to the module.

Module configuration is normally done via the controller's programming software. In addition, some controllers support configuration via the user program. In either case, the module configuration is stored in the memory of the controller. Refer to your controller's user manual for more information.

The illustration below shows the module's hardware features.

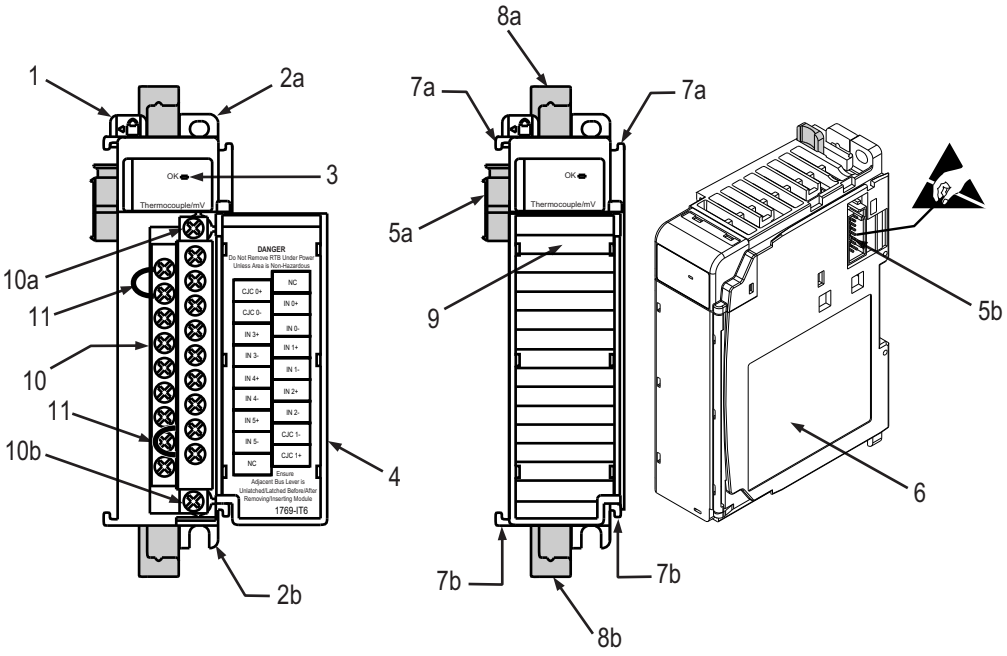

Item	Description
1	bus lever
2a	upper panel mounting tab
2b	lower panel mounting tab
3	module status LED
4	module door with terminal identification label
5a	movable bus connector (bus interface) with female pins
5b	stationary bus connector (bus interface) with male pins
6	nameplate label
7a	upper tongue-and-groove slots
7b	lower tongue-and-groove slots
8a	upper DIN rail latch
8b	lower DIN rail latch
9	write-on label for user identification tags
10	removable terminal block (RTB) with finger-safe cover
10a	RTB upper retaining screw
10b	RTB lower retaining screw
11	CJC sensors

General Diagnostic Features

The module contains a diagnostic LED that helps you identify the source of problems that may occur during power-up or during normal channel operation. The LED indicates both status and power. Power-up and channel diagnostics are explained in Chapter 5, *Diagnostics and Troubleshooting*.

System Overview

The modules communicate to the controller through the bus interface. The modules also receive 5 and 24V dc power through the bus interface.

System Operation

At power-up, the module performs a check of its internal circuits, memory, and basic functions. During this time, the module status LED remains off. If no faults are found during power-up diagnostics, the module status LED is turned on.

After power-up checks are complete, the module waits for valid channel configuration data. If an invalid configuration is detected, the module generates a configuration error. Once a channel is properly configured and enabled, it continuously converts the thermocouple or millivolt input to a value within the range selected for that channel.

Each time a channel is read by the input module, that data value is tested by the module for an over-range, under-range, open-circuit, or "input data not valid" condition. If such a condition is detected, a unique bit is set in the channel status word. The channel status word is described in Input Data File on page 4-2.

Using the module image table, the controller reads the two's complement binary converted thermocouple or millivolt data from the module. This typically occurs at the end of the program scan or when commanded by the control program. If the controller and the module determine that the data transfer has been made without error, the data is used in the control program.

Module Operation

When the module receives a differential input from an analog device, the module's circuitry multiplexes the input into an A/D converter. The converter reads the signal and converts it as required for the type of input. The module also continuously samples the CJC sensors and compensates for temperature changes at the terminal block cold junction, between the thermocouple wire and the input channel. See the block diagram on page 1-5.

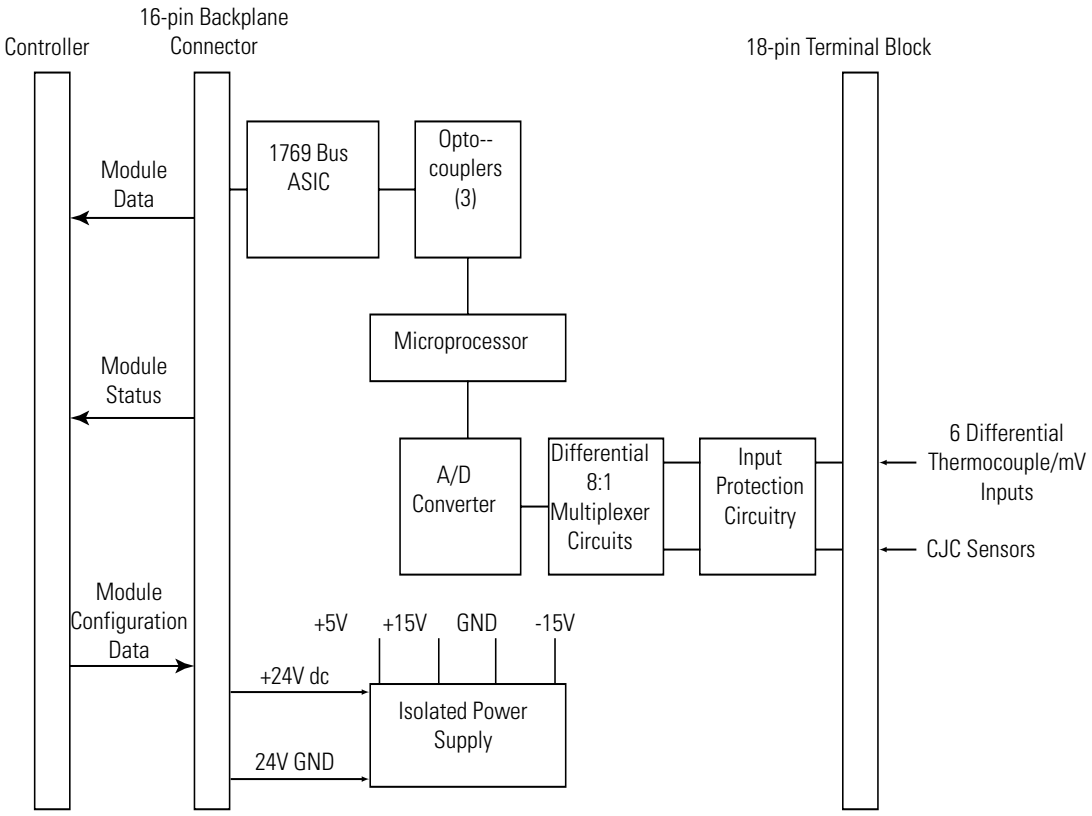

Each channel can receive input signals from a thermocouple or millivolt analog input device, depending upon how you configured the channel.

When configured for thermocouple input types, the module converts the analog input voltages into cold-junction compensated and linearized digital temperature readings. The module uses the National Institute of Standards and Technology (NIST) ITS-90 standard for linearization for all thermocouple types (J, K, T, E, R, S, B, N, C).

When configured for millivolt inputs, the module converts the analog values directly into digital counts.

Module Field Calibration

The module provides autocalibration, which compensates for offset and gain drift of the A/D converter caused by a temperature change within the module. An internal, high-precision, low drift voltage and system ground reference is used for this purpose. The input module performs autocalibration when a channel is initially enabled. In addition, you can program the module to perform a calibration cycle once every 5 minutes. See Selecting Enable/Disable Cyclic Calibration (Word 6, Bit 0) on page 4-14 for information on configuring the module to perform periodic autocalibration.

Quick Start for Experienced Users

Before You Begin

This chapter can help you to get started using the 1769-IT6 thermocouple/mV input module. We base the procedures here on the assumption that you have an understanding of Allen-Bradley controllers. You should understand electronic process control and be able to interpret the ladder logic instructions required to generate the electronic signals that control your application.

Because it is a start-up guide for experienced users, this chapter does not contain detailed explanations about the procedures listed. It does, however, reference other chapters in this book where you can get more information about applying the procedures described in each step.

If you have any questions or are unfamiliar with the terms used or concepts presented in the procedural steps, always read the referenced chapters and other recommended documentation before trying to apply the information.

Required Tools and Equipment

Have the following tools and equipment ready:

- medium blade or cross-head screwdriver
- thermocouple or millivolt analog input device
- shielded, twisted-pair cable for wiring
  (Belden™ 8761 or equivalent for millivolt inputs, or shielded thermocouple extension wire for thermocouple inputs)
- controller
  (for example, a MicroLogix™ 1500 or CompactLogix™ controller)
- programming device and software
  (for example, RSLogix 500™ or RSLogix 5000™)

What You Need To Do

This chapter covers:

1. Ensuring that your power supply is adequate
2. Attaching and locking the module
3. Wiring the module
4. Configuring the module
5. Going through the startup procedure
6. Monitoring module operation

Step 1: Ensure that your 1769 system power supply(1) has sufficient current output to support your system configuration.	Reference
	Chapter 3 (Installation and Wiring)

The modules maximum current draw is shown below.

5V dc	24V dc
100 mA	40 mA

NOTE The module cannot be located more than 7 modules away from the system power supply.

(1) The system power supply could be a 1769-PA2, -PB2, -PA4, -PB4, or the internal supply of the MicroLogix 1500 packaged controller.

Step 2: Attach and lock the module.	Reference
	Chapter 3 (Installation and Wiring)

NOTE The module can be panel or DIN rail mounted. Modules can be assembled before or after mounting.

ATTENTION

Remove power before removing or inserting this module. If you remove or insert a module with power applied, an electrical arc may occur.

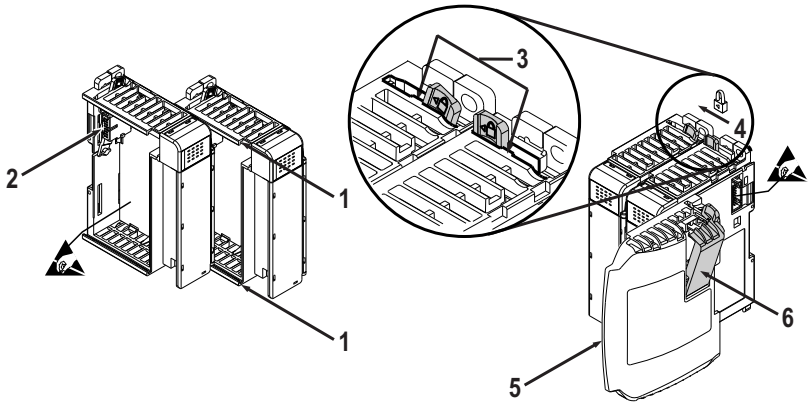

1. Check that the bus lever of the module to be installed is in the unlocked (fully right) position.
2. Use the upper and lower tongue-and-groove slots (1) to secure the modules together (or to a controller).
3. Move the module back along the tongue-and-groove slots until the bus connectors (2) line up with each other.
4. Push the bus lever back slightly to clear the positioning tab (3). Use your fingers or a small screwdriver.
5. To allow communication between the controller and module, move the bus lever fully to the left (4) until it clicks. Ensure it is locked firmly in place.

ATTENTION

When attaching I/O modules, it is very important that the bus connectors are securely locked together to ensure proper electrical connection.

6. Attach an end cap terminator (5) to the last module in the system by using the tongue-and-groove slots as before.
7. Lock the end cap bus terminator (6).

IMPORTANT A 1769-ECR or 1769-ECL right or left end cap respectively must be used to terminate the end of the 1769 communication bus.

Step 3: Wire the module.	Reference Chapter 3 (Installation and Wiring)

Follow the guidelines below when wiring the module.

General

- Power and input wiring must be in accordance with Class 1, Division 2 wiring methods, Article 501-4(b) of the National Electric Code, NFPA 70, and in accordance with the authority having jurisdiction.
- Channels are isolated from one another by ±10V dc maximum.
- Route field wiring away from any other wiring and keep it as far as possible from sources of electrical noise, such as motors, transformers, contactors, and ac devices. As a general rule, allow at least 15.2 cm (6 in.) of separation for every 120V of power.
- Routing field wiring in a grounded conduit can reduce electrical noise.
- If field wiring must cross ac or power cables, ensure that they cross at right angles.
- If multiple power supplies are used with analog millivolt inputs, the power supply commons must be connected.

Terminal Block

- Do not use the module's NC terminals as connection points.
- Do not tamper with or remove the CJC sensors on the terminal block. Removal of either one or both sensors will reduce accuracy.
- For millivolt sensors, use Belden 8761 shielded, twisted-pair wire (or equivalent) to ensure proper operation and high immunity to electrical noise.
- For a thermocouple, use the shielded, twisted-pair thermocouple extension lead wires specified by the thermocouple manufacturer. Using the incorrect type of thermocouple extension wire or not following the correct polarity will cause invalid readings.
- To ensures optimum accuracy, limit overall cable impedance by keeping a cable as short as possible. Locate the module as close to input devices as the application permits.

Grounding

ATTENTION

The possibility exists that a grounded or exposed thermocouple can become shorted to a potential greater than that of the thermocouple itself. Due to possible shock hazard, take care when wiring grounded or exposed thermocouples. See Appendix D, *Using Thermocouple Junctions*.

- This product is intended to be mounted to a well-grounded mounting surface such as a metal panel. Additional grounding connections from the module's mounting tabs or DIN rail (if used) are not required unless the mounting surface cannot be grounded.
- Keep cable shield connections to ground as short as possible.
- Ground the shield drain wire at one end only. The preferred location is as follows.
  - For grounded thermocouples or millivolt sensors, this is at the sensor end.
  - For insulated/ungrounded thermocouples, this is at the module end. Contact your sensor manufacturer for additional details.
- Refer to *Industrial Automation Wiring and Grounding Guidelines*, Allen-Bradley publication 1770-4.1, for additional information.

The terminal connections with CJC sensors are shown below:

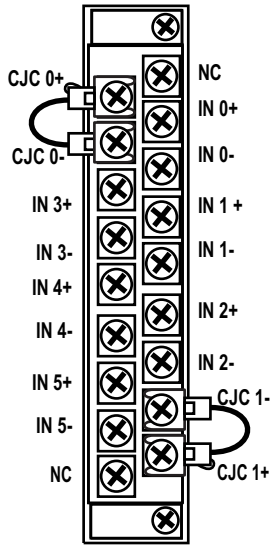

Step 4: Configure the module.	Reference
	Chapter 4 (Module Data, Status, and Channel Configuration)

The configuration file is typically modified using the programming software compatible with your controller. It can also be modified through the control program, if supported by the controller. See Channel Configuration on page 4-6 for more information.

Step 5: Go through the startup procedure.	Reference
	Chapter 5 (Diagnostics and Troubleshooting)

1. Apply power to the controller system.
2. Download your program, which contains the thermocouple module configuration settings, to the controller.
3. Put the controller in Run mode. During a normal start-up, the module status LED turns on.

NOTE If the module status LED does not turn on, cycle power. If the condition persists, contact your local distributor or Rockwell Automation for assistance.

Step 6: Monitor the module status to check if the module is operating correctly	Reference
	Chapter 5 (Diagnostics and Troubleshooting)

Module and channel configuration errors are reported to the controller. These errors are typically reported in the controller's I/O status file.

Channel status data is also reported in the module's input data table, so these bits can be used in your control program to flag a channel error.

Installation and Wiring

This chapter tells you how to:

- determine the power requirements for the modules
- avoid electrostatic damage
- install the module
- wire the module's terminal block
- wire input devices

Compliance to European Union Directives

This product is approved for installation within the European Union and EEA regions. It has been designed and tested to meet the following directives.

EMC Directive

The 1769-IT6 module is tested to meet Council Directive 89/336/EEC Electromagnetic Compatibility (EMC) and the following standards, in whole or in part, documented in a technical construction file:

- EN 50081-2
  EMC – Generic Emission Standard, Part 2 - Industrial Environment

- EN 50082-2
  EMC – Generic Immunity Standard, Part 2 - Industrial Environment

This product is intended for use in an industrial environment.

Low Voltage Directive

This product is tested to meet Council Directive 73/23/EEC Low Voltage, by applying the safety requirements of EN 61131-2 Programmable Controllers, Part 2 – Equipment Requirements and Tests.

For specific information required by EN61131-2, see the appropriate sections in this publication, as well as the following Allen-Bradley publications:

- *Industrial Automation, Wiring and Grounding Guidelines for Noise Immunity*, publication 1770-4.1
- *Automation Systems Catalog*, publication B113

Power Requirements

The module receives power through the bus interface from the +5V dc/ +24V dc system power supply. The maximum current drawn by the module is shown in the table below.

Module Current Draw	at 5V dc	at 24V dc
	100 mA	40 mA

General Considerations

Compact I/O is suitable for use in an industrial environment when installed in accordance with these instructions. Specifically, this equipment is intended for use in clean, dry environments (Pollution degree 2[1]) and to circuits not exceeding Over Voltage Category II[2] (IEC 60664-1).[3]

Hazardous Location Considerations

This equipment is suitable for use in Class I, Division 2, Groups A, B, C, D or non-hazardous locations only. The following WARNING statement applies to use in hazardous locations.

WARNING

- EXPLOSION HAZARD
- Substitution of components may impair suitability for Class I, Division 2.
- Do not replace components or disconnect equipment unless power has been switched off or the area is known to be non-hazardous.
- Do not connect or disconnect components unless power has been switched off or the area is known to be non-hazardous.
- This product must be installed in an enclosure.
- All wiring must comply with N.E.C. article 501-4(b).

(1) Pollution Degree 2 is an environment where, normally, only non-conductive pollution occurs except that occasionally a temporary conductivity caused by condensation shall be expected.

(2) Over Voltage Category II is the load level section of the electrical distribution system. At this level transient voltages are controlled and do not exceed the impulse voltage capability of the product's insulation.

(3) Pollution Degree 2 and Over Voltage Category II are International Electrotechnical Commission (IEC) designations.

Prevent Electrostatic Discharge

ATTENTION

Electrostatic discharge can damage integrated circuits or semiconductors if you touch analog I/O module bus connector pins or the terminal block on the input module. Follow these guidelines when you handle the module:

- Touch a grounded object to discharge static potential.
- Wear an approved wrist-strap grounding device.
- Do not touch the bus connector or connector pins.
- Do not touch circuit components inside the module.
- If available, use a static-safe work station.
- When it is not in use, keep the module in its static-shield bag.

Remove Power

ATTENTION

Remove power before removing or inserting this module. When you remove or insert a module with power applied, an electrical arc may occur. An electrical arc can cause personal injury or property damage by:

- sending an erroneous signal to your system's field devices, causing unintended machine motion
- causing an explosion in a hazardous environment

Electrical arcing causes excessive wear to contacts on both the module and its mating connector and may lead to premature failure.

Selecting a Location

Reducing Noise

Most applications require installation in an industrial enclosure to reduce the effects of electrical interference. Analog inputs are highly susceptible to electrical noise. Electrical noise coupled to the analog inputs will reduce the performance (accuracy) of the module.

Group your modules to minimize adverse effects from radiated electrical noise and heat. Consider the following conditions when selecting a location for the analog module. Position the module:

- away from sources of electrical noise such as hard-contact switches, relays, and AC motor drives
- away from modules which generate significant radiated heat, such as the 1769-IA16. Refer to the module's heat dissipation specification.

In addition, route shielded, twisted-pair analog input wiring away from any high voltage I/O wiring.

Power Supply Distance

You can install as many modules as your power supply can support. However, all 1769 I/O modules have a power supply distance ratings. The maximum I/O module rating is 8, which means that a module may not be located more than 8 modules away from the system power supply.

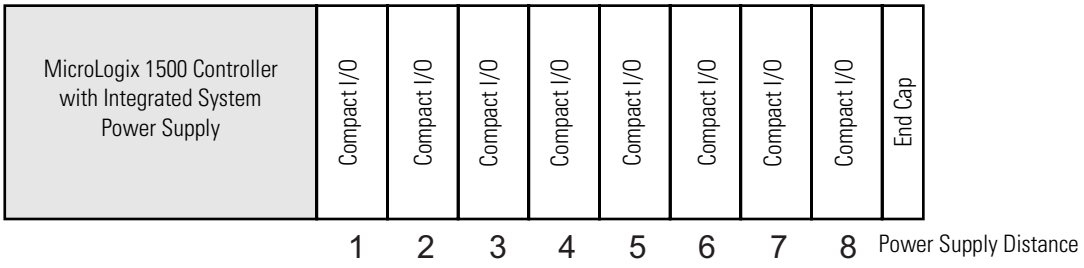

OR

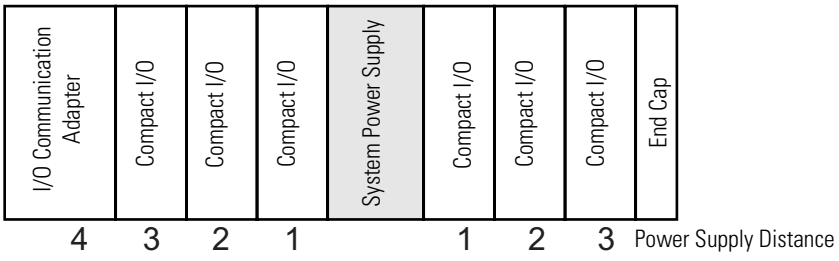

System Assembly

The module can be attached to the controller or an adjacent I/O module *before* or *after* mounting. For mounting instructions, see Panel Mounting Using the Dimensional Template on page 3-6, or DIN Rail Mounting on page 3-7. To work with a system that is already mounted, see Replacing a Single Module within a System on page 3-7.

The following procedure shows you how to assemble the Compact I/O system.

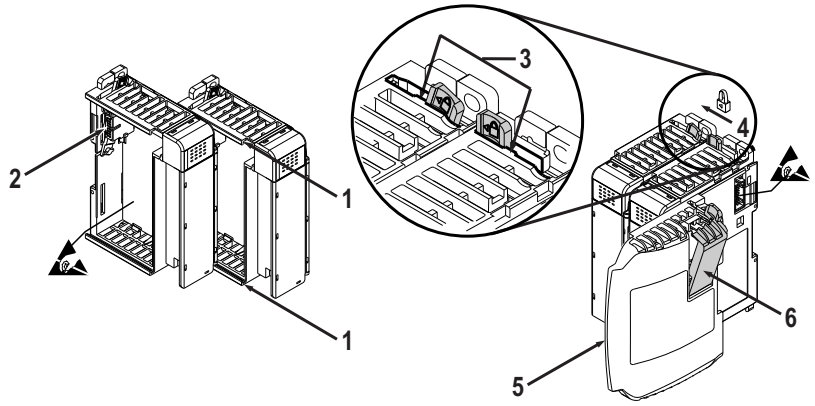

1. Disconnect power.
2. Check that the bus lever of the module to be installed is in the unlocked (fully right) position.

   NOTE If the module is being installed to the left of an existing module, check that the right-side adjacent module's bus lever is in the unlocked (fully right) position.

3. Use the upper and lower tongue-and-groove slots (1) to secure the modules together (or to a controller).
4. Move the module back along the tongue-and-groove slots until the bus connectors (2) line up with each other.
5. Push the bus lever back slightly to clear the positioning tab (3). Use your fingers or a small screwdriver.
6. To allow communication between the controller and module, move the bus lever fully to the left (4) until it clicks. Ensure it is locked firmly in place.

ATTENTION

When attaching I/O modules, it is very important that the bus connectors are securely locked together to ensure proper electrical connection.

7. Attach an end cap terminator (5) to the last module in the system by using the tongue-and-groove slots as before.
8. Lock the end cap bus terminator (6).

IMPORTANT A 1769-ECR or 1769-ECL right or left end cap respectively must be used to terminate the end of the bus.

Mounting

ATTENTION

During panel or DIN rail mounting of all devices, be sure that all debris (metal chips, wire strands, etc.) is kept from falling into the module. Debris that falls into the module could cause damage at power up.

Minimum Spacing

Maintain spacing from enclosure walls, wireways, adjacent equipment, etc. Allow 50 mm (2 in.) of space on all sides for adequate ventilation, as shown below:

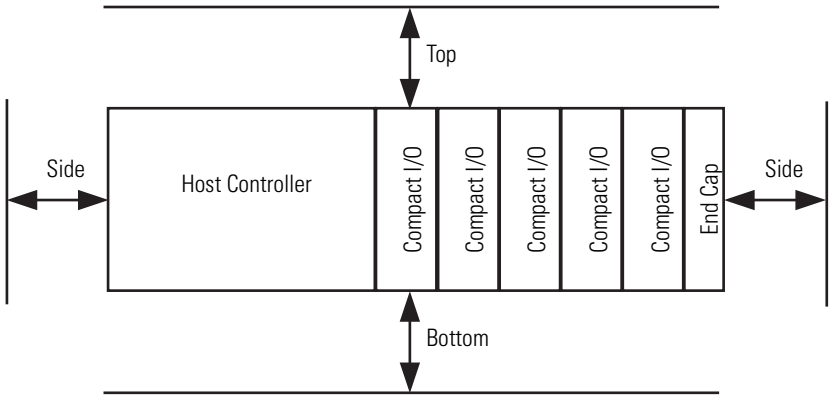

Panel Mounting

Mount the module to a panel using two screws per module. Use M4 or #8 panhead screws. Mounting screws are required on every module.

Panel Mounting Using the Dimensional Template

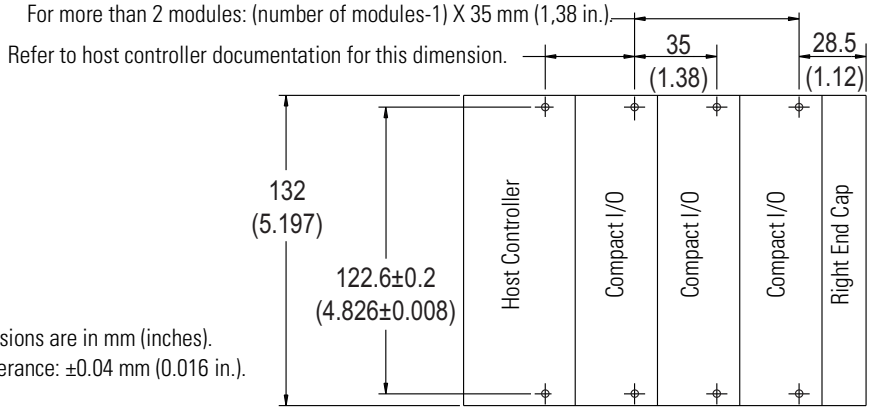

NOTE: All dimensions are in mm (inches).
Hole spacing tolerance: ±0.04 mm (0.016 in.).

Panel Mounting Procedure Using Modules as a Template

The following procedure allows you to use the assembled modules as a template for drilling holes in the panel. If you have sophisticated panel mounting equipment, you can use the dimensional template provided on page 3-6. Due to module mounting hole tolerance, it is important to follow these procedures:

1. On a clean work surface, assemble no more than three modules.
2. Using the assembled modules as a template, carefully mark the center of all module-mounting holes on the panel.
3. Return the assembled modules to the clean work surface, including any previously mounted modules.
4. Drill and tap the mounting holes for the recommended M4 or #8 screw.
5. Place the modules back on the panel, and check for proper hole alignment.
6. Attach the modules to the panel using the mounting screws.

   NOTE If mounting more modules, mount only the last one of this group and put the others aside. This reduces remounting time during drilling and tapping of the next group.

7. Repeat steps 1 to 6 for any remaining modules.

DIN Rail Mounting

The module can be mounted using the following DIN rails:

- 35 x 7.5 mm (EN 50 022 - 35 x 7.5), or
- 35 x 15 mm (EN 50 022 - 35 x 15).

Before mounting the module on a DIN rail, close the DIN rail latches. Press the DIN rail mounting area of the module against the DIN rail. The latches will momentarily open and lock into place.

Replacing a Single Module within a System

The module can be replaced while the system is mounted to a panel (or DIN rail). Follow these steps in order:

1. Remove power. See important note on page 3-3.
2. On the module to be removed, remove the upper and lower mounting screws from the module (or open the DIN latches using a flat-blade or phillips-style screwdriver).
3. Move the bus lever to the right to disconnect (unlock) the bus.

4. On the right-side adjacent module, move its bus lever to the right (unlock) to disconnect it from the module to be removed.
5. Gently slide the disconnected module forward. If you feel excessive resistance, check that the module has been disconnected from the bus, and that both mounting screws have been removed (or DIN latches opened).

NOTE It may be necessary to rock the module slightly from front to back to remove it, or, in a panel-mounted system, to loosen the screws of adjacent modules.

6. Before installing the replacement module, be sure that the bus lever on the module to be installed and on the right-side adjacent module or end cap are in the unlocked (fully right) position.
7. Slide the replacement module into the open slot.
8. Connect the modules together by locking (fully left) the bus levers on the replacement module and the right-side adjacent module.
9. Replace the mounting screws (or snap the module onto the DIN rail).

Field Wiring Connections

System Wiring Guidelines

Consider the following when wiring your system:

General

- Power and input wiring must be in accordance with Class 1, Division 2 wiring methods, Article 501-4(b) of the National Electric Code, NFPA 70, and in accordance with the authority having jurisdiction.
- Channels are isolated from one another by ±10 Vdc maximum.
- Route field wiring away from any other wiring and as far as possible from sources of electrical noise, such as motors, transformers, contactors, and ac devices. As a general rule, allow at least 15.2 cm (6 in.) of separation for every 120V of power.
- Routing field wiring in a grounded conduit can reduce electrical noise.
- If field wiring must cross ac or power cables, ensure that they cross at right angles.
- If multiple power supplies are used with analog millivolt inputs, the power supply commons must be connected.

Terminal Block

- Do not use the module's NC terminals as connection points.
- Do not tamper with or remove the CJC sensors on the terminal block. Removal of one or both sensors will reduce accuracy.
- For millivolt sensors, use Belden 8761 shielded, twisted-pair wire (or equivalent) to ensure proper operation and high immunity to electrical noise.
- For a thermocouple, use the shielded, twisted-pair thermocouple extension lead wires specified by the thermocouple manufacturer. Using the incorrect type of thermocouple extension wire or not following the correct polarity will cause invalid readings.
- To ensures optimum accuracy, limit overall cable impedance by keeping a cable as short as possible. Locate the module as close to input devices as the application permits.

Grounding

ATTENTION

The possibility exists that a grounded or exposed thermocouple can become shorted to a potential greater than that of the thermocouple itself. Due to possible shock hazard, take care when wiring grounded or exposed thermocouples. See Appendix D, Using Thermocouple Junctions.

- This product is intended to be mounted to a well-grounded mounting surface such as a metal panel. Additional grounding connections from the module's mounting tabs or DIN rail (if used) are not required unless the mounting surface cannot be grounded.
- Keep cable shield connections to ground as short as possible.
- Ground the shield drain wire at one end only. The typical location is as follows.
  - For grounded thermocouples or millivolt sensors, this is at the sensor end.
  - For insulated/ungrounded thermocouples, this is at the module end. Contact your sensor manufacturer for additional details.
- If it is necessary to connect the shield drain wire at the module end, connect it to earth ground using a panel or DIN rail mounting screw.
- Refer to *Industrial Automation Wiring and Grounding Guidelines*, Allen-Bradley publication 1770-4.1, for additional information.

Noise Prevention

- To limit the pickup of electrical noise, keep thermocouple and millivolt signal wires as far as possible from power and load lines.
- If noise persists for a device, try grounding the opposite end of the cable shield. (You can only ground one end at a time.)

Terminal Door Label

A removable, write-on label is provided with the module. Remove the label from the door, mark your unique identification of each terminal with permanent ink, and slide the label back into the door. Your markings (ID tag) will be visible when the module door is closed.

Removing and Replacing the Terminal Block

When wiring the module, you do not have to remove the terminal block. If you remove the terminal block, use the write-on label located on the side of the terminal block to identify the module location and type.

To remove the terminal block, loosen the upper and lower retaining screws. The terminal block will back away from the module as you remove the screws. Be careful not to damage the CJC sensors. When replacing the terminal block, torque the retaining screws to 0.46 Nm (4.1 in-lbs).

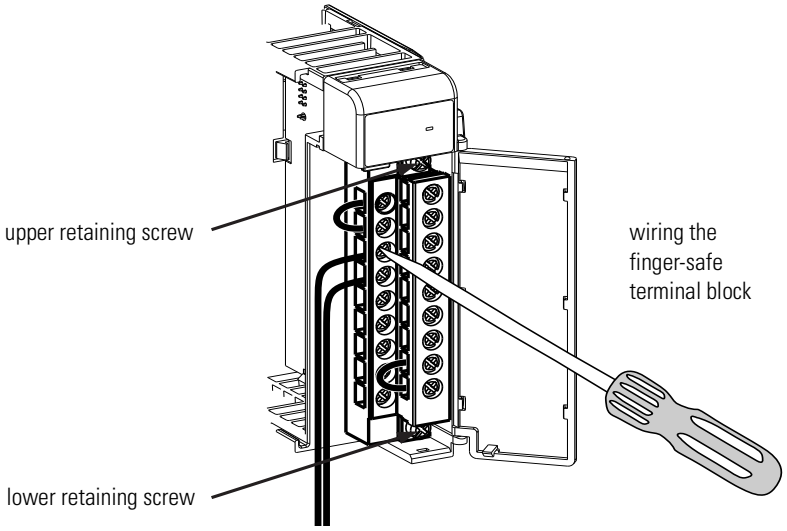

Wiring the Finger-Safe Terminal Block

When wiring the terminal block, keep the finger-safe cover in place.

1. Loosen the terminal screws to be wired.
2. Route the wire under the terminal pressure plate. You can use the bare wire or a spade lug. The terminals accept a 6.35 mm (0.25 in.) spade lug.

   NOTE The terminal screws are non-captive. Therefore, it is possible to use a ring lug [maximum 1/4 inch o.d. with a 0.139 inch minimum i.d. (M3.5)] with the module.

3. Tighten the terminal screw making sure the pressure plate secures the wire. Recommended torque when tightening terminal screws is 0.68 Nm (6 in-lbs).

   NOTE If you need to remove the finger-safe cover, insert a screwdriver into one of the square, wiring holes and gently pry the cover off. If you wire the terminal block with the finger-safe cover removed, you may not be able to put it back on the terminal block because the wires will be in the way.

Wire Size and Terminal Screw Torque

Each terminal accepts up to two wires with the following restrictions:

Wire Type		Wire Size	Terminal Screw Torque	Retaining Screw Torque
Solid	Cu-90°C (194°F)	#14 to #22 AWG	0.68 Nm (6 in-lbs)	0.46 Nm (4.1 in-lbs)
Stranded	Cu-90°C (194°F)	#16 to #22 AWG	0.68 Nm (6 in-lbs)	0.46 Nm (4.1 in-lbs)

Wiring the Module

ATTENTION

To prevent shock hazard, care should be taken when wiring the module to analog signal sources. Before wiring any module, disconnect power from the system power supply and from any other source to the module.

After the module is properly installed, follow the wiring procedure below, using the proper thermocouple extension cable, or Belden 8761 for non-thermocouple applications.

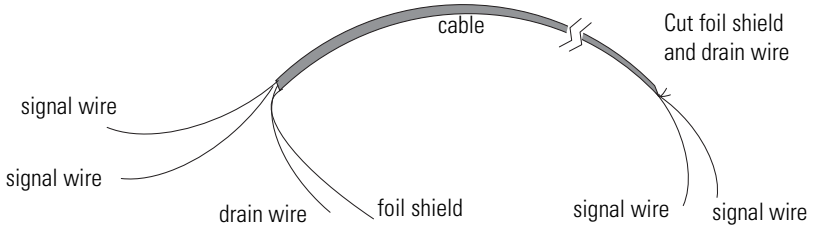

To wire your module follow these steps.

1. At each end of the cable, strip some casing to expose the individual wires.
2. Trim the signal wires to 2-inch (5 cm) lengths. Strip about 3/16 inch (5 mm) of insulation away to expose the end of the wire.

ATTENTION

Be careful when stripping wires. Wire fragments that fall into a module could cause damage at power up.

3. At one end of the cable, twist the drain wire and foil shield together, bend them away from the cable, and apply shrink wrap. Then earth ground at the preferred location based on the type of sensor you are using. See Grounding on page 3-9.
4. At the other end of the cable, cut the drain wire and foil shield back to the cable and apply shrink wrap.
5. Connect the signal wires to the terminal block. Connect the other end of the cable to the analog input device.
6. Repeat steps 1 through 5 for each channel on the module.

NOTE See Appendix D *Using Thermocouple Junctions* for additional information on wiring grounded, ungrounded, and exposed thermocouple types.

Wiring Diagram

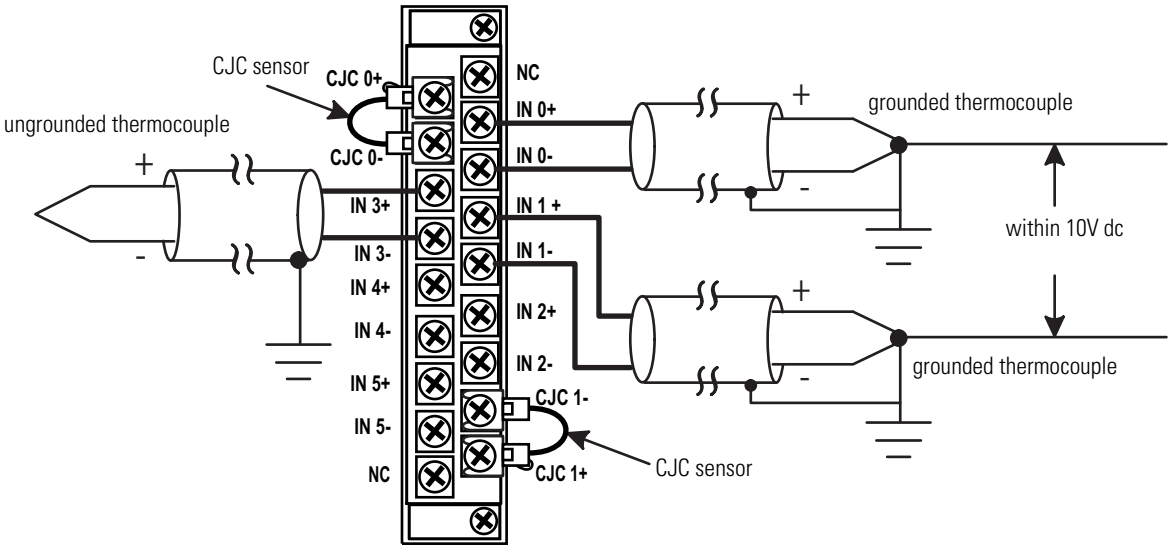

NOTE When using an ungrounded thermocouple, the shield must be connected to ground at the module end.

IMPORTANT When using grounded and/or exposed thermocouples that are touching electrically conductive material, the ground potential between any two channels cannot exceed ±10V dc, or temperature readings will be inaccurate.

Cold Junction Compensation

To obtain accurate readings from each of the channels, the cold junction temperature (temperature at the module's terminal junction between the thermocouple wire and the input channel) must be compensated for. Two cold junction compensating thermistors have been integrated in the removable terminal block. These thermistors must remain installed to retain accuracy.

ATTENTION Do not remove or loosen the cold junction compensating thermistor assemblies located on between the two upper and lower CJC terminals. Both thermistor assemblies are critical to ensure accurate thermocouple input readings at each channel. The module will operate in the thermocouple mode, but at reduced accuracy if either CJC sensor is removed. See Determining Open-Circuit Response (Bits 6 and 5) on page 4-10.

If either of the thermistor assemblies are accidentally removed, re-install them by connecting each one across each pair of CJC terminals.

Calibration

The thermocouple module is initially calibrated at the factory. The module also has an autocalibration function.

When an autocalibration cycle takes place, the module's multiplexer is set to system ground potential and an A/D reading is taken. The A/D converter then sets its internal input to the module's precision voltage source, and another reading is taken. The A/D converter uses these numbers to compensate for system offset (zero) and gain (span) errors.

Autocalibration of a channel occurs whenever a channel is enabled. You can also program your module to perform cyclic calibration cycles, every five minutes. See Selecting Enable/Disable Cyclic Calibration (Word 6, Bit 0) on page 4-14.

To maintain optimal system accuracy, periodically perform an autocalibration cycle.

IMPORTANT The module does not convert input data while the calibration cycle is in progress following a change in configuration. Module scan times are increased by up to 112 ms during cyclic autocalibration.

Module Data, Status, and Channel Configuration

After installing the 1769-IT6 thermocouple/mV input module, you must configure it for operation, usually using the programming software compatible with the controller (for example, RSLogix 500 or RSLogix 5000). Once configuration is complete and reflected in the ladder logic, you need to operate the module and verify its configuration.

This chapter contains information on the following:

- module memory map
- accessing input image file data
- configuring channels
- determining effective resolution and range
- determining module update time

Module Memory Map

The module uses eight input words for data and status bits (input image), and seven configuration words.

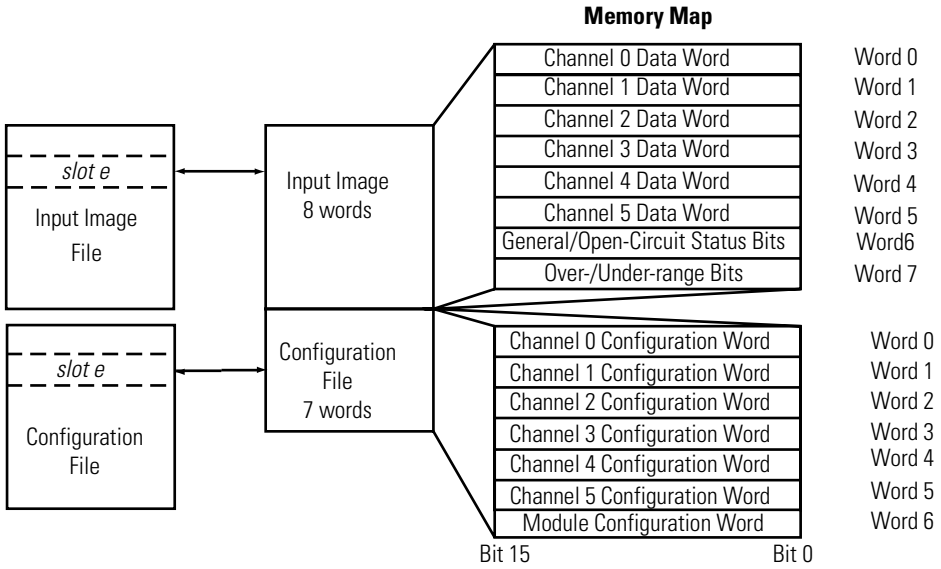

NOTE Not all controllers support program access to the configuration file. Refer to your controller's user manual.

Accessing Input Image File Data

The input image file represents data words and status words. Input words 0 through 5 hold the input data that represents the value of the analog inputs for channels 0 through 5. These data words are valid only when the channel is enabled and there are no errors. Input words 6 and 7 hold the status bits. To receive valid status information, the channel must be enabled.

You can access the information in the input image file using the programming software configuration screen. For information on configuring the module in a MicroLogix 1500 system using RSLogix 500, see Appendix E; for CompactLogix using RSLogix 5000, see Appendix F; for 1769-ADN DeviceNet Adapter using RSNetworx, see Appendix G.

Input Data File

The input data table allows you to access module read data for use in the control program, via word and bit access. The data table structure is shown in table below.

Table 4.1 Input Data Table

Word/Bit[1]	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0	Analog Input Data Channel 0															
1	Analog Input Data Channel 1															
2	Analog Input Data Channel 2															
3	Analog Input Data Channel 3															
4	Analog Input Data Channel 4															
5	Analog Input Data Channel 5															
6	OC7	OC6	OC5	OC4	OC3	OC2	OC1	OC0	S7	S6	S5	S4	S3	S2	S1	S0
7	U0	O0	U1	O1	U2	O2	U3	O3	U4	O4	U5	O5	U6	O6	U7	O7

(1) Changing bit values is not supported by all controllers. Refer to your controller manual for details.

Input Data Values

Data words 0 through 5 correspond to channels 0 through 5 and contain the converted analog input data from the input device. The most significant bit, bit 15, is the sign bit (SGN).

General Status Bits (S0 to S7)

Bits S0 through S5 of word 6 contain the general status information for channels 0 through 5, respectively. Bits S6 and S7 contain general status information for the two CJC sensors (S6 corresponds to CJC0, S7 to CJC1). If set (1), these bits indicate an error (over- or under-range, open-circuit or input data not valid condition) associated with that channel. The data not valid condition is described below.

Input Data Not Valid Condition

The general status bits S0 to S5 also indicate whether or not the input data for a particular channel, 0 through 5, is being properly converted (valid) by the module. This “invalid data” condition can occur (bit set) when the download of a new configuration to a channel is accepted by the module (proper configuration) but before the A/D converter can provide valid (properly configured) data to the 1769 bus master/controller. The following information highlights the bit operation of the Data Not Valid condition.

1. The default and module power-up bit condition is reset (0).
2. The bit condition is set (1) when a new configuration is received and determined valid by the module. The set (1) bit condition remains until the module begins converting analog data for the previously accepted new configuration. When conversion begins, the bit condition is reset (0). The amount of time it takes for the module to begin the conversion process depends on the number of channels being configured and the amount of configuration data downloaded by the controller.

   NOTE If the new configuration is invalid, the bit function remains reset (0) and the module posts a configuration error. See Configuration Errors on page 5-5.

3. If A/D hardware errors prevent the conversion process from taking place, the bit condition is set (1).

Open-Circuit Flag Bits (OC0 to OC7)

Bits OC0 through OC5 of word 6 contain open-circuit error information for channels 0 through 5, respectively. Errors for the CJC sensors are indicated in OC6 and OC7. The bit is set (1) when an open-circuit condition exists. See Open-Circuit Detection on page 5-3 for more information on open-circuit operation.

Over-Range Flag Bits (O0 to O7)

Over-range bits for channels 0 through 5 and the CJC sensors are contained in word 7, even-numbered bits. They apply to all input types. When set (1), the over-range flag bit indicates an input signal that is at the maximum of its normal operating range for the represented channel or sensor. The module automatically resets (0) the bit when the data value falls below the maximum for that range.

Under-Range Flag Bits (U0 - U7)

Under-range bits for channels 0 through 5 and the CJC sensors are contained in word 7, odd-numbered bits. They apply to all input types. When set (1), the under-range flag bit indicates an input signal that is at the minimum of its normal operating range for the represented channel or sensor. The module automatically resets (0) the bit when the under-range condition is cleared and the data value is within the normal operating range.

Configuring Channels

After module installation, you must configure operation details, such as thermocouple type, temperature units, etc., for each channel. Channel configuration data for the module is stored in the controller configuration file, which is both readable and writable.

The configuration data file is shown below. Bit definitions are provided in Channel Configuration on page 4-6. Detailed definitions of each of the configuration parameters follow the table.

Configuration Data File

The default value of the configuration data is represented by zeros in the data file. The structure of the channel configuration file is shown below.

Word/ Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
0	Enable Channel 0	Data Format Channel 0			Input Type Channel 0				Temperature Units Channel 0	Open-Circuit Condition Channel 0		Not Used	Not Used	Filter Frequency Channel 0		
1	Enable Channel 1	Data Format Channel 1			Input Type Channel 1				Temperature Units Channel 1	Open-Circuit Condition Channel 1		Not Used	Not Used	Filter Frequency Channel 1		
2	Enable Channel 2	Data Format Channel 2			Input Type Channel 2				Temperature Units Channel 2	Open-Circuit Condition Channel 2		Not Used	Not Used	Filter Frequency Channel 2		
3	Enable Channel 3	Data Format Channel 3			Input Type Channel 3				Temperature Units Channel 3	Open-Circuit Condition Channel 3		Not Used	Not Used	Filter Frequency Channel 3		
4	Enable Channel 4	Data Format Channel 4			Input Type Channel 4				Temperature Units Channel 4	Open-Circuit Condition Channel 4		Not Used	Not Used	Filter Frequency Channel 4		
5	Enable Channel 5	Data Format Channel 5			Input Type Channel 5				Temperature Units Channel 5	Open-Circuit Condition Channel 5		Not Used	Not Used	Filter Frequency Channel 5		
6	Reserved															Enable/ Disable Cyclic Calibration

The configuration file can also be modified through the control program, if supported by the controller. For information on configuring the module using RSLogix 500 (with MicroLogix 1500 controller), see Appendix E; for RSLogix 5000 (CompactLogix controller), see Appendix F; for RSNetworx (1769-ADN), see Appendix G.

The structure and bit settings are shown in Channel Configuration on page 4-6.

Channel Configuration

Each channel configuration word consists of bit fields, the settings of which determine how the channel operates. See the table below and the descriptions that follow for valid configuration settings and their meanings.

To Select		Make these bit settings															
		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Filter Frequency	10 Hz												Not Used(1)		1	1	0
	60 Hz														0	0	0
	50 Hz														0	0	1
	250Hz														0	1	1
	500 Hz														1	0	0
	1 kHz														1	0	1
Open Circuit	Upscale										0	0					
	Downscale										0	1					
	Hold Last State										1	0					
	Zero										1	1					
Temperature Units	Degrees C									0							
	Degrees F									1							
Input Type	Thermocouple J					0	0	0	0								
	Thermocouple K					0	0	0	1								
	Thermocouple T					0	0	1	0								
	Thermocouple E					0	0	1	1								
	Thermocouple R					0	1	0	0								
	Thermocouple S					0	1	0	1								
	Thermocouple B					0	1	1	0								
	Thermocouple N					0	1	1	1								
	Thermocouple C					1	0	0	0								
	-50 to +50 mV					1	0	0	1								
	-100 to +100 mV					1	0	1	0								
Data Format	Raw/Proportional		0	0	0												
	Engineering Units		0	0	1												
	Engineering Units X 10		1	0	0												
	Scaled-for-PID		0	1	0												
	Percent Range		0	1	1												
Enable Channel	Disable	0															
	Enable	1															

(1) An attempt to write any non-valid (spare) bit configuration into any selection field results in a module configuration error.

NOTE Default settings for a particular function are indicated by zero(s). For example, the default filter frequency is 60Hz.

Enabling or Disabling a Channel (Bit 15)

You can enable or disable each of the six channels individually using bit 15. The module only scans enabled channels. Enabling a channel forces it to be recalibrated before it measures input data. Disabling a channel sets the channel data word to zero.

NOTE When a channel is not enabled (0), no input is provided to the controller by the A/D converter. This speeds up the response of the active channels, improving performance.

Selecting Data Formats (Bits 14 through 12)

This selection configures channels 0 through 5 to present analog data in any of the following formats:

- Raw/Proportional Data
- Engineering Units x 1
- Engineering Units x 10
- Scaled for PID
- Percent Range

Table 4.2 Channel Data Word Format

Input Type	Data Format						
	Engineering Units x1		Engineering Units x10		Scaled-for-PID	Raw/ Proportional Data	Percent Range
	°C	°F	°C	°F			
J	-2100 to +12000	-3460 to +21920	-210 to +1200	-346 to +2192	0 to +16383	-32767 to +32767	0 to +10000
K	-2700 to +13700	-4540 to +24980	-270 to +1370	-454 to +2498	0 to +16383	-32767 to +32767	0 to +10000
T	-2700 to +4000	-4540 to +7520	-270 to +400	-454 to +752	0 to +16383	-32767 to +32767	0 to +10000
E	-2700 to +10000	-4540 to +18320	-270 to +1000	-454 to +1832	0 to +16383	-32767 to +32767	0 to +10000
R	0 to +17680	+320 to 32140	0 to +1768	+32 to 3214	0 to +16383	-32767 to +32767	0 to +10000
S	0 to +17680	+320 to 32140	0 to +1768	+32 to 3214	0 to +16383	-32767 to +32767	0 to +10000
B	+3000 to 18200	+5720 to 32767(1)	+300 to 1820	+572 to 3308	0 to +16383	-32767 to +32767	0 to +10000
N	-2100 to +13000	-3460 to +23720	-210 to +1300	-346 to +2372	0 to +16383	-32767 to +32767	0 to +10000
C	0 to +23150	+320 to 32767(1)	0 to +2315	+32 to 4199	0 to +16383	-32767 to +32767	0 to +10000
±50 mV	-5000 to +5000(2)		-500 to +500(2)		0 to +16383	-32767 to +32767	0 to +10000
±100 mV	-10000 to 10000(2)		-1000 to 1000(2)		0 to +16383	-32767 to +32767	0 to +10000

(1) Type B and C thermocouples cannot be represented in engineering units x1 (°F) above 3276.7 °F; therefore, it will be treated as an over-range error.

(2) When millivolts are selected, the temperature setting is ignored. Analog input date is the same for °C or °F selection.

NOTE The engineering units data formats represent real engineering temperature units provided by the module to the controller. The raw/proportional counts, scaled-for-PID and percent of full-scale data formats may yield the highest effective resolutions, but may also require that you convert channel data to real engineering units in your control program.

Raw/Proportional Data

The value presented to the controller is proportional to the selected input and scaled into the maximum data range allowed by the bit resolution of the A/D converter and filter selected. The raw/proportional data format also provides the best resolution of all the data formats.

If you select the raw/proportional data format for a channel, the data word will be a number between -32767 and +32767. For example, if a type J thermocouple is selected, the lowest temperature of -210°C corresponds to -32767 counts. The highest temperature of 1200°C corresponds to +32767. See Determining Effective Resolution and Range on page 4-14.

Engineering Units x 1

When using this data format for a thermocouple or millivolt input, the module scales the thermocouple or millivolt input data to the actual engineering values for the selected millivolt input or thermocouple type. It expresses temperatures in 0.1°C or 0.1°F units. For millivolt inputs, the module expresses voltages in 0.01 mV units.

NOTE Use the engineering units x 10 setting to produce temperature readings in whole degrees Celsius or Fahrenheit.

The resolution of the engineering units x 1 data format is dependent on the range selected and the filter selected. See Determining Effective Resolution and Range on page 4-14.

Engineering Units x 10

When using a thermocouple input with this data format, the module scales the input data to the actual temperature values for the selected thermocouple type. With this format, the module expresses temperatures in 1°C or 1°F units. For millivolt inputs, the module expresses voltages in 0.1 mV units.

The resolution of the engineering units x 10 data format is dependent on the range selected and the filter selected. See Determining Effective Resolution and Range on page 4-14.

Scaled-for-PID

The value presented to the controller is a signed integer with 0 representing the lower input range and +16383 representing the upper input range.

To obtain the value, the module scales the input signal range to a 0 to +16383 range, which is standard to the PID algorithm for the MicroLogix 1500 and other Allen-Bradley controllers (e.g. SLC). For example, if type J thermocouple is used, the lowest temperature for the thermocouple is -210°C, which corresponds to 0 counts. The highest temperature in the input range, 1200°C, corresponds to +16383 counts.

Percent Range

Input data is presented to the user as a percent of the specified range. The module scales the input signal range to a 0 to +10000 range. For example, using a type J thermocouple, the range -210°C to +1200°C is represented as 0% to 100%. See Determining Effective Resolution and Range on page 4-14.

Selecting Input Type (Bits 11 through 8)

Bits 11 through 8 in the channel configuration word indicate the type of thermocouple or millivolt input device. Each channel can be individually configured for any type of input.

Selecting Temperature Units (Bit 7)

The module supports two different linearized/scaled ranges for thermocouples, degrees Celsius (°C) and degrees Fahrenheit (°F). Bit 7 is ignored for millivolt input types, or when raw/proportional, scaled-for-PID, or percent data formats are used.

IMPORTANT If you are using engineering units x 1 data format and degrees Fahrenheit temperature units, thermocouple types B and C cannot achieve full-scale temperature with 16-bit signed numerical representation. An over-range error will occur for the configured channel if it tries to represent the full-scale value. The maximum representable temperature is 3276.7°F.

Determining Open-Circuit Response (Bits 6 and 5)

An open-circuit condition occurs when an input device or its extension wire is physically separated or open. This can happen if the wire is cut or disconnected from the terminal block.

NOTE If either CJC sensor is removed from the module terminal block, its open-circuit bit is set (1) and the module continues to calculate thermocouple readings at reduced accuracy. If an open CJC circuit is detected at power-up, the module uses 25°C as the sensed temperature at that location. If an open CJC circuit is detected during normal operation, the last valid CJC reading is used. An input channel configured for millivolt input is not affected by CJC open-circuit conditions. See Open-Circuit Detection on page 5-3 for additional details.

Bits 6 and 5 define the state of the channel data word when an open-circuit condition is detected for the corresponding channel. The module overrides the actual input data depending on the option that you specify when it detects an open circuit. The open-circuit options are explained in the table below.

Table 4.3 Open-Circuit Response Definitions

Response Option	Definition
Upscale	Sets the input data value to full upper scale value of channel data word. The full-scale value is determined by the selected input type and data format.
Downscale	Sets the input data value to full lower scale value of channel data word. The low scale value is determined by the selected input type and data format.
Last State	Sets the input data value to the last input value prior to the detection of the open-circuit.
Zero	Sets the input data value to 0 to force the channel data word to 0.

Selecting Input Filter Frequency (Bits 2 through 0)

The input filter selection field allows you to select the filter frequency for each channel and provides system status of the input filter setting for channels 0 through 5. The filter frequency affects the following, as explained later in this chapter:

- noise rejection characteristics for module inputs
- channel step response
- channel cut-off frequency
- effective resolution
- module update time

Effects of Filter Frequency on Noise Rejection

The filter frequency that you choose for a module channel determines the amount of noise rejection for the inputs. A lower frequency (50 Hz versus 500 Hz) provides better noise rejection and increases effective resolution, but also increases channel update time. A higher filter frequency provides lower noise rejection, but decreases the channel update time and effective resolution.

When selecting a filter frequency, be sure to consider cut-off frequency and channel step response to obtain acceptable noise rejection. Choose a filter frequency so that your fastest-changing signal is below that of the filter's cut-off frequency.

Common Mode Rejection is better than 115 dB at 50 and 60 Hz, with the 50 and 60 Hz filters selected, respectively, or with the 10Hz filter selected. The module performs well in the presence of common mode noise as long as the signals applied to the user positive and negative input terminals do not exceed the common mode voltage rating (±10V) of the module. Improper earth ground may be a source of common mode noise.

NOTE Transducer power supply noise, transducer circuit noise, or process variable irregularities may also be sources of normal mode noise.

NOTE The filter frequency of the module's CJC sensors is the lowest filter frequency of any enabled thermocouple type to maximize the trade-offs between effective resolution and channel update time.

Effects of Filter Frequency on Channel Step Response

The selected channel filter frequency determines the channel's step response. The step response is the time required for the analog input signal to reach 100% of its expected final value, given a full-scale step change in the input signal. This means that if an input signal changes faster than the channel step response, a portion of that signal will be attenuated by the channel filter. The channel step response is calculated by a settling time of 3 x (1/filter frequency).

Table 4.4 Filter Frequency and Step Response

Filter Frequency	Step Response
10 Hz	300 ms
50 Hz	60 ms
60 Hz	50 ms
250 Hz	12 ms
500 Hz	6 ms
1 kHz	3 ms

Channel Cut-Off Frequency

The filter cut-off frequency, -3 dB, is the point on the frequency response curve where frequency components of the input signal are passed with 3 dB of attenuation. The following table shows cut-off frequencies for the supported filters.

Table 4.5 Filter Frequency versus Channel Cut-off Frequency

Filter Frequency	Cut-off Frequency
10 Hz	2.62 Hz
50 Hz	13.1 Hz
60 Hz	15.7 Hz
250 Hz	65.5 Hz
500 Hz	131 Hz
1 kHz	262 Hz

All input frequency components at or below the cut-off frequency are passed by the digital filter with less than 3 dB of attenuation. All frequency components above the cut-off frequency are increasingly attenuated as shown in the graphs on page 4-13.

Figure 4.1 Frequency Response Graphs

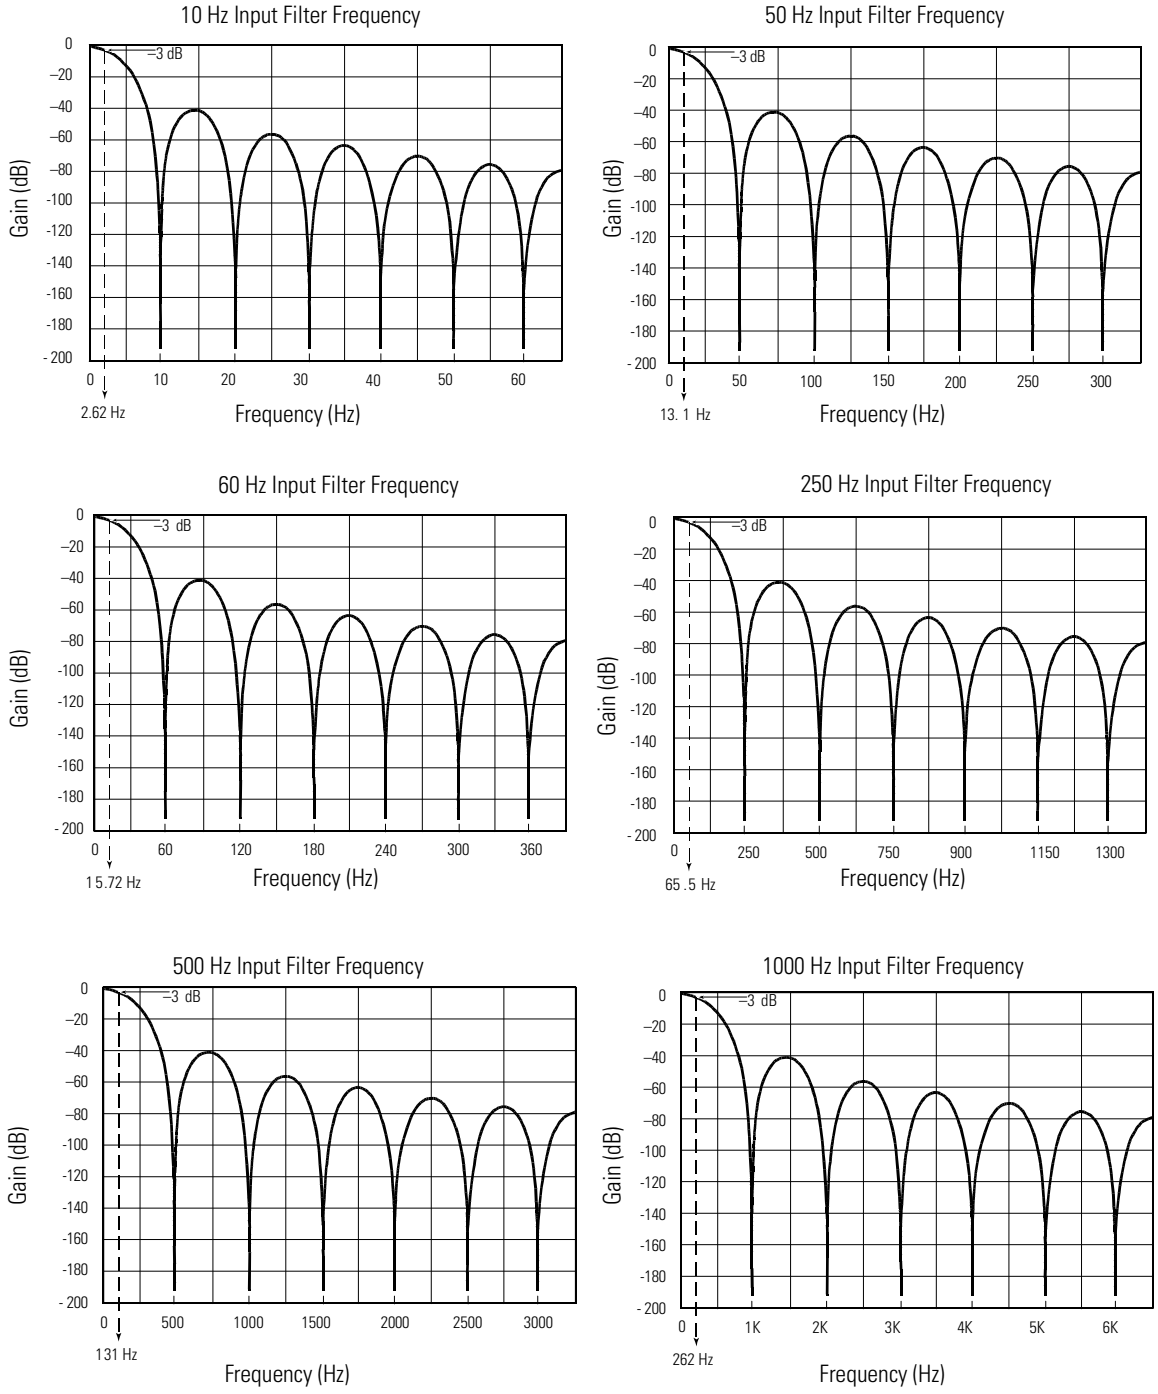

The cut-off frequency for each channel is defined by its filter frequency selection. Choose a filter frequency so that your fastest changing signal is below that of the filter's cut-off frequency. The cut-off frequency should not be confused with the update time. The cut-off frequency relates to how the digital filter attenuates frequency components of the input signal.

The update time defines the rate at which an input channel is scanned and its channel data word is updated.

Selecting Enable/Disable Cyclic Calibration (Word 6, Bit 0)

Cyclic calibration functions to reduce offset and gain drift errors due to temperature changes within the module. By setting word 6, bit 0 to 0, you can configure the module to perform calibration on all enabled channels. Setting this bit to 1 disables cyclic calibration.

You can program the calibration cycle to occur whenever you desire for systems that allow modifications to the state of this bit via the ladder program. When the calibration function is enabled (bit = 0), a calibration cycle occurs once for all enabled channels. If the function remains enabled, a calibration cycle occurs every five minutes thereafter. The calibration cycle of each enabled channel is staggered over several module scan cycles within the five minute period to limit impact on the system response speed.

See Effects of Autocalibration on Module Update Time on page 4-34.

Determining Effective Resolution and Range

The effective resolution for an input channel depends upon the filter frequency selected for that channel. The following graphs provide the effective resolution for each of the range selections at the six available frequencies. These graphs do not include the affects of unfiltered input noise. Choose the frequency that most closely matches your requirements.

Figure 4.2 Effective Resolution Versus Input Filter Selection for Type B Thermocouples Using 10, 50, and 60 Hz Filters

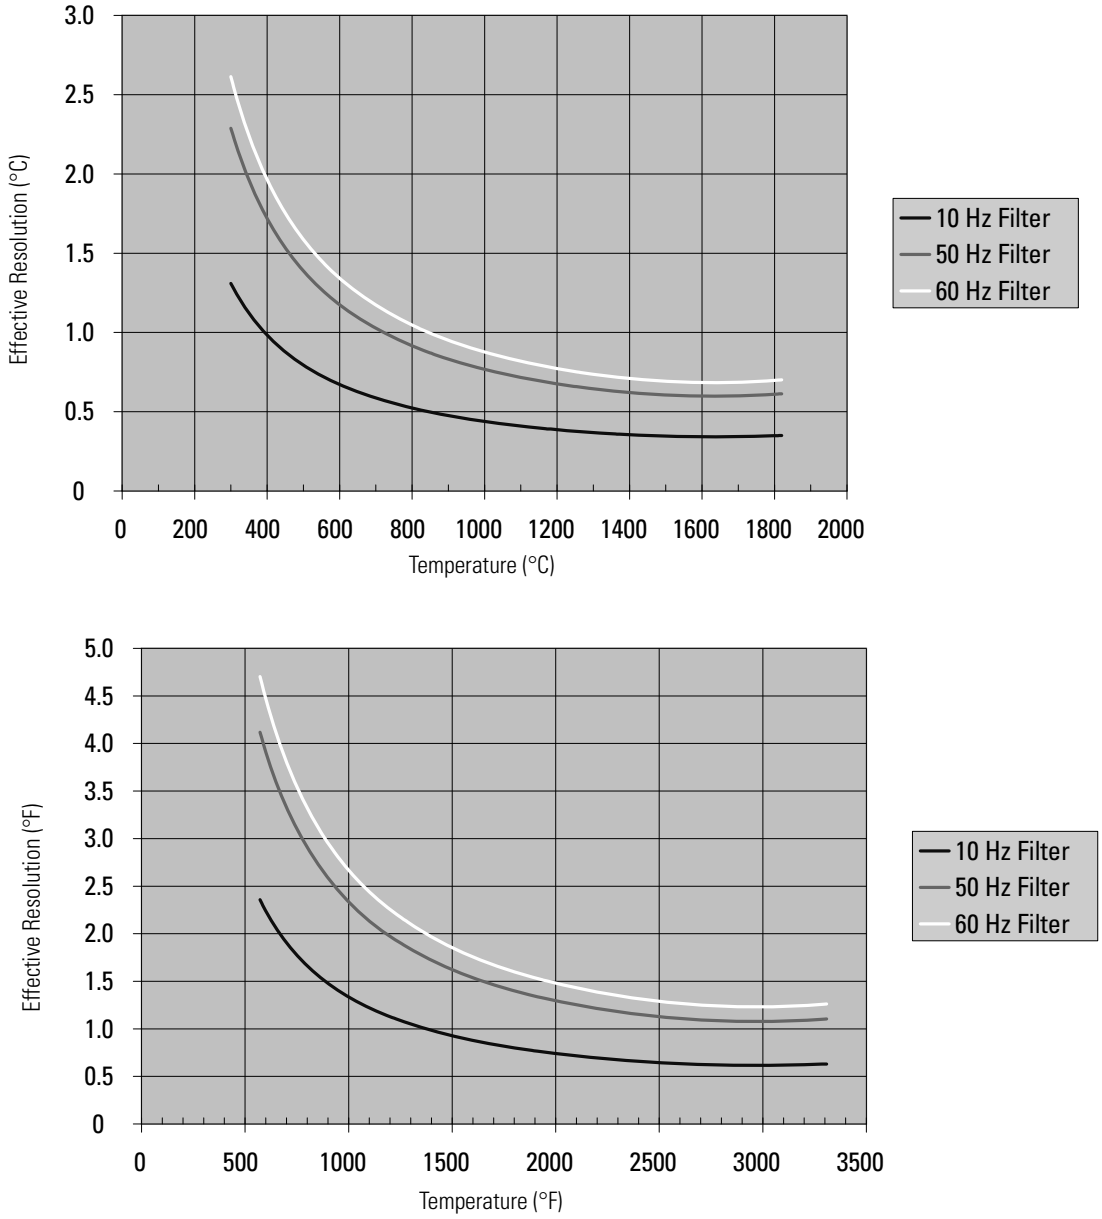

Figure 4.3 Effective Resolution Versus Input Filter Selection for Type B Thermocouples Using 250, 500, and 1k Hz Filters

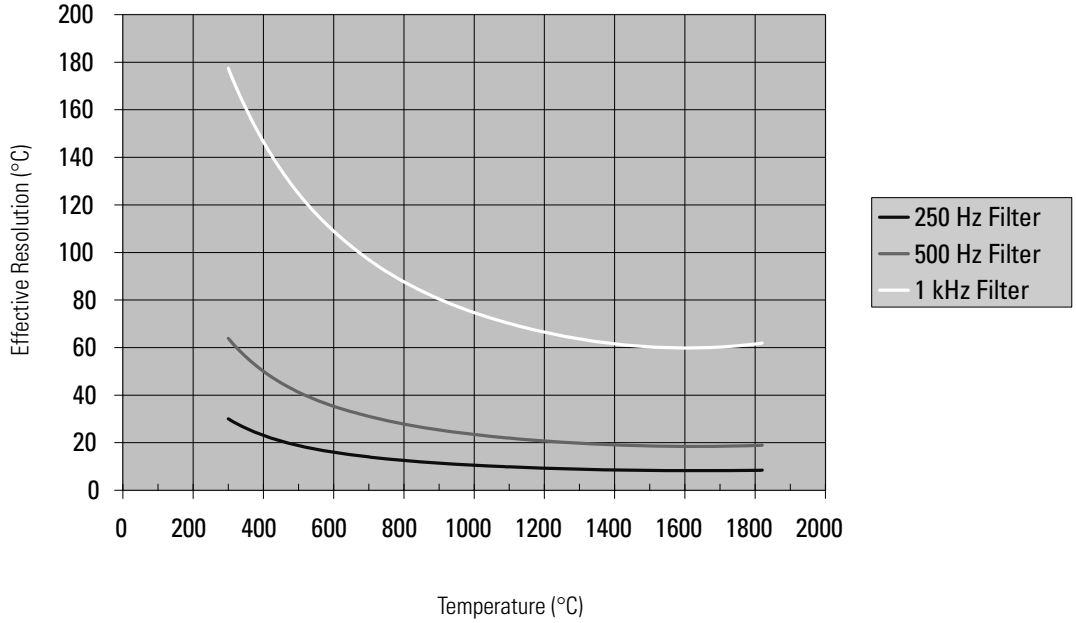

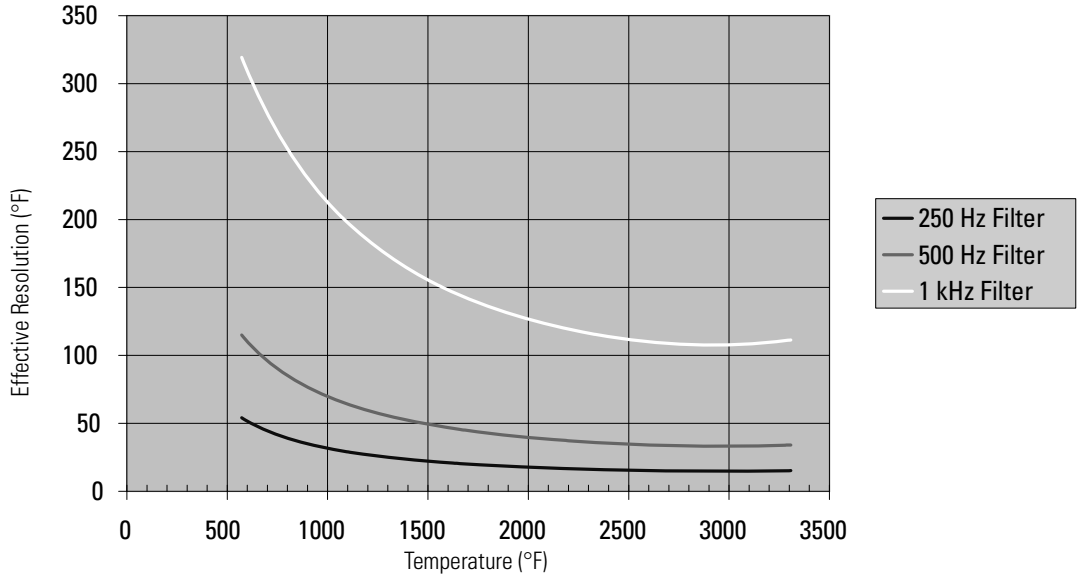

Figure 4.4 Effective Resolution Versus Input Filter Selection for Type C Thermocouples Using 10, 50, and 60 Hz Filters

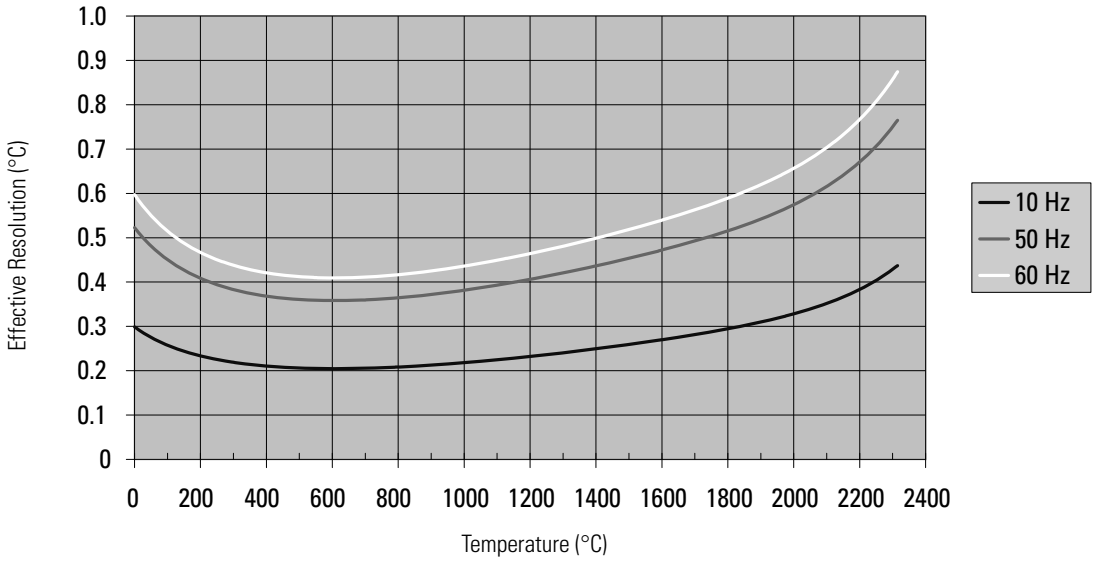

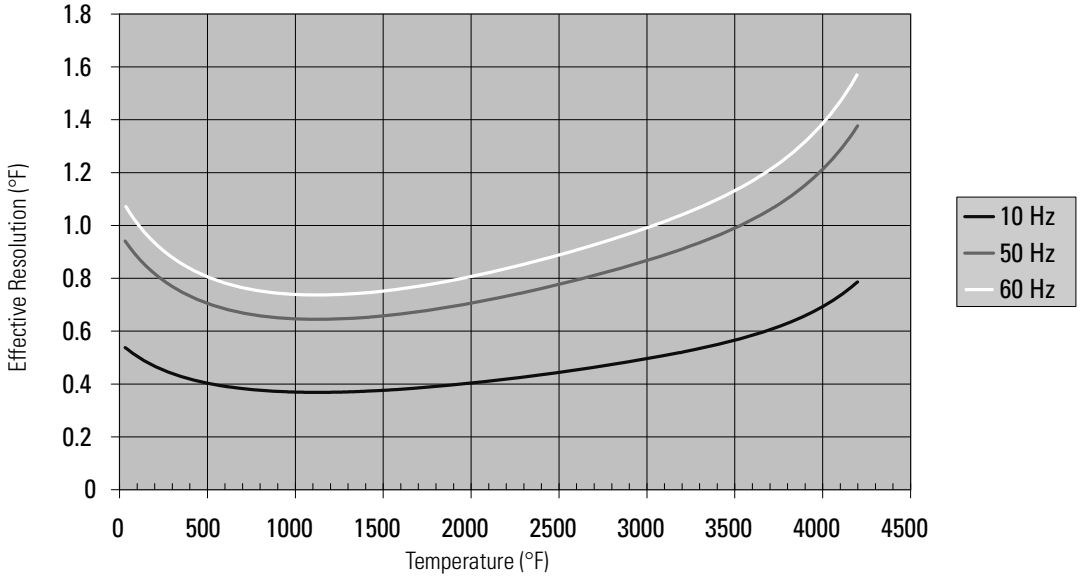

Figure 4.5 Effective Resolution Versus Input Filter Selection for Type C Thermocouples Using 250, 500, and 1k Hz Filters

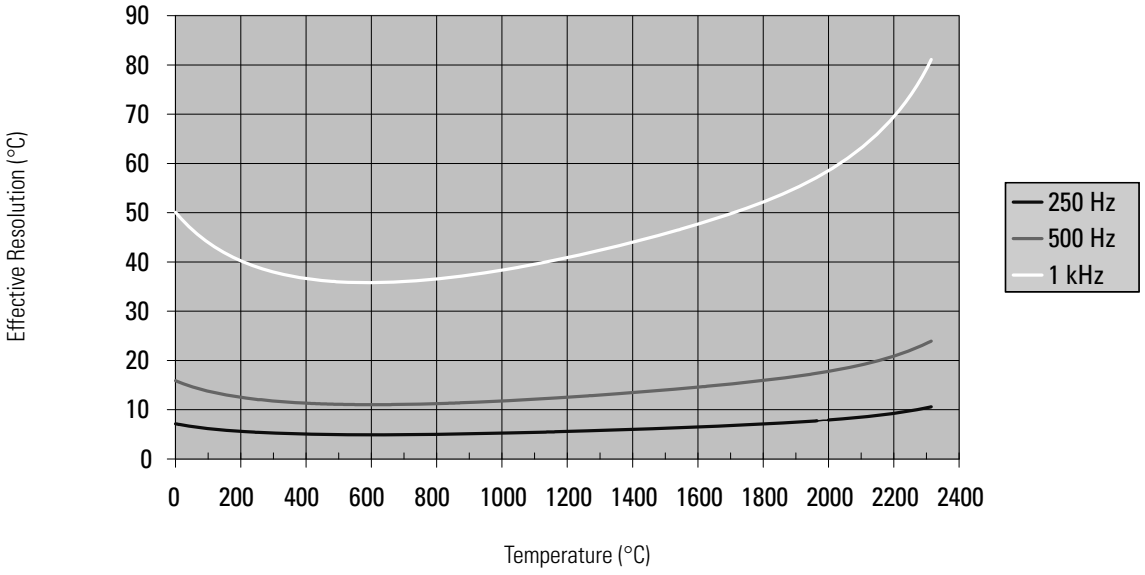

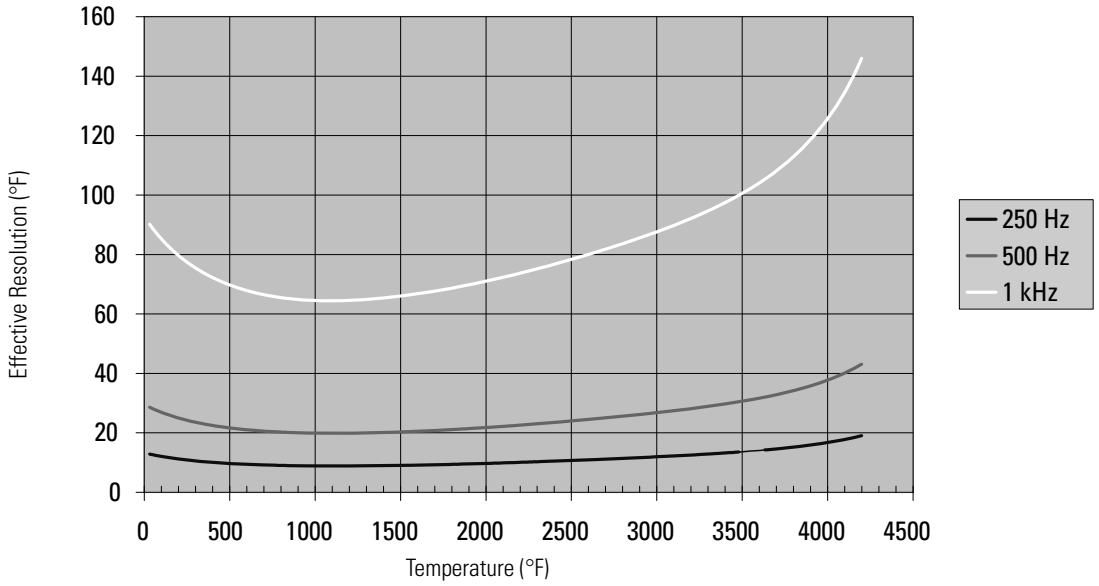

Figure 4.6 Effective Resolution Versus Input Filter Selection for Type E Thermocouples Using 10, 50, and 60 Hz Filters

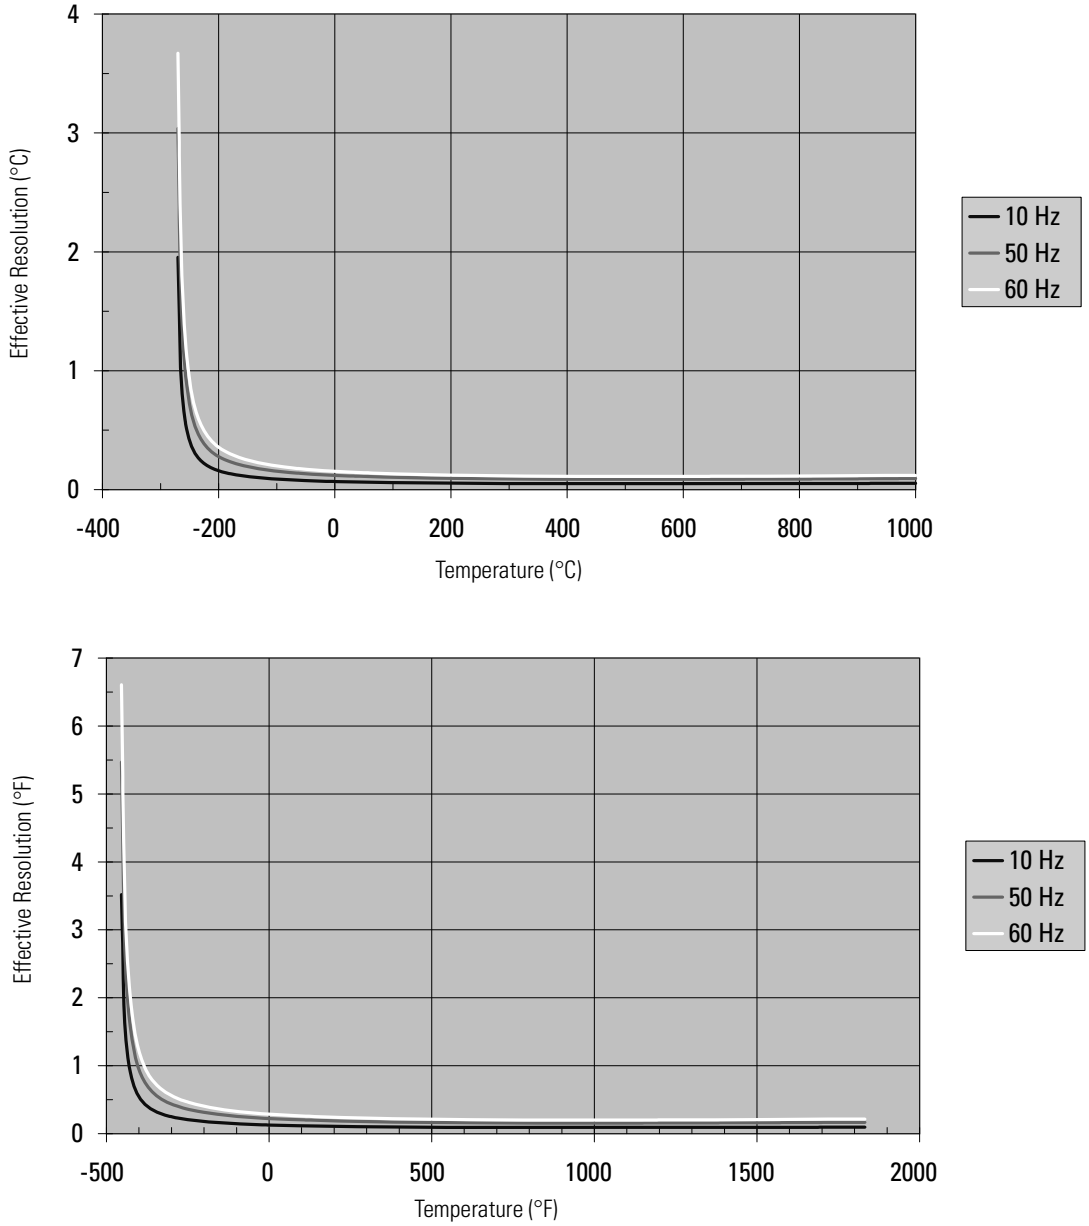

Figure 4.7 Effective Resolution Versus Input Filter Selection for Type E Thermocouples Using 250, 500, and 1k Hz Filters

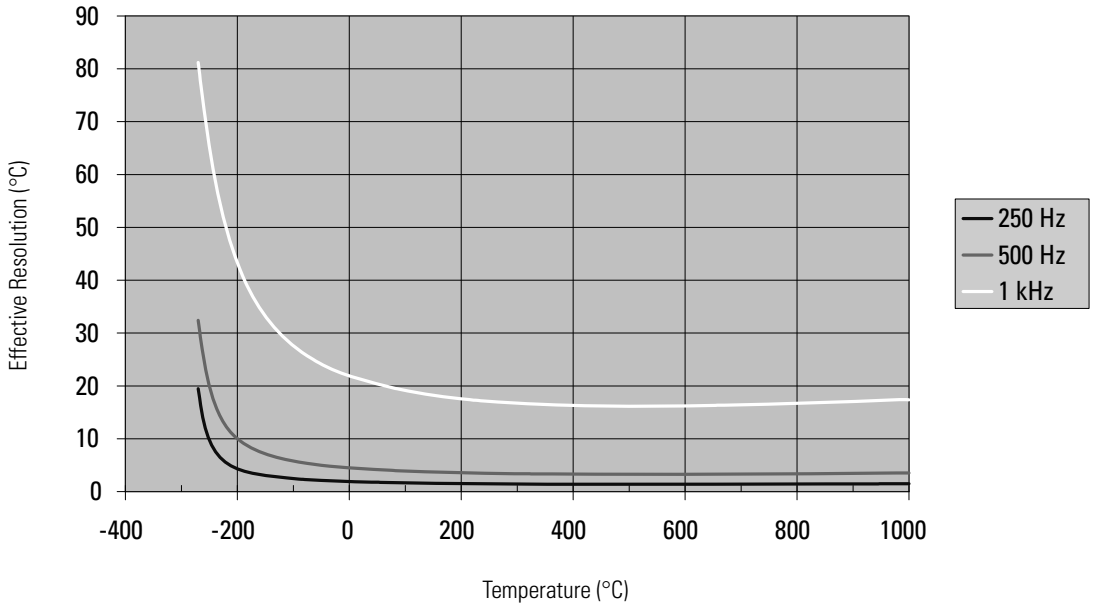

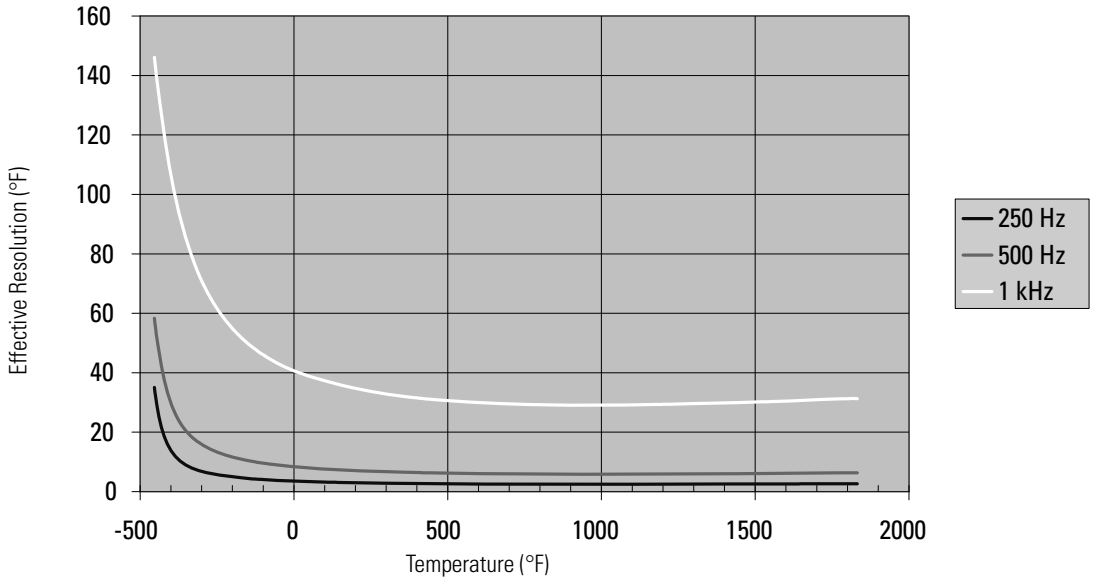

Figure 4.8 Effective Resolution Versus Input Filter Selection for Type J Thermocouples Using 10, 50, and 60 Hz Filters

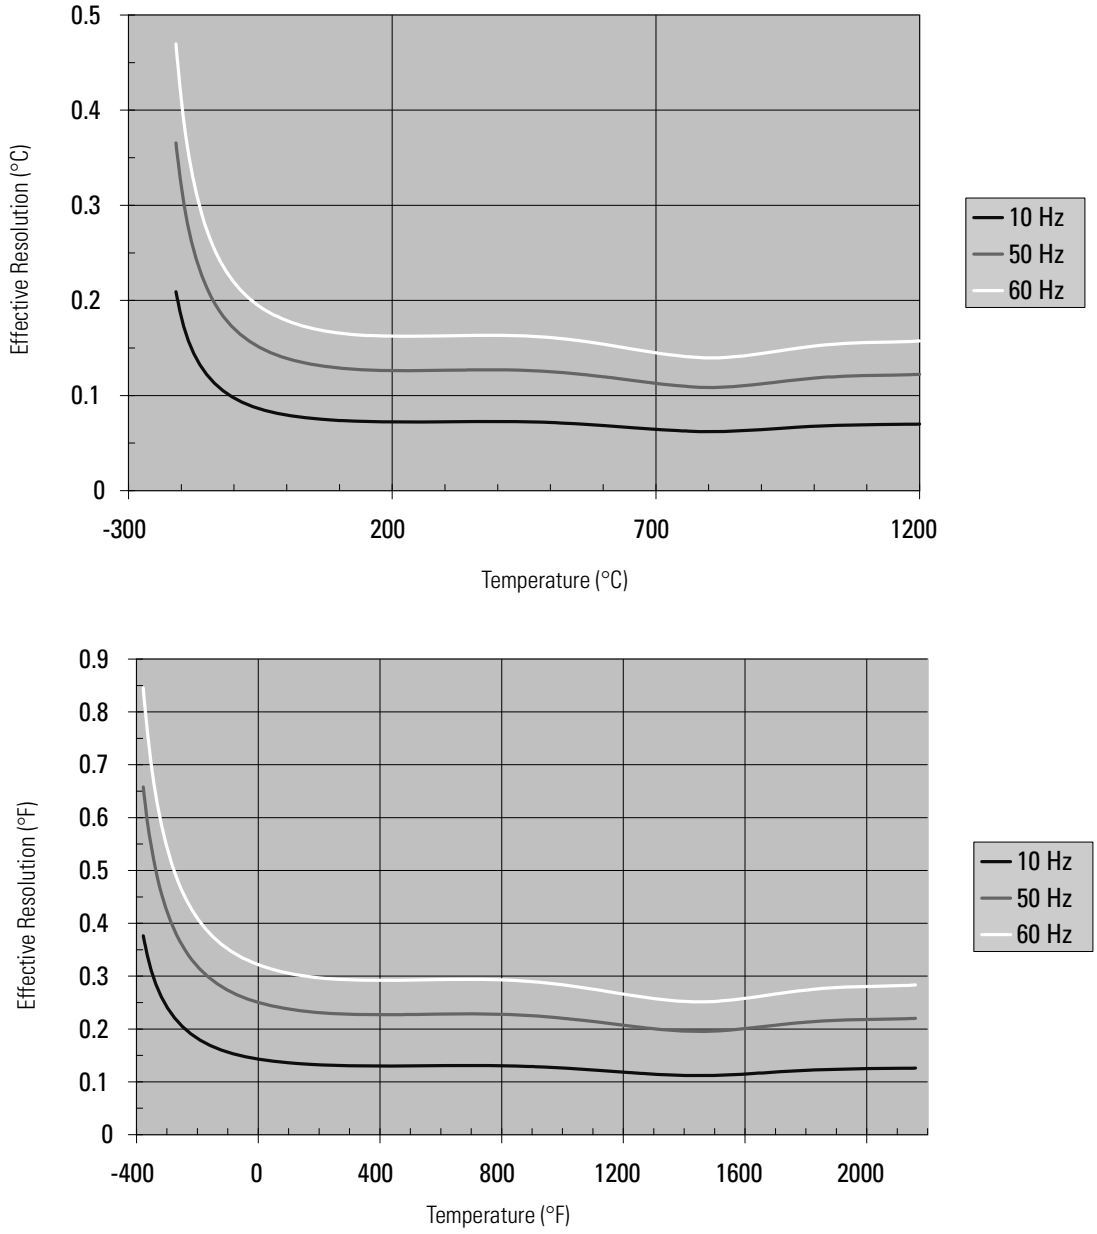

Figure 4.9 Effective Resolution Versus Input Filter Selection for Type J Thermocouples Using 250, 500, and 1k Hz Filters

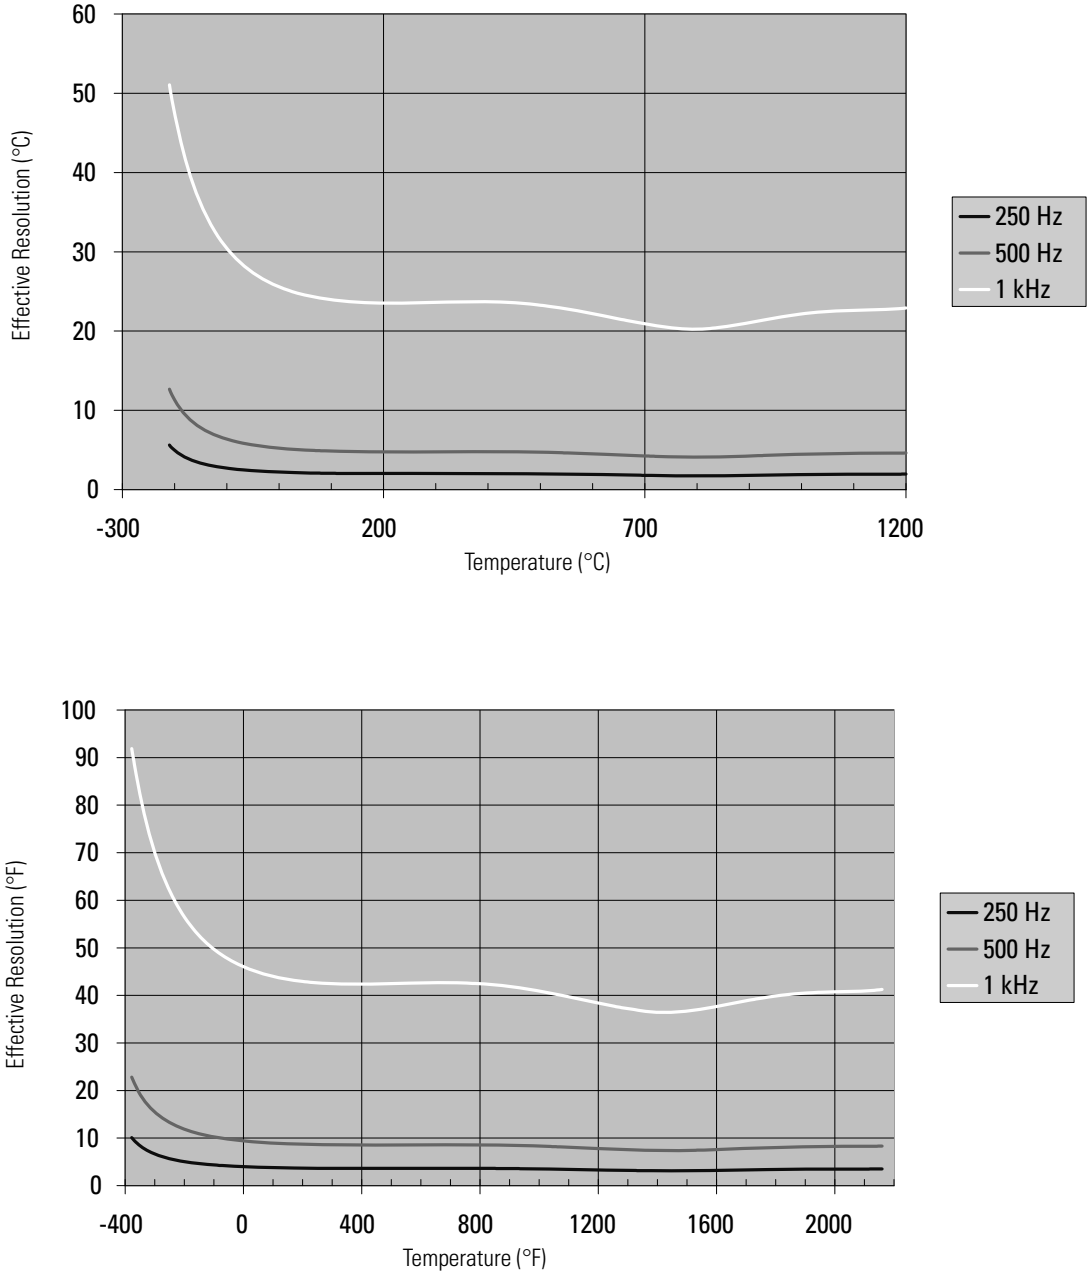

Figure 4.10 Effective Resolution Versus Input Filter Selection for Type K Thermocouples Using 10, 50, and 60 Hz Filters

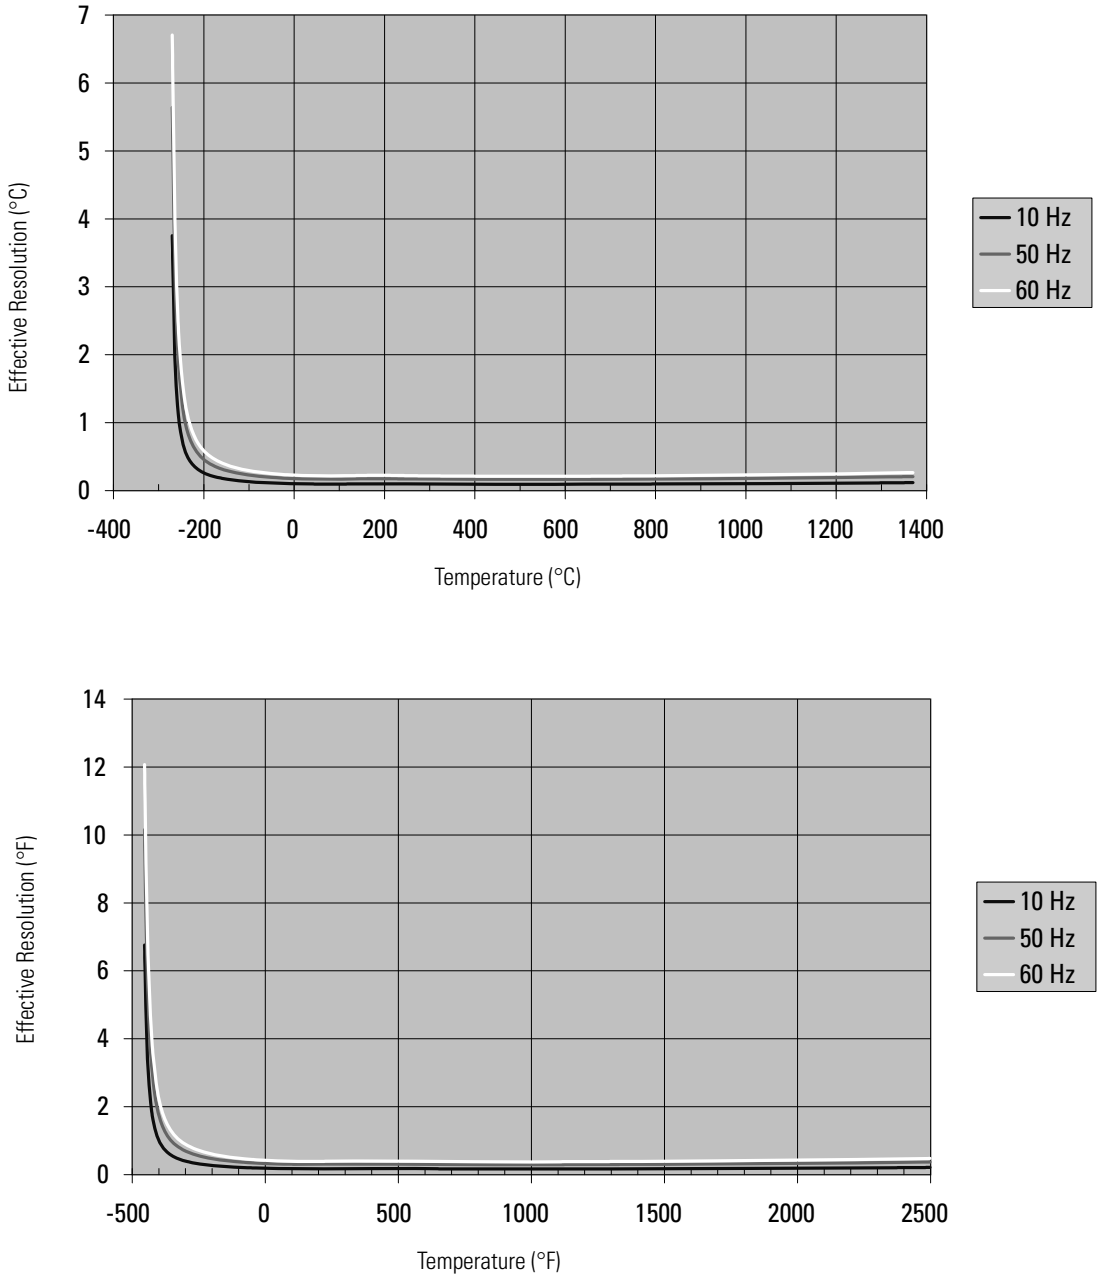

Figure 4.11 Effective Resolution Versus Input Filter Selection for Type K Thermocouples Using 250, 500, and 1k Hz Filters

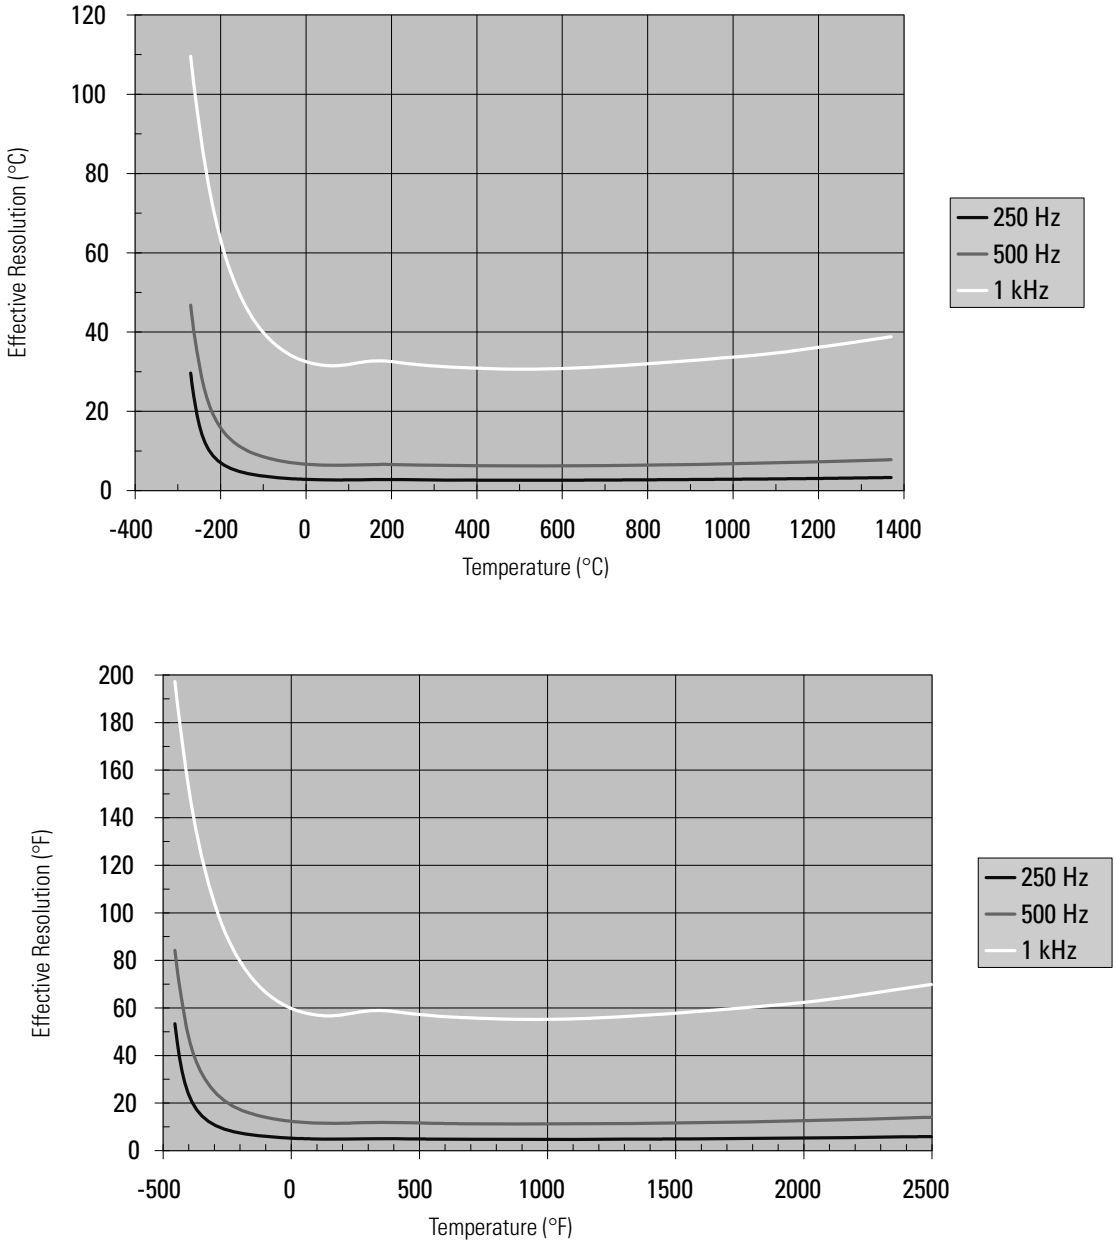

Figure 4.12 Effective Resolution Versus Input Filter Selection for Type N Thermocouples Using 10, 50, and 60 Hz Filters

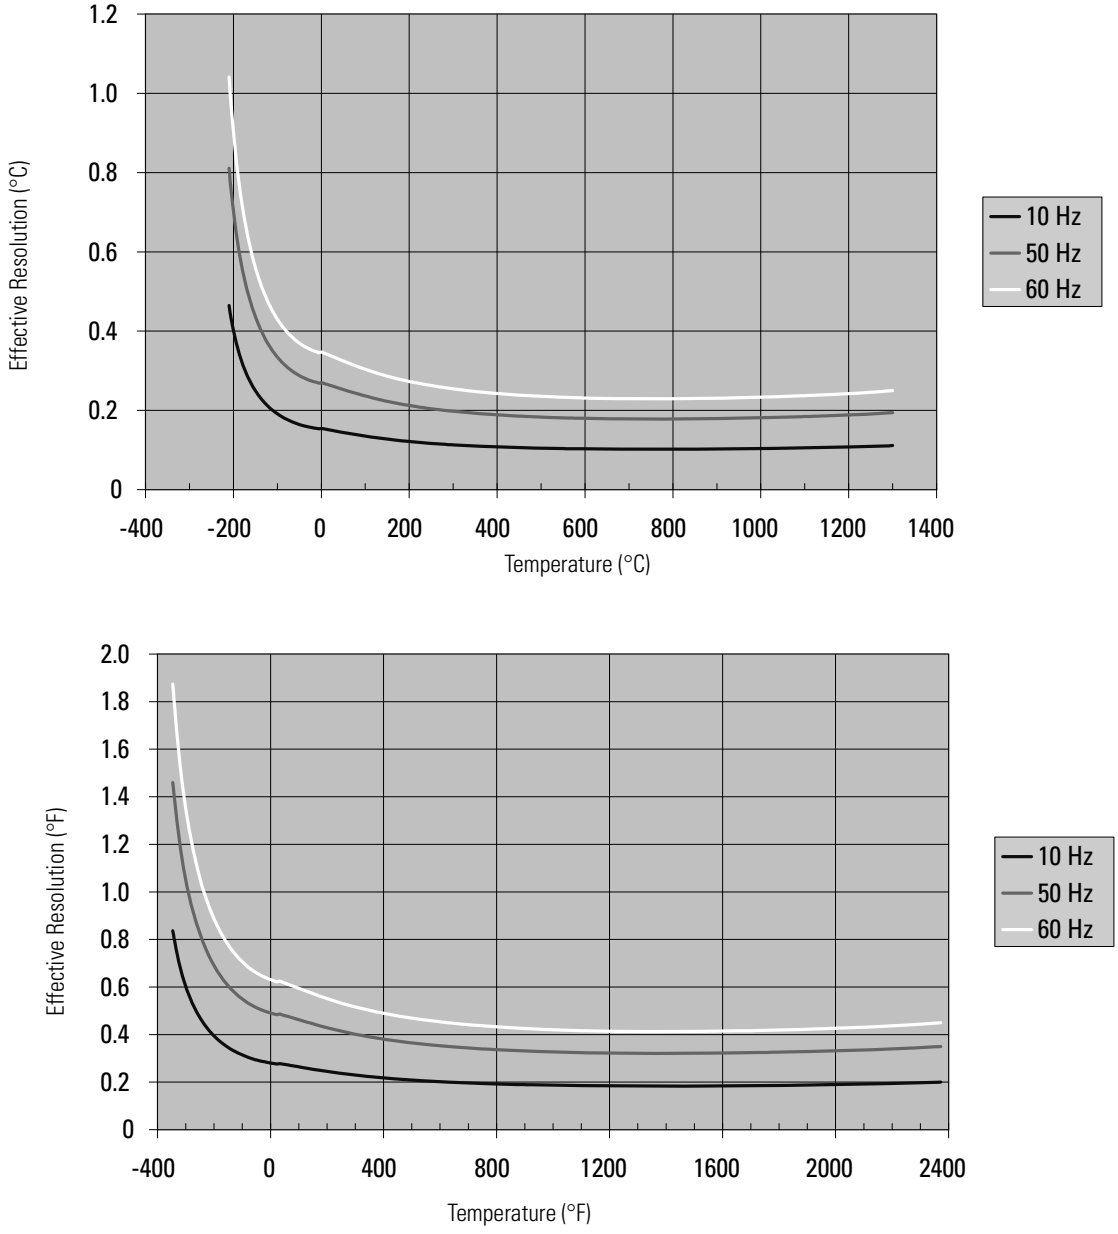

Figure 4.13 Effective Resolution Versus Input Filter Selection for Type N Thermocouples Using 250, 500, and 1k Hz Filters

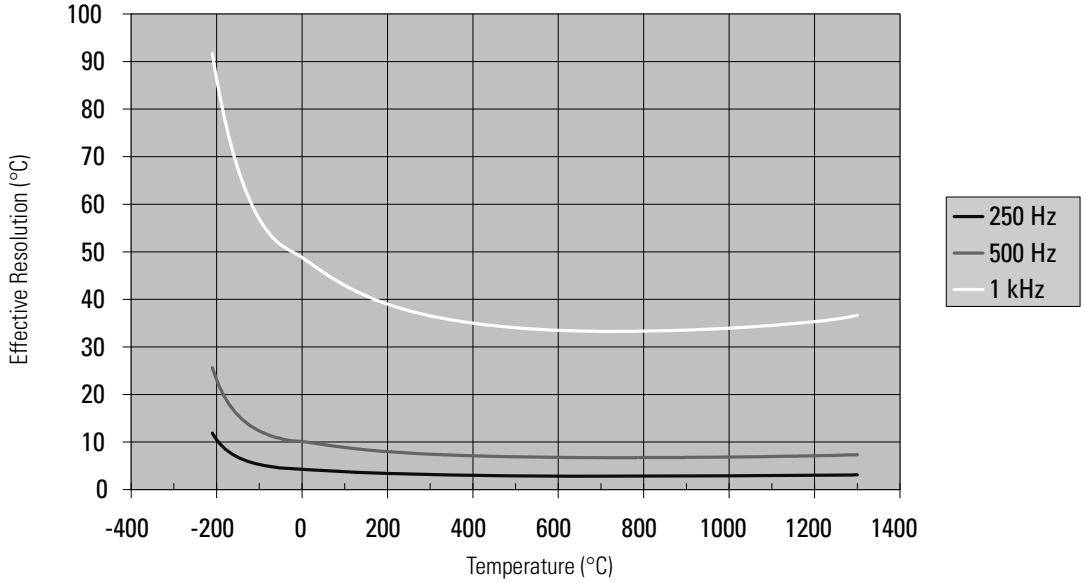

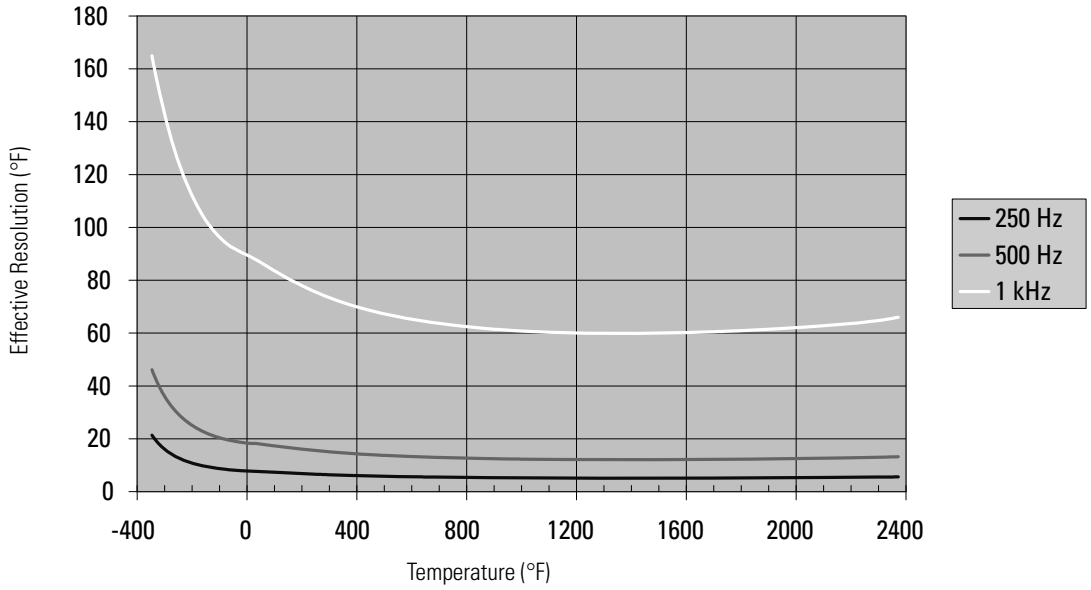

Figure 4.14 Effective Resolution Versus Input Filter Selection for Type R Thermocouples Using 10, 50, and 60 Hz Filters

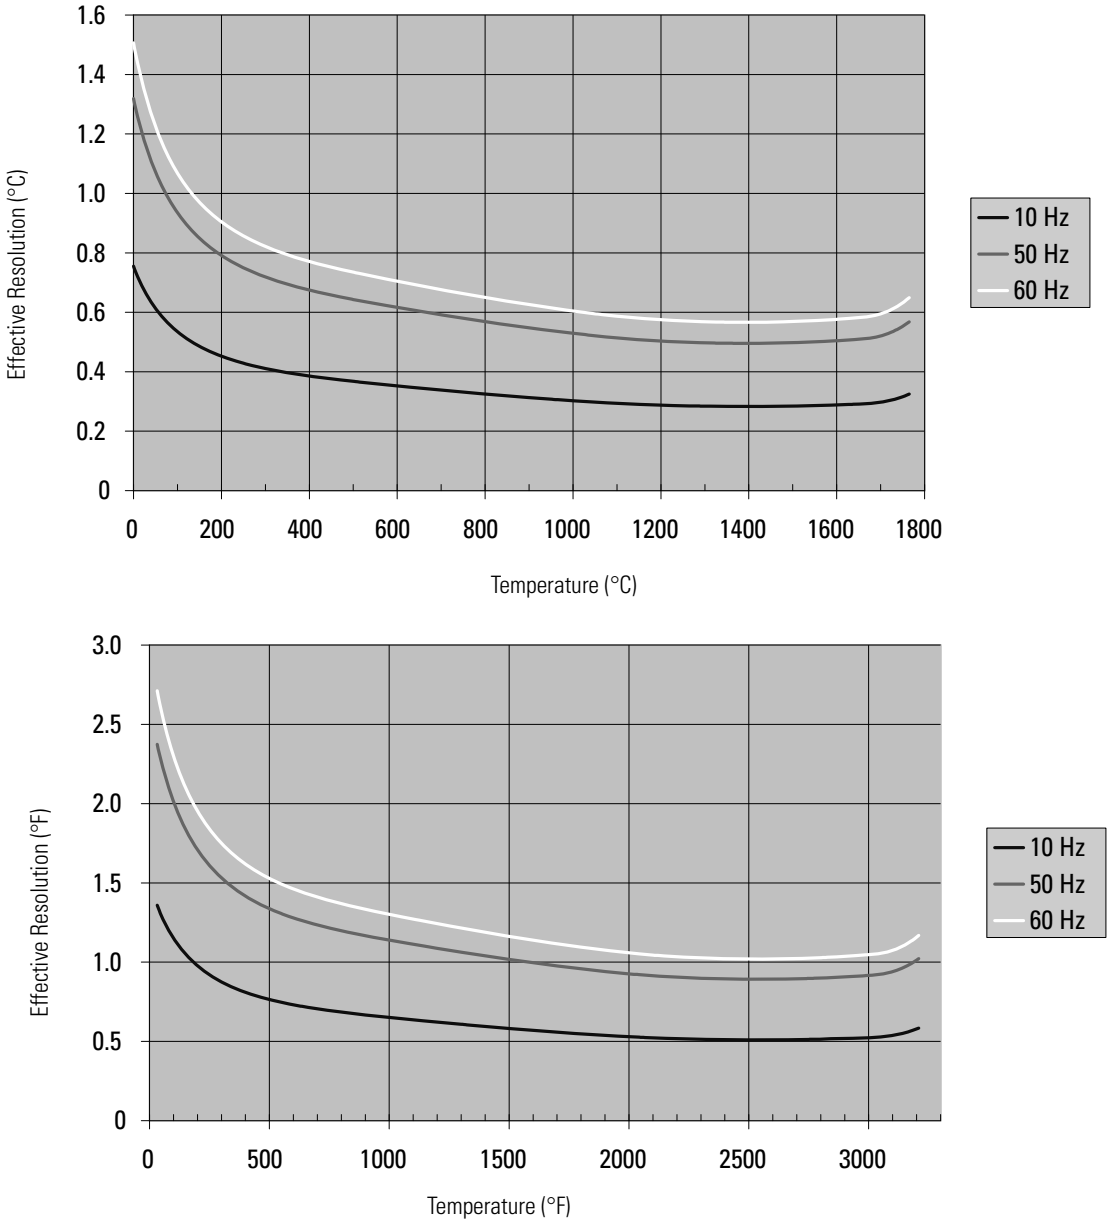

Figure 4.15 Effective Resolution Versus Input Filter Selection for Type R Thermocouples Using 250, 500, and 1k Hz Filters

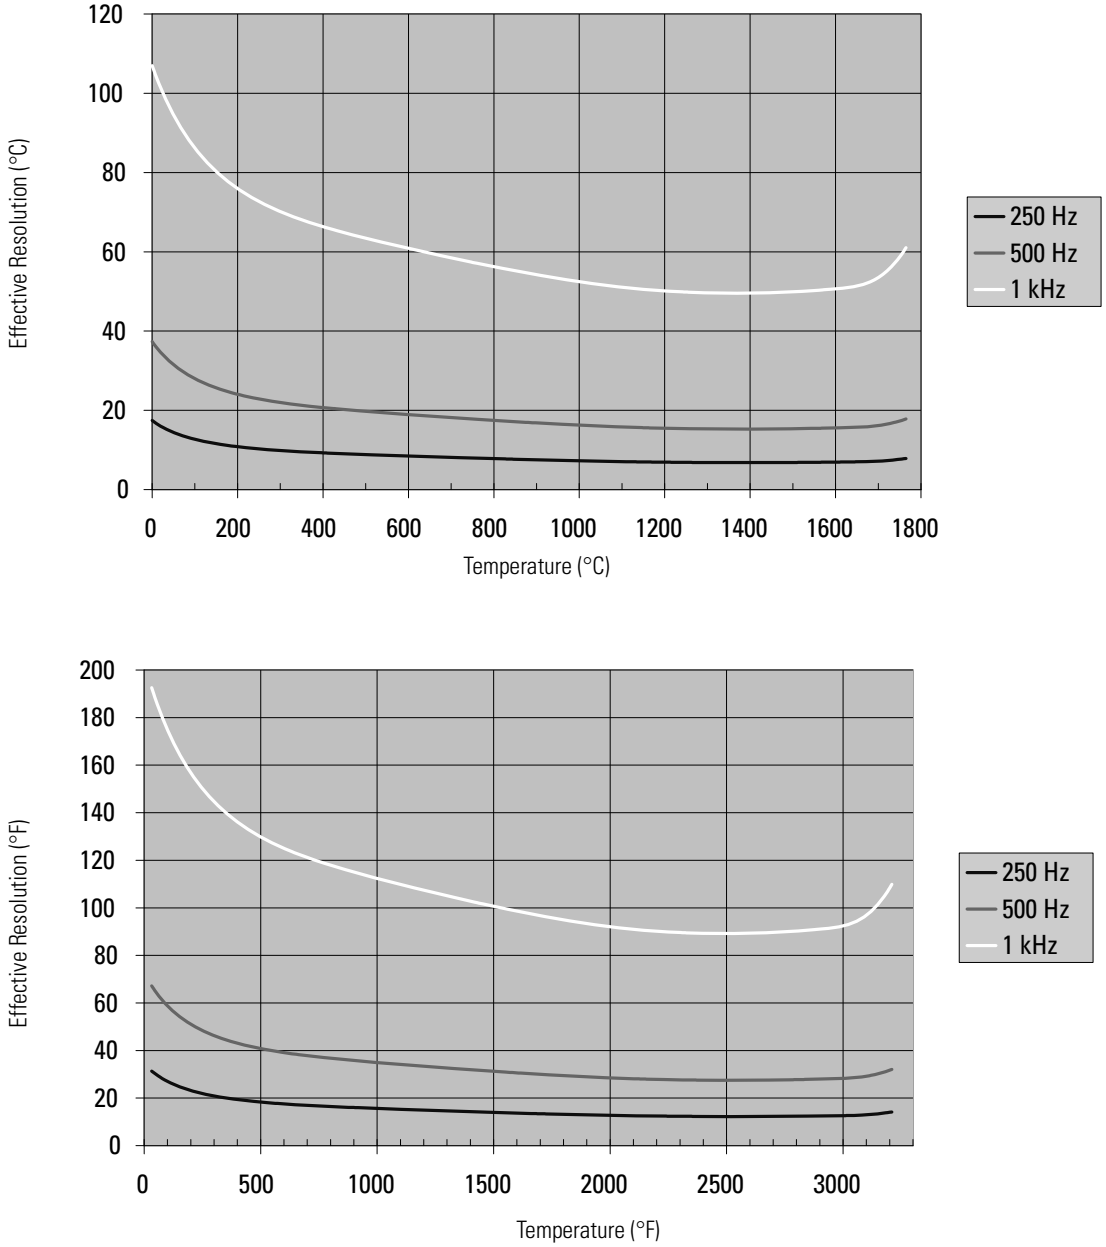

Figure 4.16 Effective Resolution Versus Input Filter Selection for Type S Thermocouples Using 10, 50, and 60 Hz Filters

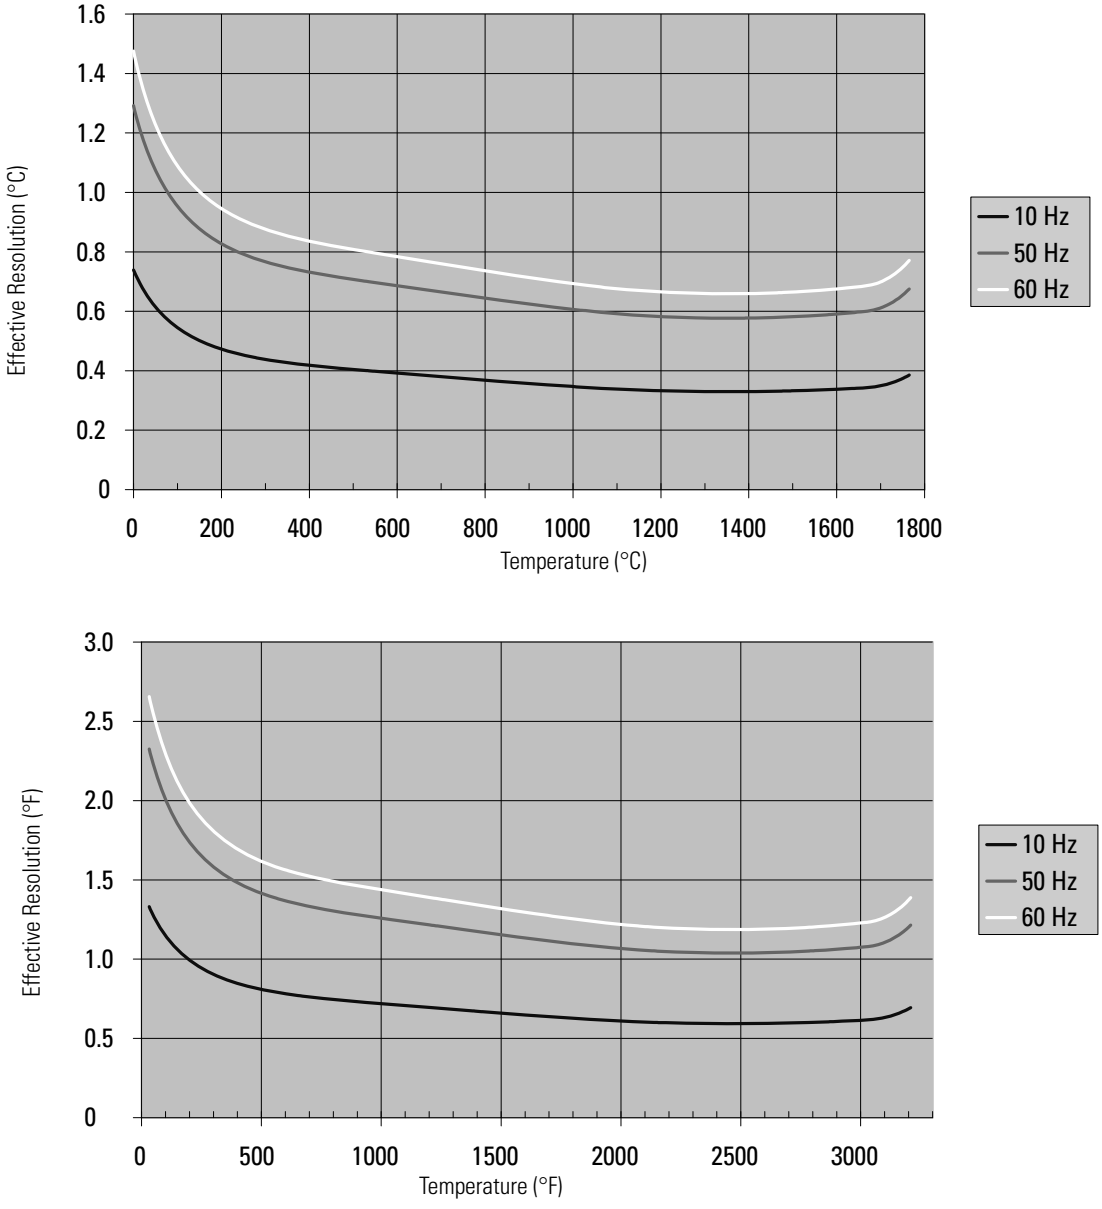

Figure 4.17 Effective Resolution Versus Input Filter Selection for Type S Thermocouples Using 250, 500, and 1k Hz Filters

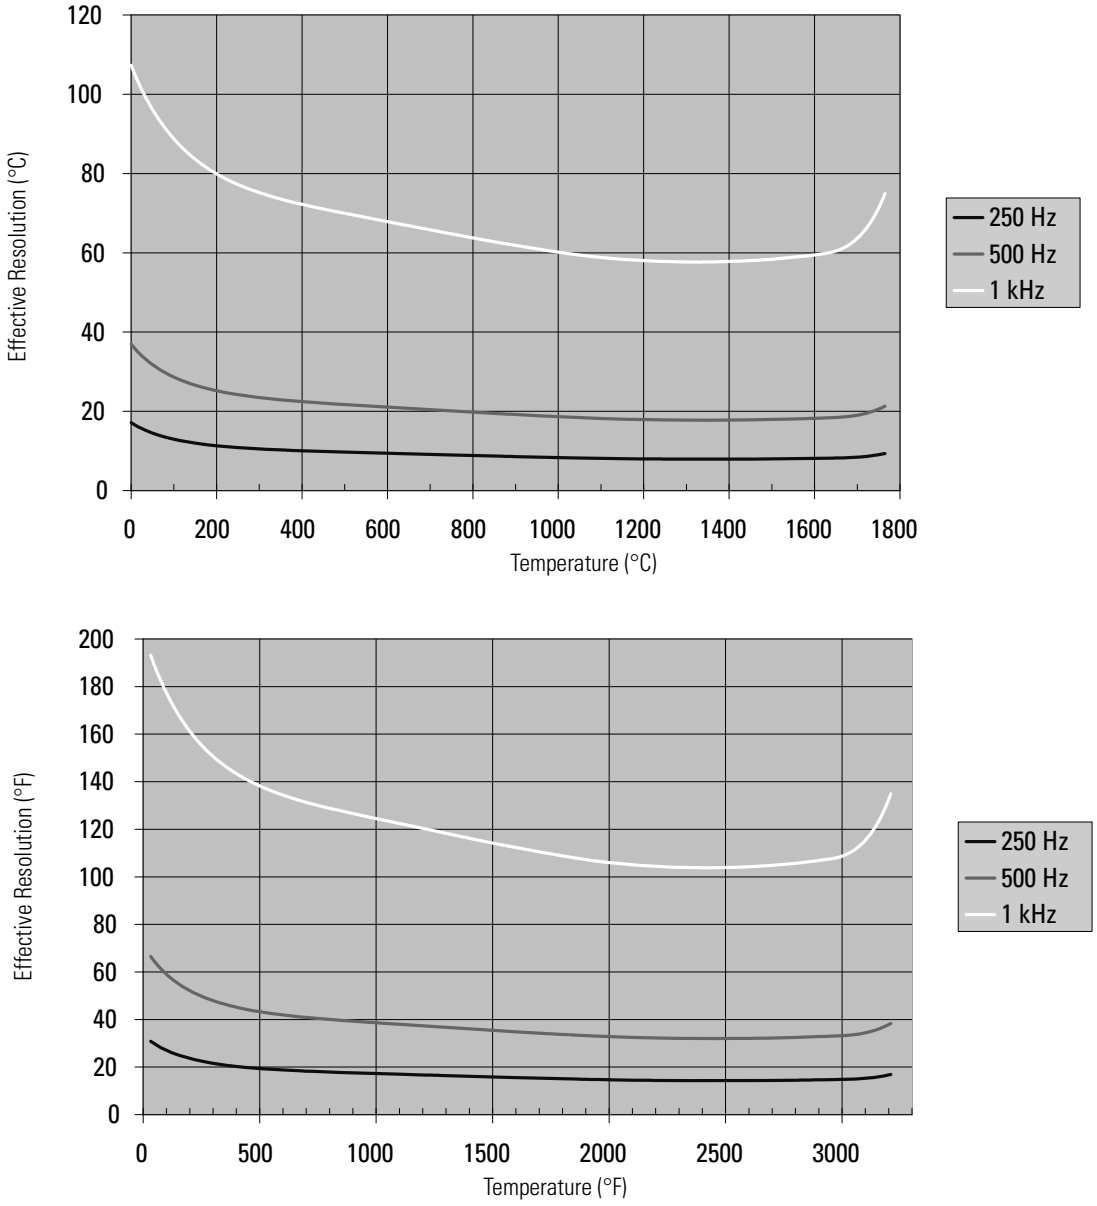

Figure 4.18 Effective Resolution Versus Input Filter Selection for Type T Thermocouples Using 10, 50, and 60 Hz Filters

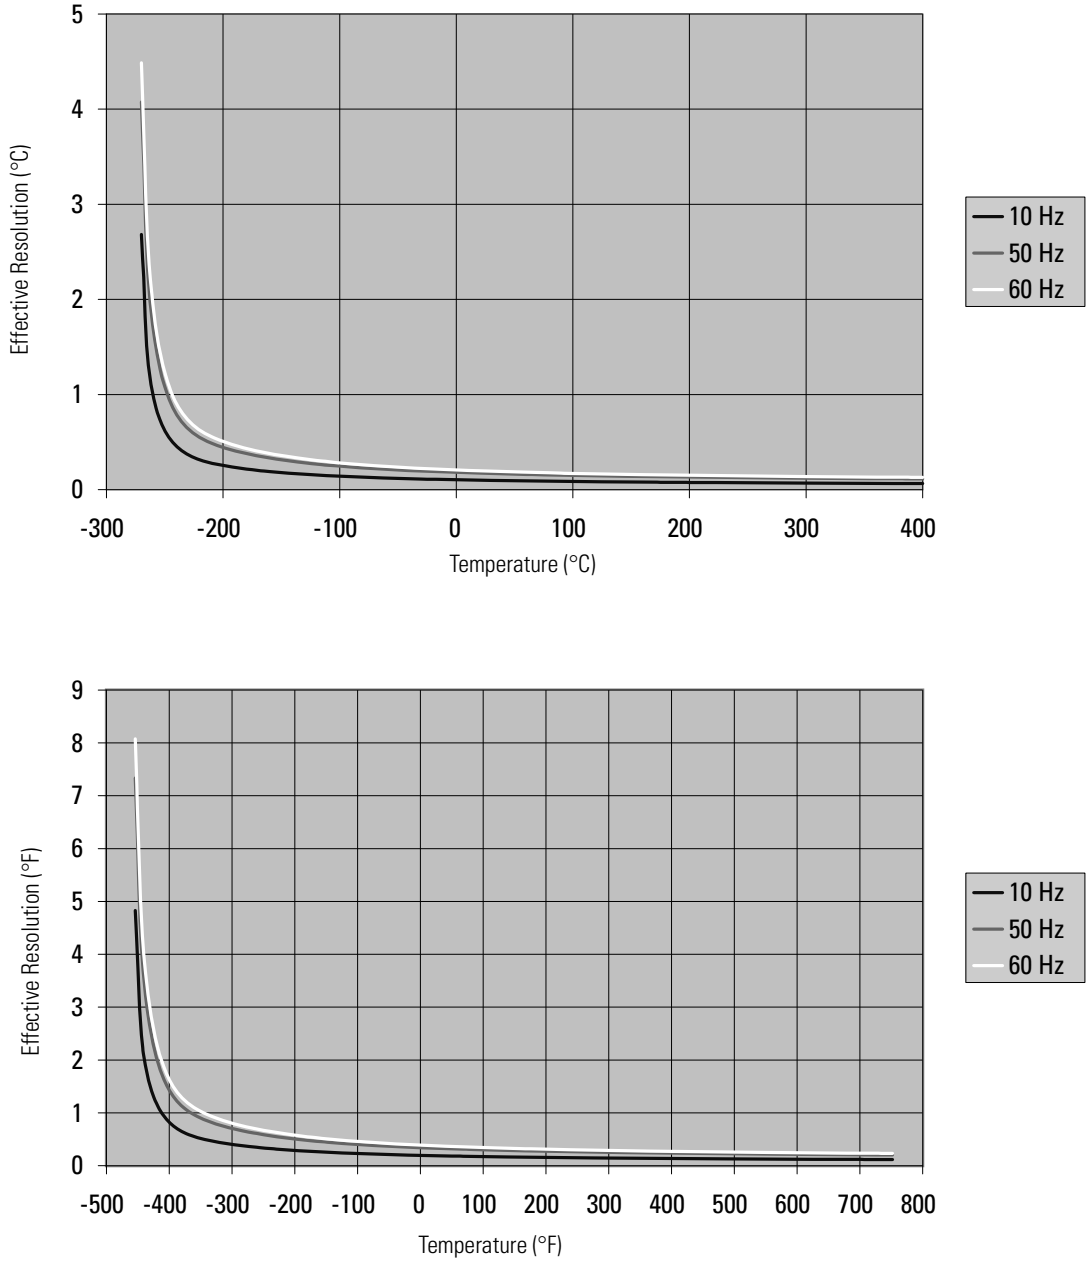

Figure 4.19 Effective Resolution Versus Input Filter Selection for Type T Thermocouples Using 250, 500, and 1k Hz Filters

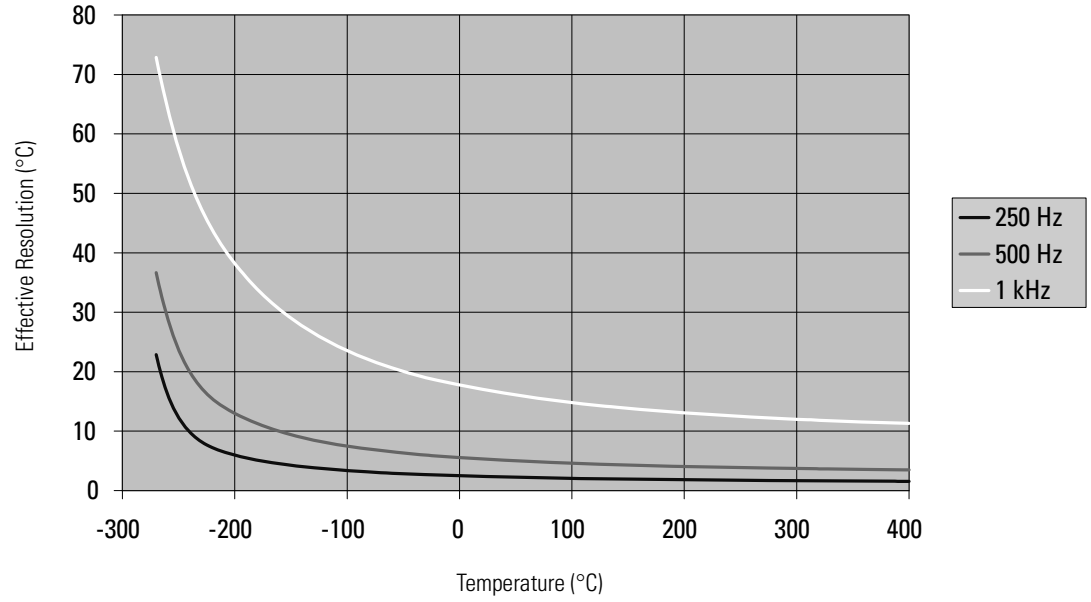

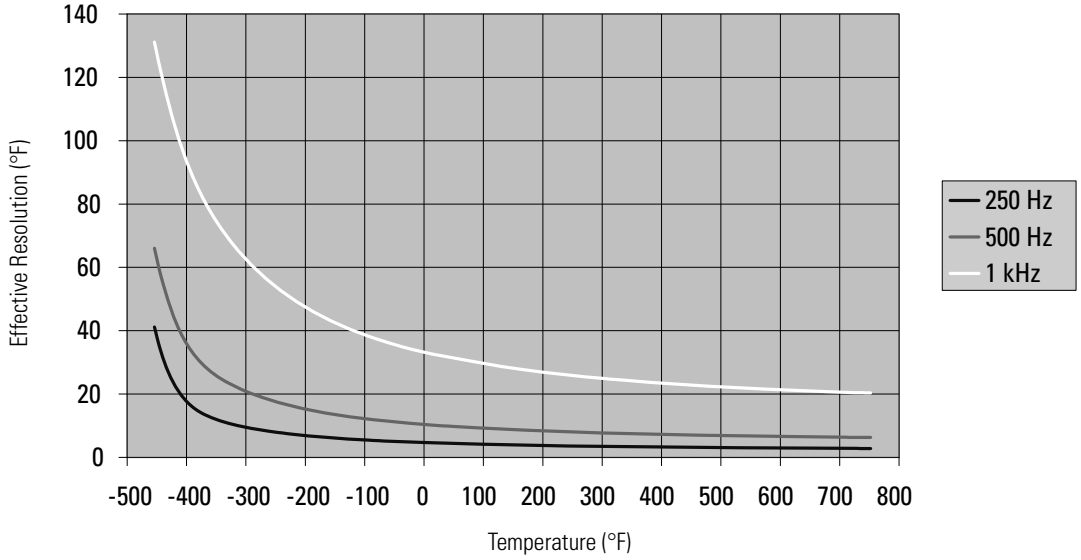

Table 4.6 Effective Resolution vs. Input Filter Selection for Millivolt Inputs

Filter Frequency	±50mV	±100mV
10 Hz	6 μV	6 μV
50 Hz	9 μV	12 μV
60 Hz	9 μV	12 μV
250 Hz	125 μV	150 μV
500 Hz	250 μV	300 μV
1 kHz	1000 μV	1300 μV

The table below identifies the number of significant bits used to represent the input data for each available filter frequency. The number of significant bits is defined as the number of bits that will have little of no jitter due to noise, and is used in defining the effective resolution.

NOTE The resolutions provided by the filters apply to the raw/proportional data format only.

Determining Module Update Time

The module update time is defined as the time required for the module to sample and convert the input signals of all enabled input channels and provide the resulting data values to the processor. Module update time can be calculated by adding the sum of all enabled channel's times. The module sequentially samples the enabled channels in a continuous loop as shown below.

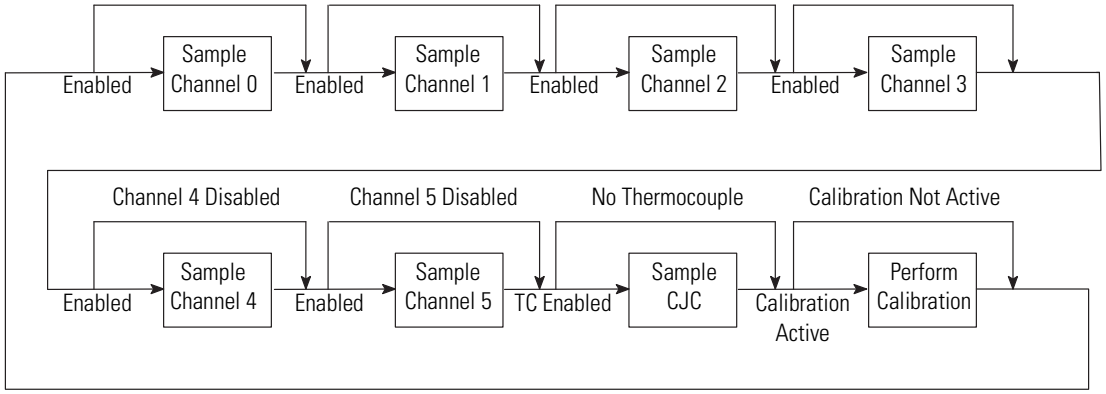

Channel update time is dependent upon the input filter selection. The following table shows the channel update times.

Table 4.7 Channel Update Time

Filter Frequency	Channel Update Time
10 Hz	303 ms
50 Hz	63 ms
60 Hz	53 ms
250 Hz	15 ms
500 Hz	9 ms
1 kHz	7 ms

The CJC input is only sampled if one or more channels are enabled for any thermocouple type. The CJC update time is equal to the largest channel update time of any of the enabled thermocouple inputs types. In that case, a single CJC update is done per scan. See the scan diagram on the previous page. The cyclic calibration time only applies when cyclic calibration is enabled and active. If enabled, the cyclic calibration is staggered over several scan cycles once every five minutes to limit the overall impact to module update time.

Effects of Autocalibration on Module Update Time

The module's autocalibration feature allows it to correct for accuracy errors caused by temperature drift over the module operating temperature range (0 to 60°C). Autocalibration occurs automatically on a system mode change from Program-to-Run for all configured channels or if any online(1) configuration change is made to a channel. In addition, you can configure the module to perform autocalibration every 5 minutes during normal operation, or you can disable this feature using the Enable/ Disable Cyclic Calibration function (default is enabled). This feature allows you to implement a calibration cycle anytime, at your command, by enabling and then disabling this bit.(1)

If you enable the cyclic autocalibration function, the module update time increases when the autocalibration occurs. To limit its impact on the module update time, the autocalibration function is divided over two module scans. The first part (offset/0) of a channel calibration adds 71 ms and the second part (gain/span) adds 112 ms to the module update. This takes place over two consecutive module scans. Each enabled channel requires a separate offset/0 and gain/span cycle, unless *any* channel to be scanned uses an Input Type of the same Input Class as *any previously calibrated* channel. See the figure on page 4-33 and the Input Class table

(1) Not all controllers allow online configuration changes. Refer to your controller's user manual for details. During an online configuration change, input data for the affected channel is not updated by the module.

below. In that case, offset and gain calibration values from the previous channel are used, and no additional time is required.

Table 4.8 Input Class

Input Type	Input Class
Thermocouples B, C, R, S, and T	1
Thermocouples E, J, K, and N	2
50 mV	2
100 mV	3
CJC Sensors	4

Calculating Module Update Time

To determine the module update time, add the individual channel update times for each enabled channel and the CJC update time if any of the channels are enabled as thermocouple inputs.

EXAMPLE

1. Two Channels Enabled for Millivolt Inputs

Channel 0: ±50 mV with 60 Hz filter
Channel 1 Input: ±50 mV with 500 Hz filter

From Table 4.7, Channel Update Time, on page 4-34:

Module Update Time
= Ch 0 Update Time + Ch 1 Update Time
= 53 ms + 9 ms
= 62 ms

EXAMPLE

2. Three Channels Enabled for Different Inputs

Channel 0 Input: Type J Thermocouple with 10 Hz filter
Channel 1 Input: Type J Thermocouple with 60 Hz filter
Channel 2 Input: ±100 mV with 250 Hz filter

From Table 4.7, Channel Update Time, on page 4-34:

Module Update Time
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time (uses lowest thermocouple filter selected)
= 303 ms + 53 ms + 15 ms + 303 ms
= 674 ms

EXAMPLE

3. Three Channels Enabled for Different Inputs with Cyclic Calibration Enabled

Channel 0 Input: Type T Thermocouple with 60 Hz Filter
Channel 1 Input: Type T Thermocouple with 60 Hz Filter
Channel 2 Input: Type J Thermocouple with 60 Hz Filter

From Table 4.7, Channel Update Time, on page 4-34:

Module Update Time *without* an Autocalibration Cycle
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time (uses lowest thermocouple filter selected)
= 53 ms + 53 ms + 53 ms + 53 ms = 212 ms

Module Update Time *during* an Autocalibration Cycle

Channel 0 Scan 1 (Module Scan 1)
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time + *Ch 0 Gain Time*
= 53 ms + 53 ms + 53 ms + 53 ms + *112* ms = 324 ms

Channel 0 Scan 3 (Module Scan 2)
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time + *Ch 0 Offset Time*
= 53 ms + 53 ms + 53 ms + 53 ms + *71* ms = 283 ms

Channel 1 Scan 1 : (no scan impact)
No autocalibration cycle is required because Channel 1 is the same Input Class as Channel 0. Data is updated in scan 3.

Channel 2, Scan 1 (Module Scan 3)
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time + *Ch 2 Gain Time*
= 53 ms + 53 ms + 53 ms + 53 ms + *112* ms = 324 ms

Channel 2, Scan 2 (Module Scan 4)
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time + *Ch 2 Offset Time*
= 53 ms + 53 ms + 53 ms + 53 ms + *71* ms = 283 ms

CJC Scan 1 (Module Scan 5)
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time + *CJC Gain Time*
= 53 ms + 53 ms + 53 ms + 53 ms + *112* ms = 324 ms

CJC Scan 2 (Module Scan 6)
= Ch 0 Update Time + Ch 1 Update Time
+ Ch 2 Update Time + CJC Update Time + *CJC Offset Time*
= 53 ms + 53 ms + 53 ms + 53 ms + *71* ms = 283 ms

After the above cycles are complete, the module returns to scans without autocalibration for approximately 5 minutes. At that time, the autocalibration cycle repeats.

Impact of Autocalibration on Module Startup During Mode Change

Regardless of the selection of the Enable/Disable Cyclic Calibration function, an autocalibration cycle occurs automatically on a mode change from Program-to-Run and on subsequent module startups/initialization for all configured channels. During module startup, input data is not updated by the module and the General Status bits (S0 to S5) are set to 1, indicating a Data Not Valid condition. The amount of time it takes the module to startup is dependent on channel filter frequency selections as indicated in Table 4.7, Channel Update Time, on page 4-34. The following is an example calculation of module startup time.

EXAMPLE

1. Two Channels Enabled for Different Inputs

Channel 0 Input: Type T Thermocouple with 60 Hz filter
Channel 1 Input: Type J Thermocouple with 60 Hz filter

Module Startup Time

= (Ch 0 Gain Time + Ch 0 Offset Time) + (Ch 1 Gain Time + Ch 1 Offset Time) + (CJC Gain Time + CJC Offset Time) + (CJC 0 Data Acquisition + CJC 1 Data Acquisition + Ch 0 Data Acquisition + Ch 1 Data Acquisition)
= (112 ms + 71 ms) + (112 ms + 71 ms) + (53 ms + 53 ms + 53 ms + 53 ms)
= 183 ms + 183 ms + 183 ms + 212 ms = 761 ms

Diagnostics and Troubleshooting

This chapter describes troubleshooting the thermocouple/mV input module. This chapter contains information on:

- safety considerations while troubleshooting
- internal diagnostics during module operation
- module errors
- contacting Rockwell Automation for technical assistance

Safety Considerations

Safety considerations are an important element of proper troubleshooting procedures. Actively thinking about the safety of yourself and others, as well as the condition of your equipment, is of primary importance.

The following sections describe several safety concerns you should be aware of when troubleshooting your control system.

ATTENTION

Never reach into a machine to actuate a switch because unexpected motion can occur and cause injury.

Remove all electrical power at the main power disconnect switches before checking electrical connections or inputs/outputs causing machine motion.

Indicator Lights

When the green LED on the module is illuminated, it indicates that power is applied to the module and that it has passed its internal tests.

Stand Clear of Equipment

When troubleshooting any system problem, have all personnel remain clear of the equipment. The problem could be intermittent, and sudden unexpected machine motion could occur. Have someone ready to operate an emergency stop switch in case it becomes necessary to shut off power.

Program Alteration

There are several possible causes of alteration to the user program, including extreme environmental conditions, Electromagnetic Interference (EMI), improper grounding, improper wiring connections, and unauthorized tampering. If you suspect a program has been altered, check it against a previously saved master program.

Safety Circuits

Circuits installed on the machine for safety reasons, like over-travel limit switches, stop push buttons, and interlocks, should always be hard-wired to the master control relay. These devices must be wired in series so that when any one device opens, the master control relay is de-energized, thereby removing power to the machine. Never alter these circuits to defeat their function. Serious injury or machine damage could result.

Module Operation vs. Channel Operation

The module performs diagnostic operations at both the module level and the channel level. Module-level operations include functions such as power-up, configuration, and communication with a 1769 bus master, such as a MicroLogix 1500 controller, 1769-ADN DeviceNet Adapter, or CompactLogix controller.

Channel-level operations describe channel related functions, such as data conversion and over- or under-range detection.

Internal diagnostics are performed at both levels of operation. When detected, module error conditions are immediately indicated by the module status LED. Both module hardware and channel configuration error conditions are reported to the controller. Channel over-range or under-range and open-circuit conditions are reported in the module's input data table. Module hardware errors are typically reported in the controller's I/O status file. Refer to your controller manual for details.

Power-up Diagnostics

At module power-up, a series of internal diagnostic tests are performed. If these diagnostic tests are not successfully completed, the module status LED remains off and a module error is reported to the controller.

If module status LED is:	Indicated condition:	Corrective action:
On	Proper Operation	No action required.
Off	Module Fault	Cycle power. If condition persists, replace the module. Call your local distributor or Rockwell Automation for assistance.

Channel Diagnostics

When an input channel is enabled, the module performs a diagnostic check to see that the channel has been properly configured. In addition, the channel is tested on every scan for configuration errors, over-range and under-range, and open-circuit conditions.

Invalid Channel Configuration Detection

Whenever a channel configuration word is improperly defined, the module reports an error. See pages 5-4 to 5-7 for a description of module errors.

Over- or Under-Range Detection

Whenever the data received at the channel word is out of the defined operating range, an over-range or under-range error is indicated in input data word 7.

Possible causes of an out-of-range condition include:

- The temperature is too hot or too cold for the type of thermocouple being used.
- The wrong thermocouple is being used for the input type selected, or for the configuration that was programmed.
- The input device is faulty.
- The signal input from the input device is beyond the scaling range.

Open-Circuit Detection

On each scan, the module performs an open-circuit test on all enabled channels. Whenever an open-circuit condition occurs, the open-circuit bit for that channel is set in input data word 6.

Possible causes of an open circuit include:

- the input device is broken
- a wire is loose or cut
- the input device is not installed on the configured channel
- A thermocouple is installed incorrectly

Non-critical vs. Critical Module Errors

Non-critical module errors are typically recoverable. Channel errors (over-range or under-range errors) are non-critical. Non-critical error conditions are indicated in the module input data table.

Critical module errors are conditions that may prevent normal or recoverable operation of the system. When these types of errors occur, the system typically leaves the run or program mode of operation until the error can be dealt with. Critical module errors are indicated in Table 5.3 Extended Error Codes on page 5-6.

Module Error Definition Table

Analog module errors are expressed in two fields as four-digit Hex format with the most significant digit as “don’t care” and irrelevant. The two fields are “Module Error” and “Extended Error Information”. The structure of the module error data is shown below.

Table 5.1 Module Error Table

“Don’t Care” Bits				Module Error			Extended Error Information								
15	**14**	**13**	**12**	**11**	**10**	**9**	**8**	**7**	**6**	**5**	**4**	**3**	**2**	**1**	**0**
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Hex Digit 4				**Hex Digit 3**			**Hex Digit 2**					**Hex Digit 1**			

Module Error Field

The purpose of the module error field is to classify module errors into three distinct groups, as described in the table below. The type of error determines what kind of information exists in the extended error information field. These types of module errors are typically reported in the controller’s I/O status file. Refer to your controller manual for details.

Table 5.2 Module Error Types

Error Type	Module Error Field Value Bits 11 through 9 (binary)	Description
No Errors	000	No error is present. The extended error field holds no additional information.
Hardware Errors	001	General and specific hardware error codes are specified in the extended error information field.
Configuration Errors	010	Module-specific error codes are indicated in the extended error field. These error codes correspond to options that you can change directly. For example, the input range or input filter selection.

Extended Error Information Field

Check the extended error information field when a non-zero value is present in the module error field. Depending upon the value in the module error field, the extended error information field can contain error codes that are module-specific or common to all 1769 analog modules.

NOTE If no errors are present in the module error field, the extended error information field is set to zero.

Hardware Errors

General or module-specific hardware errors are indicated by module error code 001. See Table 5.3 Extended Error Codes on page 5-6.

Configuration Errors

If you set the fields in the configuration file to invalid or unsupported values, the module generates a critical error.

Table 5.3 Extended Error Codes on page 5-6 lists the possible module-specific configuration error codes defined for the modules.

Error Codes

The table below explains the extended error code.

Table 5.3 Extended Error Codes

Error Type	Hex Equivalent[1]	Module Error Code	Extended Error Information Code	Error Description
		Binary	Binary	
No Error	X000	000	0 0000 0000	No Error
General Common Hardware Error	X200	001	0 0000 0000	General hardware error; no additional information
	X201	001	0 0000 0001	Power-up reset state
Hardware-Specific Error	X300	001	1 0000 0000	General hardware error; no additional information
	X301	001	1 0000 0001	Microprocessor hardware error; hardware ROM error
	X302	001	1 0000 0010	Hardware EEPROM error
	X303	001	1 0000 0011	Channel 0 calibration error
	X304	001	1 0000 0100	Channel 1 calibration error
	X305	001	1 0000 0101	Channel 2 calibration error
	X306	001	1 0000 0110	Channel 3 calibration error
	X307	001	1 0000 0111	Channel 4 calibration error
	X308	001	1 0000 1000	Channel 5 calibration error
	X309	001	1 0000 1001	CJC0 calibration error
	X30A	001	1 0000 1010	CJC1 calibration error
	X30B	001	1 0000 1011	Channel 0 Analog/Digital Converter error
	X30C	001	1 0000 1100	Channel 1 Analog/Digital Converter error
	X30D	001	1 0000 1101	Channel 2 Analog/Digital Converter error
	X30E	001	1 0000 1110	Channel 3 Analog/Digital Converter error
	X30F	001	1 0000 1111	Channel 4 Analog/Digital Converter error
	X310	001	1 0001 0000	Channel 5 Analog/Digital Converter error
	X311	001	1 0001 0001	CJC0 Analog/Digital Converter error
	X312	001	1 0001 0010	CJC1 Analog/Digital Converter error

Table 5.3 Extended Error Codes

Error Type	Hex Equivalent[1]	Module Error Code	Extended Error Information Code	Error Description
		Binary	Binary	
Module-Specific Configuration Error	X400	010	0 0000 0000	General configuration error; no additional information
	X401	010	0 0000 0001	Invalid input type selected (channel 0)
	X402	010	0 0000 0010	Invalid input type selected (channel 1)
	X403	010	0 0000 0011	Invalid input type selected (channel 2)
	X404	010	0 0000 0100	Invalid input type selected (channel 3)
	X405	010	0 0000 0101	Invalid input type selected (channel 4)
	X406	010	0 0000 0110	Invalid input type selected (channel 5)
	X407	010	0 0000 0111	Invalid input filter selected (channel 0)
	X408	010	0 0000 1000	Invalid input filter selected (channel 1)
	X409	010	0 0000 1001	Invalid input filter selected (channel 2)
	X40A	010	0 0000 1010	Invalid input filter selected (channel 3)
	X40B	010	0 0000 1011	Invalid input filter selected (channel 4)
	X40C	010	0 0000 1100	Invalid input filter selected (channel 5)
	X40D	010	0 0000 1101	Invalid input format selected (channel 0)
	X40E	010	0 0000 1110	Invalid input format selected (channel 1)
	X40F	010	0 0000 1111	Invalid input format selected (channel 2)
	X410	010	0 0001 0000	Invalid input format selected (channel 3)
	X411	010	0 0001 0001	Invalid input format selected (channel 4)
	X412	010	0 0001 0010	Invalid input format selected (channel 5)
	X413	010	0 0001 0011	An unused bit has been set for channel 0
	X414	010	0 0001 0100	An unused bit has been set for channel 1
	X415	010	0 0001 0101	An unused bit has been set for channel 2
	X416	010	0 0001 0110	An unused bit has been set for channel 3
	X417	010	0 0001 0111	An unused bit has been set for channel 4
	X418	010	0 0001 1000	An unused bit has been set for channel 5
	X419	010	0 0001 1001	Invalid module configuration register

(1) X represents the "Don't Care" digit.

Module Inhibit Function

Some controllers support the module inhibit function. See your controller manual for details.

Whenever the 1769-IT6 module is inhibited, the module continues to provide information about changes at its inputs to the 1769 CompactBus master (for example, a CompactLogix controller).

Contacting Rockwell Automation

If you need to contact Rockwell Automation for assistance, please have the following information available when you call:

- a clear statement of the problem, including a description of what the system is actually doing. Note the LED state; also note data and configuration words for the module.
- a list of remedies you have already tried
- processor type and firmware number (See the label on the processor.)
- hardware types in the system, including all I/O modules
- fault code if the processor is faulted

Specifications

General Specifications

Specification	Value
Dimensions	118 mm (height) x 87 mm (depth) x 35 mm (width) height including mounting tabs is 138 mm 4.65 in. (height) x 3.43 in (depth) x 1.38 in (width) height including mounting tabs is 5.43 in.
Approximate Shipping Weight (with carton)	276g (0.61 lbs.)
Storage Temperature	-40°C to +85°C (-40°F to +185°F)
Operating Temperature	0°C to +60°C (32°F to +140°F)
Operating Humidity	5% to 95% non-condensing
Operating Altitude	2000 meters (6561 feet)
Vibration	Operating: 10 to 500 Hz, 5G, 0.030 in. peak-to-peak Relay Operation: 2G
Shock	Operating: 30G, 11 ms panel mounted (20G, 11 ms DIN rail mounted) Relay Operation: 7.5G panel mounted (5G DIN rail mounted) Non-Operating: 40G panel mounted (30G DIN rail mounted)
System Power Supply Distance Rating	8 (The module may not be more than 7 modules away from a system power supply.)
Recommended Cable	Belden™ 8761 (shielded) for millivolt inputs Shielded thermocouple extension wire for the specific type of thermocouple you are using. Follow thermocouple manufacturer's recommendations.
Agency Certification	• C-UL certified (under CSA C22.2 No. 142) • UL 508 listed • CE compliant for all applicable directives
Hazardous Environment Class	Class I, Division 2, Hazardous Location, Groups A, B, C, D (UL 1604, C-UL under CSA C22.2 No. 213)
Radiated and Conducted Emissions	EN50081-2 Class A

Specification	Value
Electrical /EMC:	*The module has passed testing at the following levels:*
• ESD Immunity (IEC61000-4-2)	• 4 kV contact, 8 kV air, 4 kV indirect
• Radiated Immunity (IEC61000-4-3)	• 10 V/m , 80 to 1000 MHz, 80% amplitude modulation, +900 MHz keyed carrier
• Fast Transient Burst (IEC61000-4-4)	• 2 kV, 5kHz
• Surge Immunity (IEC61000-4-5)	• 1kV galvanic gun
• Conducted Immunity (IEC61000-4-6)	• 10V, 0.15 to 80MHz(1) (2)

(1) Conducted Immunity frequency range may be 150 kHz to 30 MHz if the Radiated Immunity frequency range is 30 to 1000 MHz.

(2) For grounded thermocouples, the 10V level is reduced to 3V.

Input Specifications

Specification	Value
Number of Inputs	6 input channels plus 2 CJC sensors
Bus Current Draw (max.)	100 mA at 5V dc 40 mA at 24V dc
Heat Dissipation	1.5 Total Watts (The Watts per point, plus the minimum Watts, with all points energized.)
Converter Type	Delta Sigma
Response Speed per Channel	Input filter and configuration dependent. See "Effects of Filter Frequency on Channel Step Response" on page 4-12
Rated Working Voltage(1)	30V ac/30V dc
Common Mode Voltage Range(2)	±10V maximum per channel
Common Mode Rejection	115 dB (minimum) at 50 Hz (with 10 Hz or 50 Hz filter) 115 dB (minimum) at 60 Hz (with 10 Hz or 60 Hz filter)
Normal Mode Rejection Ratio	85 dB (minimum) at 50 Hz (with 10 Hz or 50 Hz filter) 85 dB (minimum) at 60 Hz (with 10 Hz or 60 Hz filter)
Maximum Cable Impedance	25 Ω (for specified accuracy)
Input Impedance	>10M Ω
Open-circuit Detection Time	7 ms to 2.1 seconds(3)
Calibration	The module performs autocalibration upon power-up and whenever a channel is enabled. You can also program the module to calibrate every five minutes.
Non-linearity (in percent full scale)	±0.03%

(1) Rated working voltage is the maximum continuous voltage that can be applied at the input terminal, including the input signal and the value that floats above ground potential (for example, 30V dc input signal and 20V dc potential above ground).

(2) For proper operation, both the plus and minus input terminals must be within ±10V dc of analog common.

(3) Open-circuit detection time is equal to the module scan time, which is based on the number of enabled channels, and the filter frequency of each channel.

Specification	Value
Module Error over Full Temperature Range (0 to +60°C [+32°F to +140°F])	See "Accuracy" on page A-4.
CJC Sensor Accuracy	±0.3°C (±0.54°F)
CJC Accuracy	±1.0°C (±1.8°F)
Maximum Overload at Input Terminals	±35V dc continuous(1)
Input Group to Bus Isolation	720V dc for 1 minute (qualification test) 30V ac/30V dc working voltage
Input Channel Configuration	via configuration software screen or the user program (by writing a unique bit pattern into the module's configuration file). Refer to your controller's user manual to determine if user program configuration is supported.
Module OK LED	On: module has power, has passed internal diagnostics, and is communicating over the bus. Off: Any of the above is not true.
Channel Diagnostics	Over- or under-range and open-circuit by bit reporting
Vendor I.D. Code	1
Product Type Code	10
Product Code	36

(1) Maximum current input is limited due to input impedance.

Repeatability at 25°C (77°F)(1) (2)

Input Type	Repeatability for 10 Hz Filter
Thermocouple J	±0.1°C [±0.18°F]
Thermocouple N (-110°C to +1300°C [-166°F to +2372°F])	±0.1°C [±0.18°F]
Thermocouple N (-210°C to -110°C [-346°F to -166°F])	±0.25°C [±0.45°F]
Thermocouple T (-170°C to +400°C [-274°F to +752°F])	±0 .1°C [±0.18°F]
Thermocouple T (-270°C to -170°C [-454°F to -274°F])	±1.5°C [±2.7°F]
Thermocouple K (-270°C to +1370°C [-454°F to +2498°F])	±0.1°C [±0.18°F]
Thermocouple (-270°C to -170°C [-454°F to -274°F])	±2.0°C [±3.6°F]
Thermocouple E (-220°C to +1000°C [-364°F to +1832°F])	±0.1°C [±0.18°F]
Thermocouple E (-270°C to -220°C [-454°F to -364°F])	±1.0°C [±1.8°F]
Thermocouples S and R	±0.4°C [±0.72°F]
Thermocouple C	±0.7°C [±1.26°F]
Thermocouple B	±0.2°C [±0.36°F]
±50 mV	±6 µV
±100 mV	±6 µV

(1) Repeatability is the ability of the input module to register the same reading in successive measurements for the same input signal.

(2) Repeatability at any other temperature in the 0 to 60°C (32 to 140°F) range is the same as long as the temperature is stable.

Accuracy

Input Type[1]	With Autocalibration Enabled		Without Autocalibration
	Accuracy[2] [3] for 10 Hz, 50 Hz and 60 Hz Filters (max.)		Maximum Temperature Drift[2] [4]
	at 25°C [77°F] Ambient	at 0 to 60°C [32 to 140°F] Ambient	at 0 to 60°C [32 to 140°F] Ambient
Thermocouple J (-210°C to 1200°C [-346°F to 2192°F])	±0.6°C [± 1.1°F]	±0.9°C [± 1.7°F]	±0.0218°C/°C [±0.0218°F/°F]
Thermocouple N (-200°C to +1300°C [-328°F to 2372°F])	±1°C [± 1.8°F]	±1.5°C [±2.7°F]	±0.0367°C/°C [±0.0367°F/°F]
Thermocouple N (-210°C to -200°C [-346°F to -328°F])	±1.2°C [±2.2°F]	±1.8°C [±3.3°F]	±0.0424°C/°C [±0.0424°F/°F]
Thermocouple T (-230°C to +400°C [-382°F to +752°F])	±1°C [± 1.8°F]	±1.5°C [±2.7°F]	±0.0349°C/°C [±0.0349°F/°F]
Thermocouple T (-270°C to -230°C [-454°F to -382°F])	±5.4°C [± 9.8°F]	±7.0°C [±12.6°F]	±0.3500°C/°C [±0.3500°F/°F]
Thermocouple K (-230°C to +1370°C [-382°F to +2498°F])	±1°C [± 1.8°F]	±1.5°C [±2.7°F]	±0.4995°C/°C [±0.4995°F/°F]
Thermocouple K (-270°C to -225°C [-454°F to -373°F])	±7.5°C [± 13.5°F]	±10°C [± 18°F]	±0.0378°C/°C [±0.0378°F/°F]
Thermocouple E (-210°C to +1000°C [-346°F to +1832°F])	±0.5°C [± 0.9°F]	±0.8°C [±1.5°F]	±0.0199°C/°C [±0.0199°F/°F]
Thermocouple E (-270°C to -210°C [-454°F to -346°F])	±4.2°C [± 7.6°F]	±6.3°C [±11.4°F]	±0.2698°C/°C [±0.2698°F/°F]
Thermocouple R	±1.7°C [± 3.1°F]	±2.6°C [± 4.7°F]	±0.0613°C/°C [±0.0613°F/°F]
Thermocouple S	±1.7°C [± 3.1°F]	±2.6°C [± 4.7°F]	±0.0600°C/°C [±0.0600°F/°F]
Thermocouple C	±1.8°C [±3.3°F]	±3.5°C [±6.3°F]	±0.0899°C/°C [±0.0899°F/°F]
Thermocouple B	±3.0°C [±5.4°F]	±4.5°C [±8.1°F]	±0.1009°C/°C [±0.1009°F/°F]
±50 mV	±15 µV	±25 µV	±0.44µV/°C [±0.80µV/°F]
±100 mV	±20 µV	±30 µV	±0.69µV/°C [±01.25µV/°F]

(1) The module uses the National Institute of Standards and Technology (NIST) ITS-90 standard for thermocouple linearization.

(2) Accuracy and temperature drift information does not include the affects of errors or drift in the cold junction compensation circuit.

(3) Accuracy is dependent upon the analog/digital converter output rate selection, data format, and input noise.

(4) Temperature drift with autocalibration is slightly better than without autocalibration.

NOTE For more detailed accuracy and drift information, see the accuracy graphs on pages A-5 through A-21 and the temperature drift graphs on pages A-23 through A-27.

Accuracy Versus Thermocouple Temperature and Filter Frequency

The following graphs show the module's accuracy when operating at 25°C for each thermocouple type over the thermocouple's temperature range for each frequency. The effect of errors in cold junction compensation is not included.

Figure A.1 Module Accuracy at 25°C (77°F) Ambient for Type B Thermocouple Using 10, 50, and 60 Hz Filter

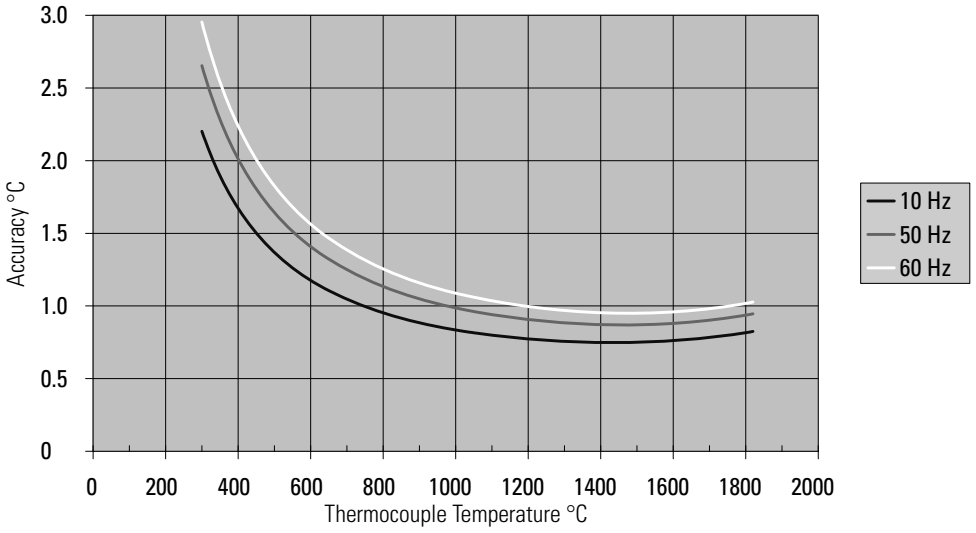

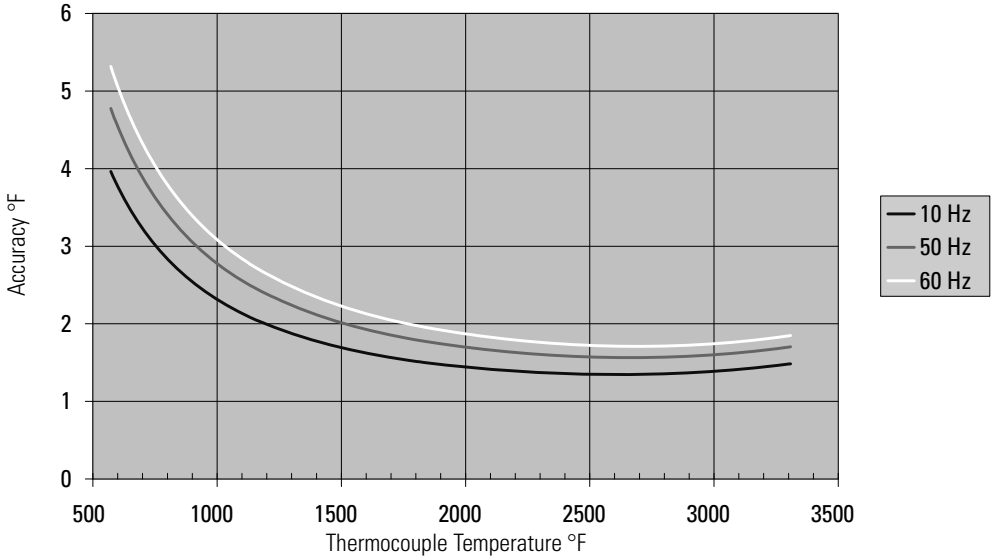

Figure A.2 Module Accuracy at 25°C (77°F) Ambient forType B Thermocouple Using 250, 500, and 1 kHz Filter

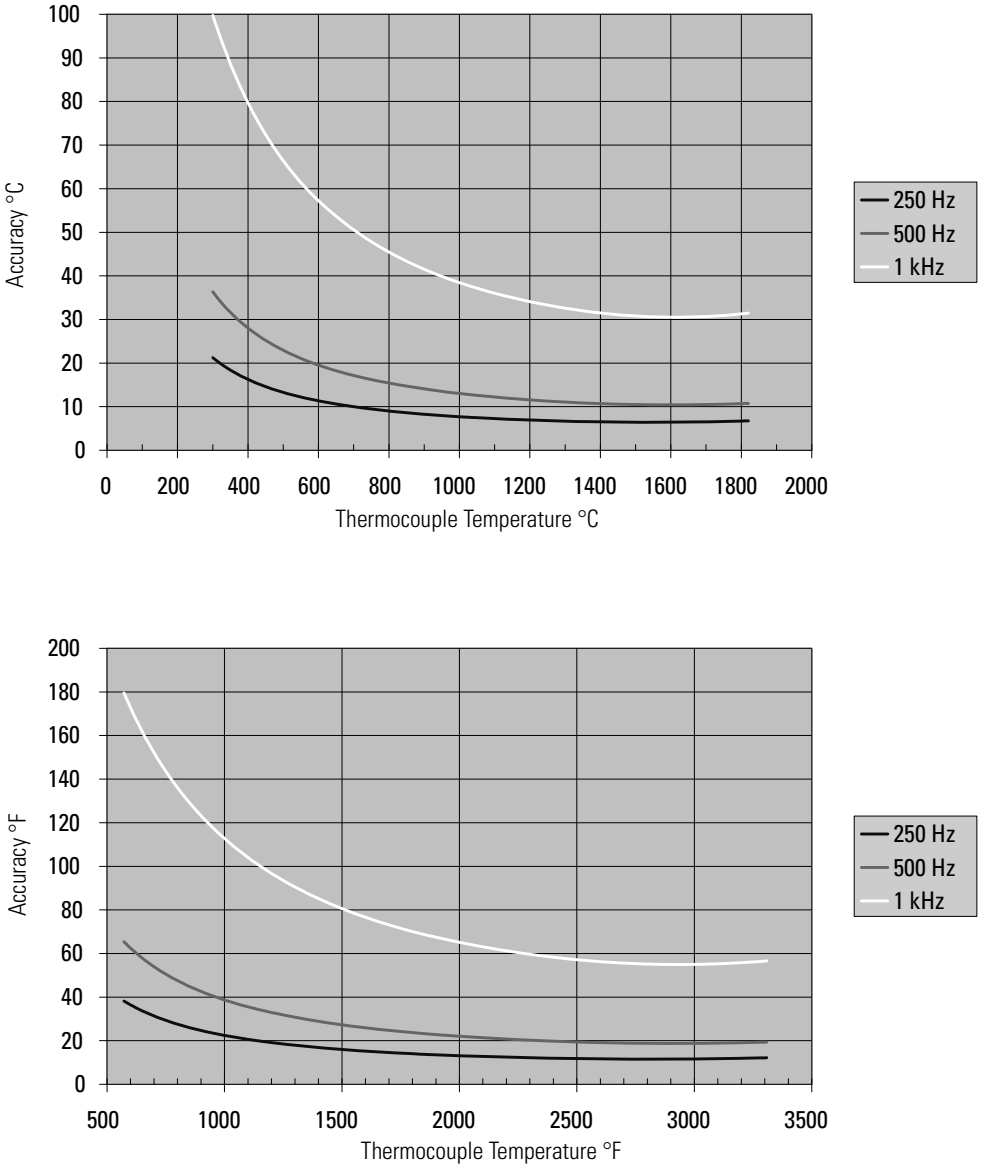

Figure A.3 Module Accuracy at 25°C (77°F) Ambient for Type C Thermocouple Using 10, 50, and 60 Hz Filter

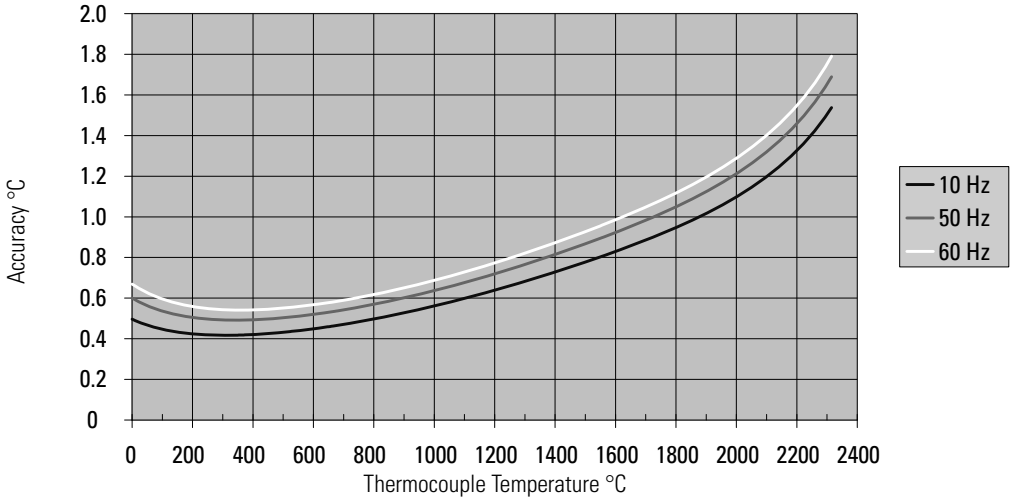

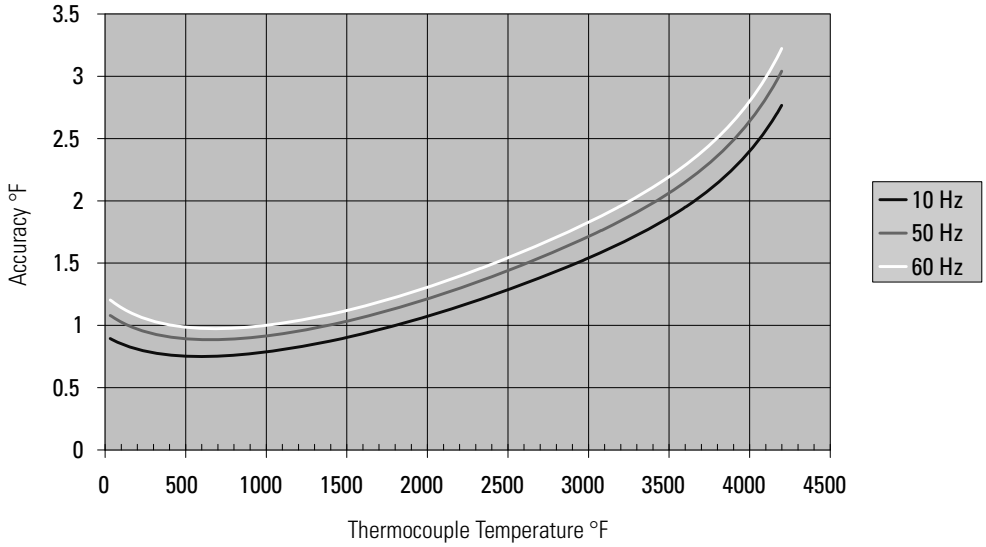

Figure A.4 Module Accuracy at 25°C (77°F) Ambient forType C Thermocouple Using 250, 500, and 1 kHz Filter

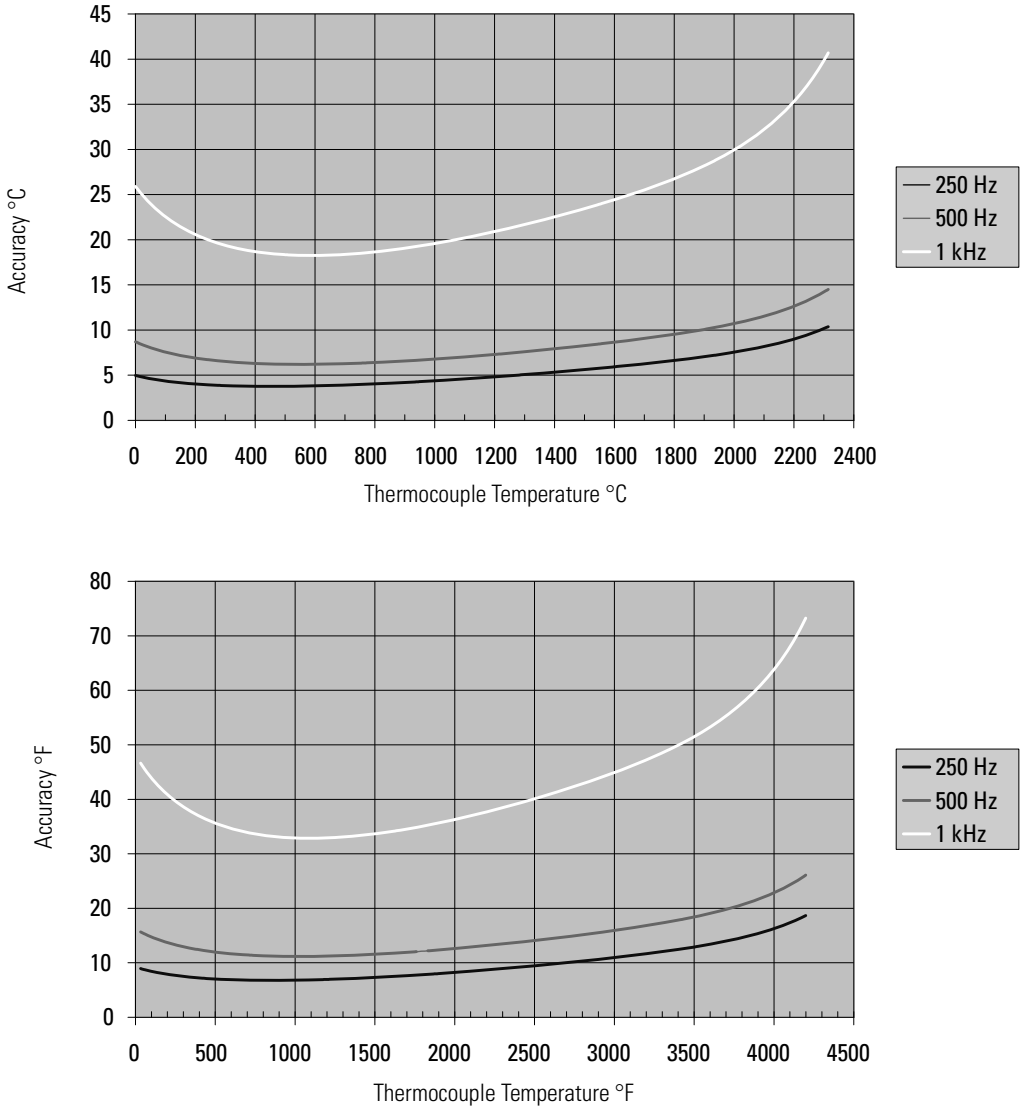

Figure A.5 Module Accuracy at 25°C (77°F) Ambient for Type E Thermocouple Using 10, 50, and 60 Hz Filter

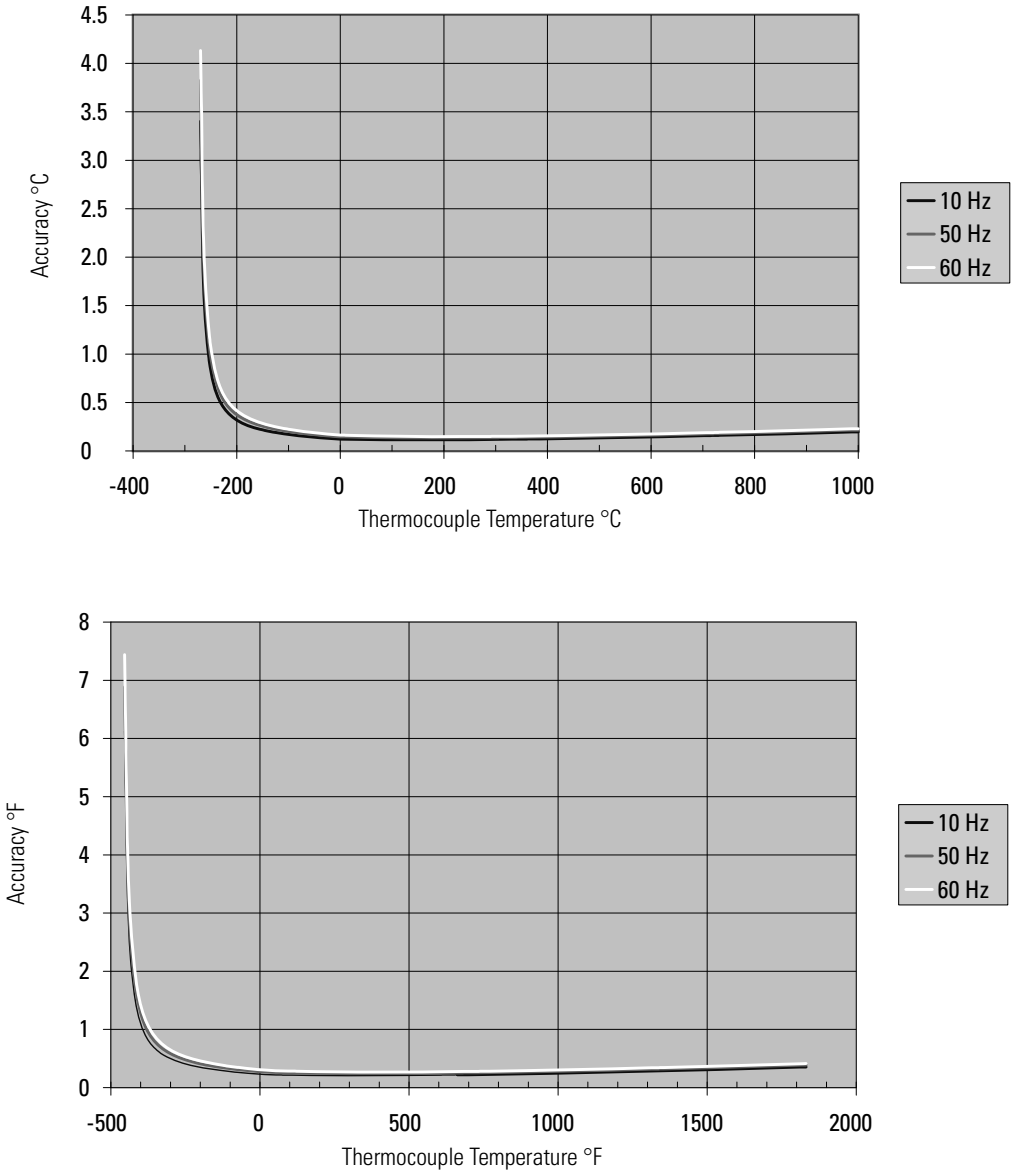

Figure A.6 Module Accuracy at 25°C (77°F) Ambient forType E Thermocouple Using 250, 500, and 1 kHz Filter

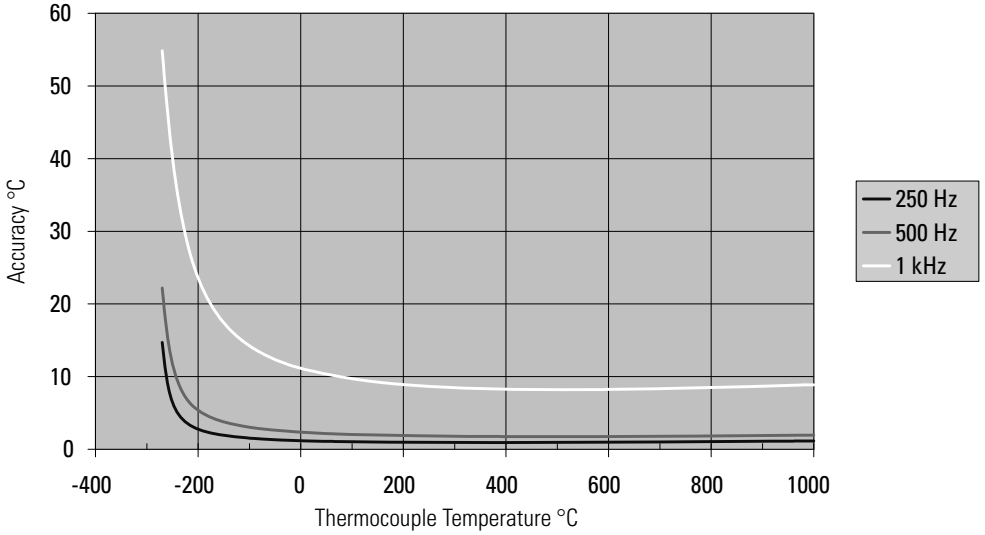

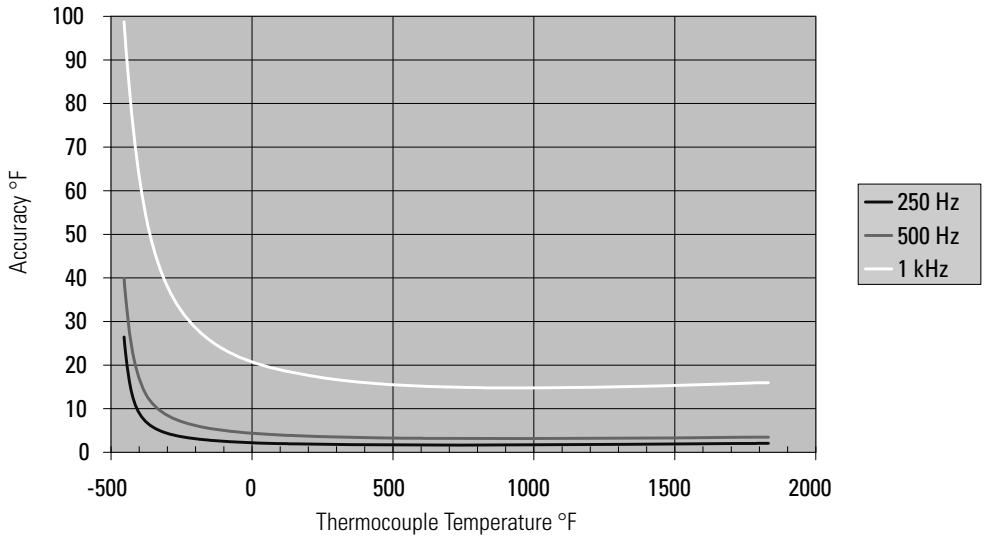

Figure A.7 Module Accuracy at 25°C (77°F) Ambient for Type J Thermocouple Using 10, 50, and 60 Hz Filter

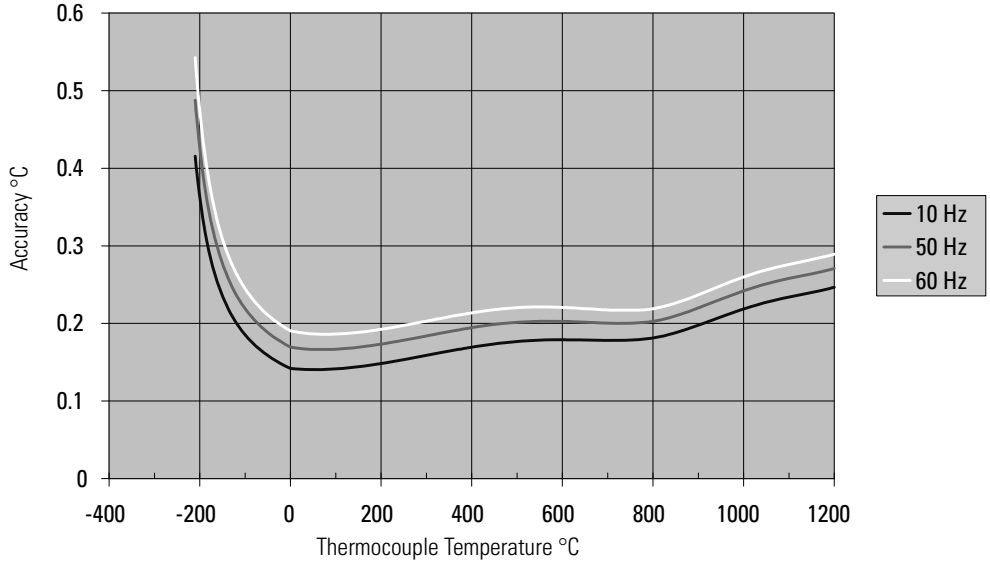

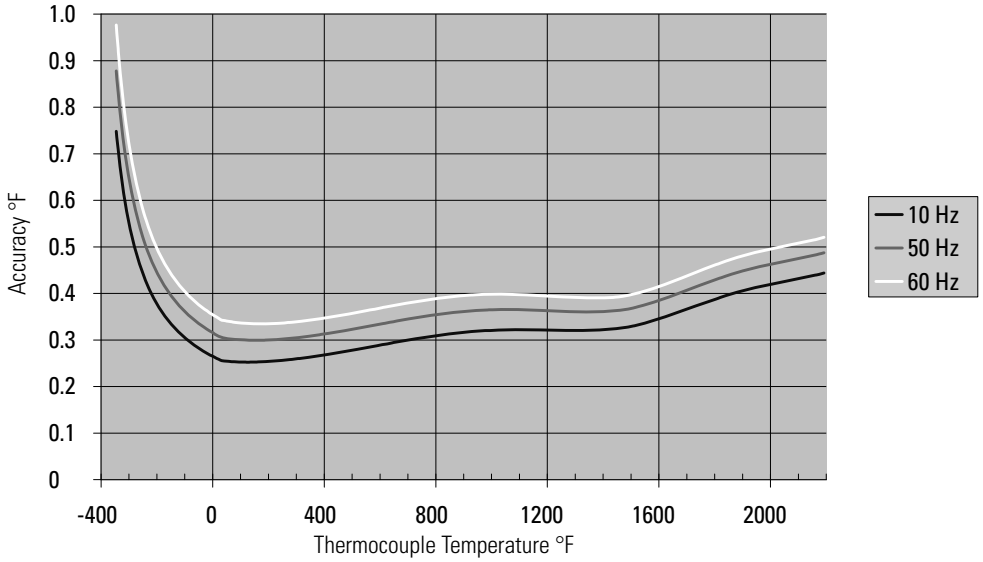

Figure A.8 Module Accuracy at 25°C (77°F) Ambient forType J Thermocouple Using 250, 500, and 1 kHz Filter

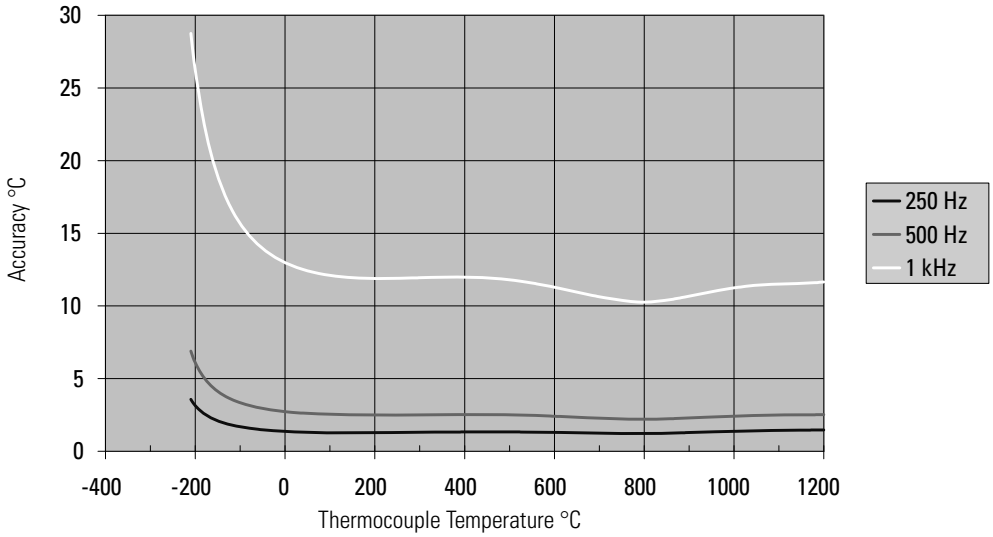

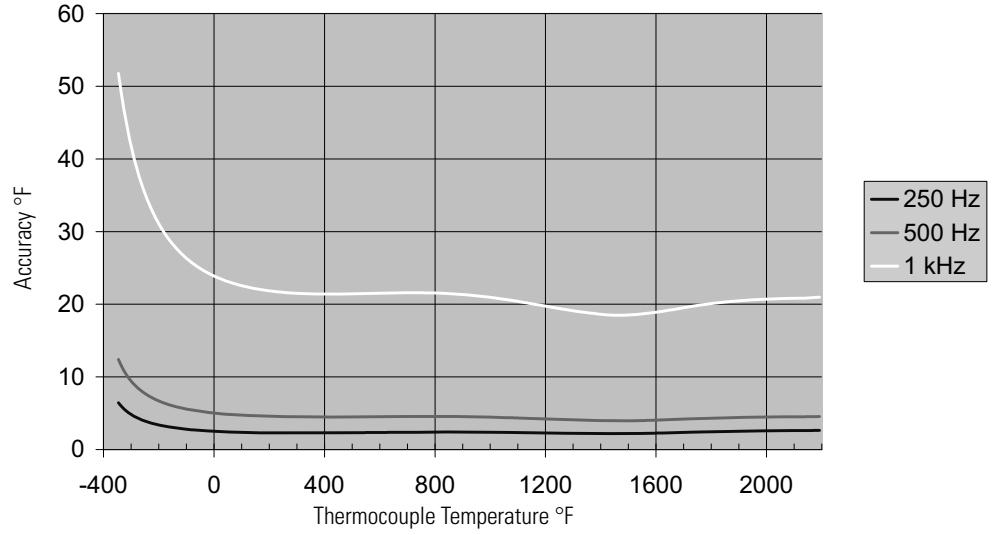

Figure A.9 Module Accuracy at 25°C (77°F) Ambient for Type K Thermocouple Using 10, 50, and 60 Hz Filter

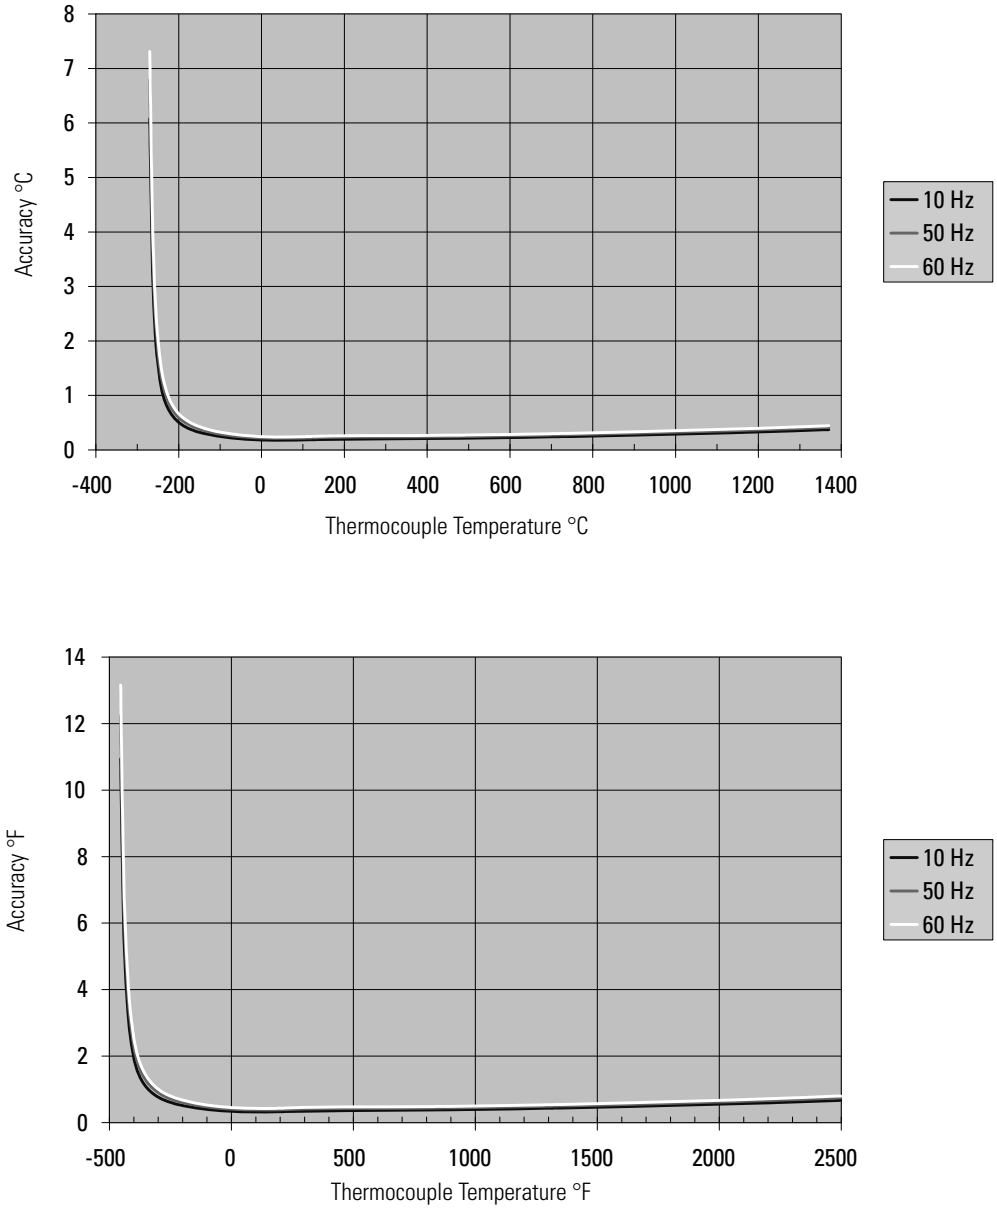

Figure A.10 Module Accuracy at 25°C (77°F) Ambient forType K Thermocouple Using 250, 500, and 1 kHz Filter

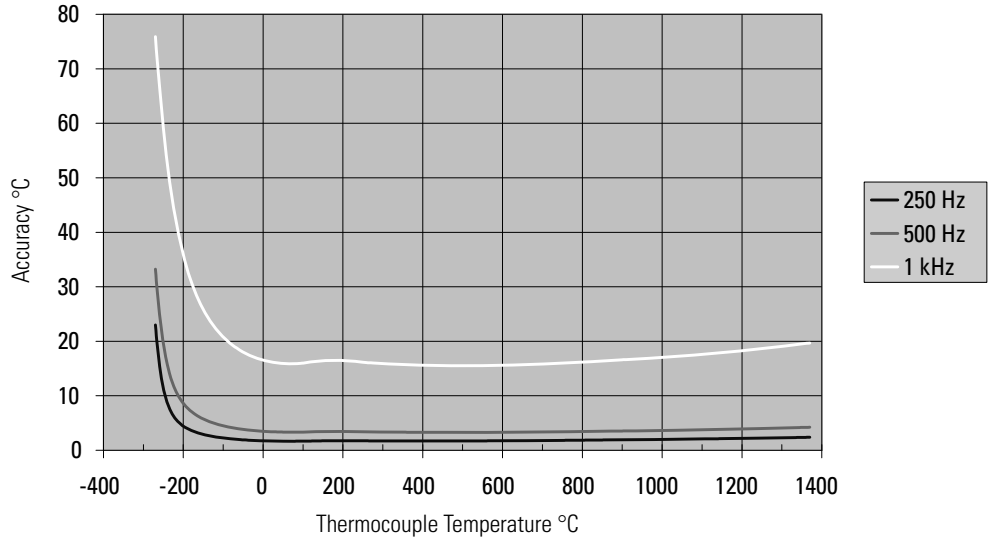

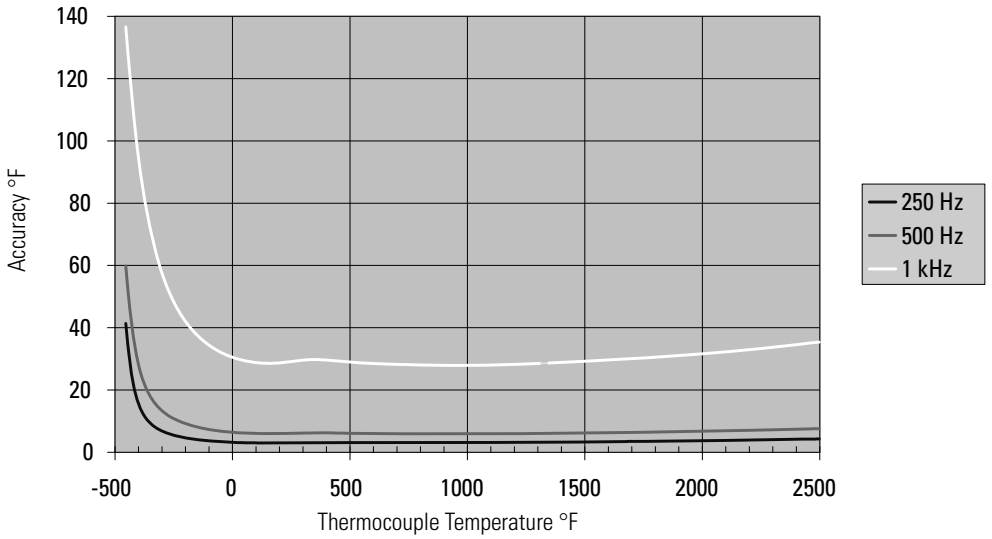

Figure A.11 Module Accuracy at 25°C (77°F) Ambient for Type N Thermocouple Using 10, 50, and 60 Hz Filter

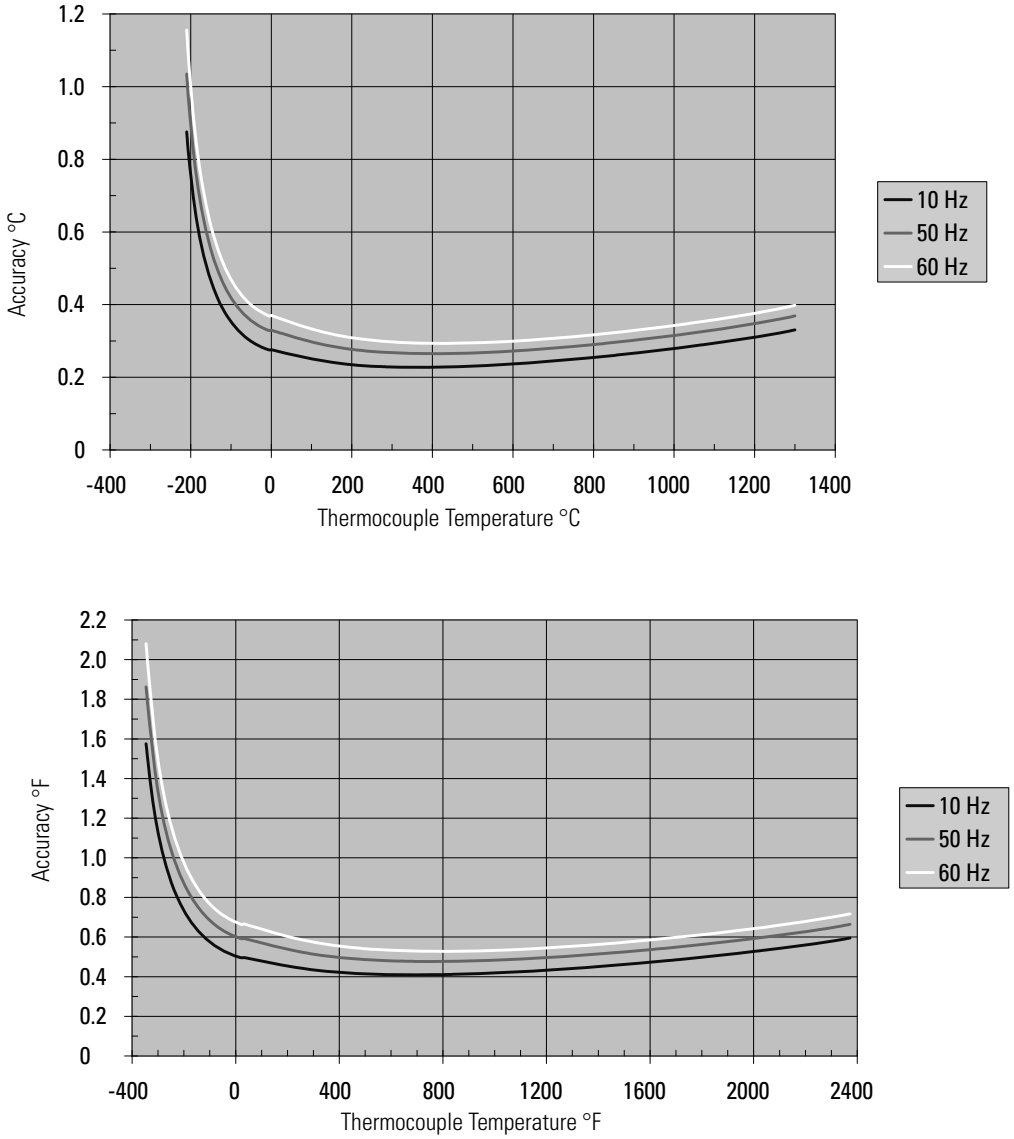

Figure A.12 Module Accuracy at 25°C (77°F) Ambient forType N Thermocouple Using 250, 500, and 1 kHz Filter

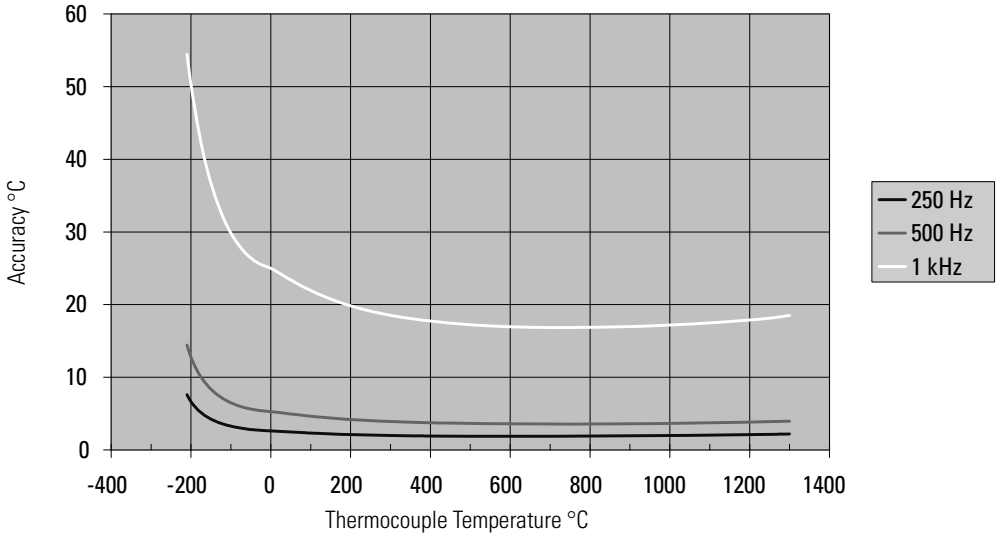

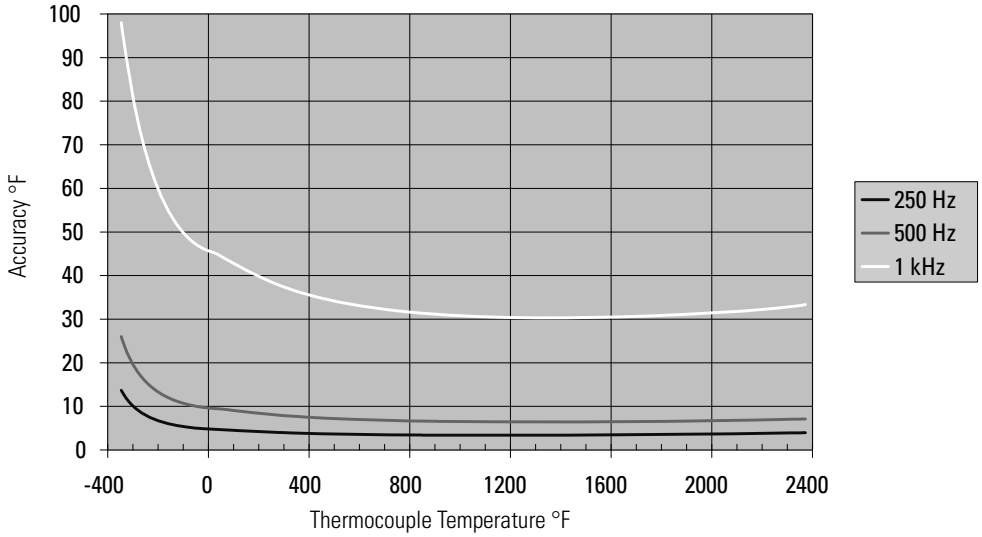

Figure A.13 Module Accuracy at 25°C (77°F) Ambient for Type R Thermocouple Using 10, 50, and 60 Hz Filter

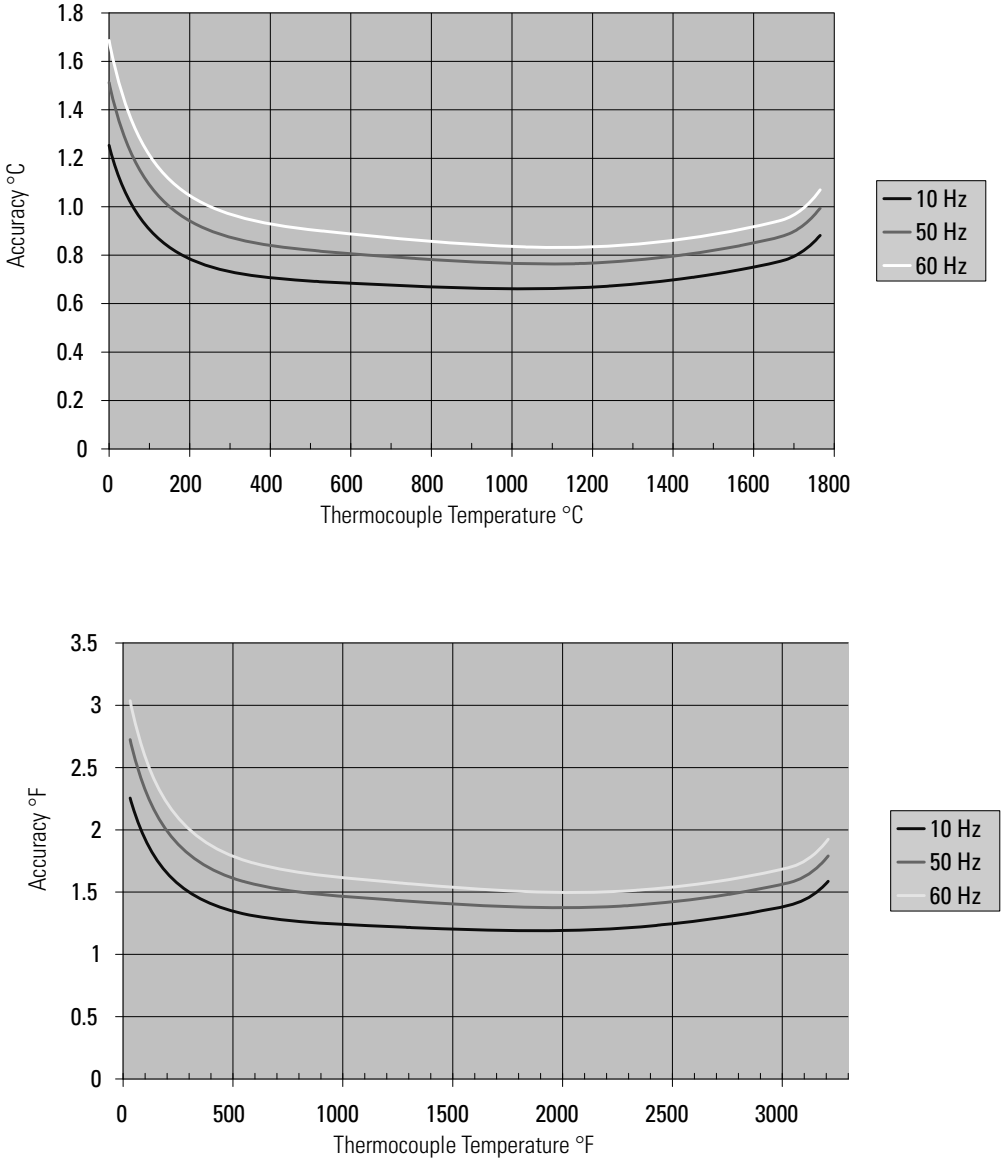

Figure A.14 Module Accuracy at 25°C (77°F) Ambient forType R Thermocouple Using 250, 500, and 1 kHz Filter

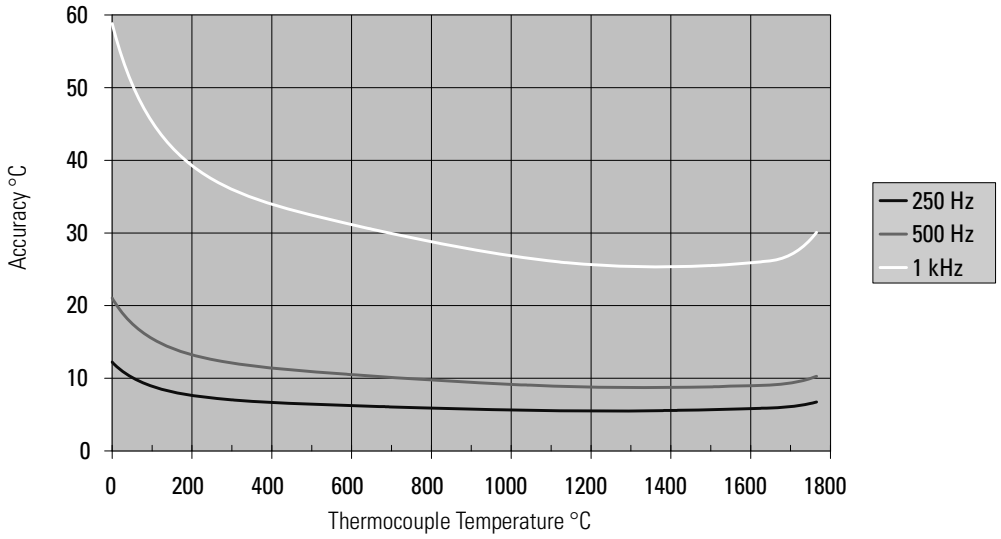

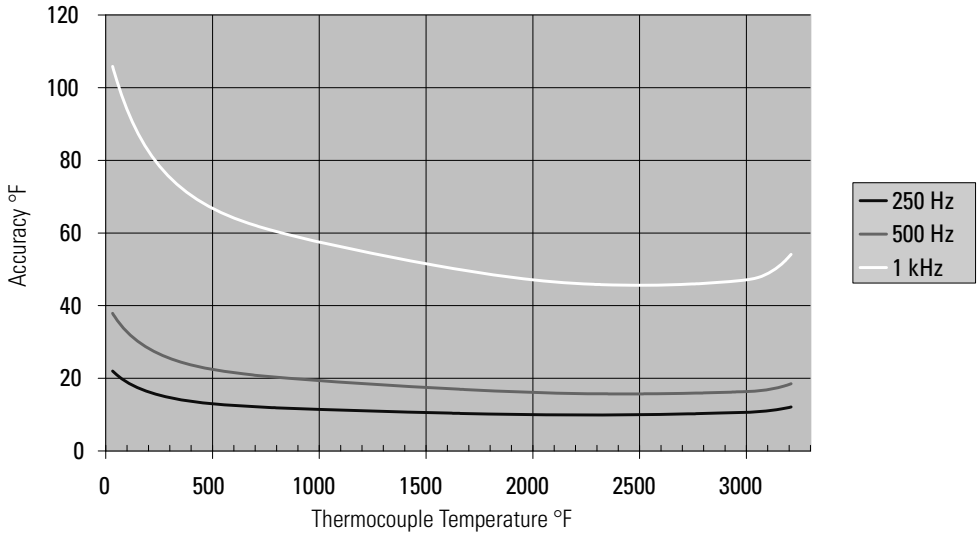

Figure A.15 Module Accuracy at 25°C (77°F) Ambient for Type S Thermocouple Using 10, 50, and 60 Hz Filter

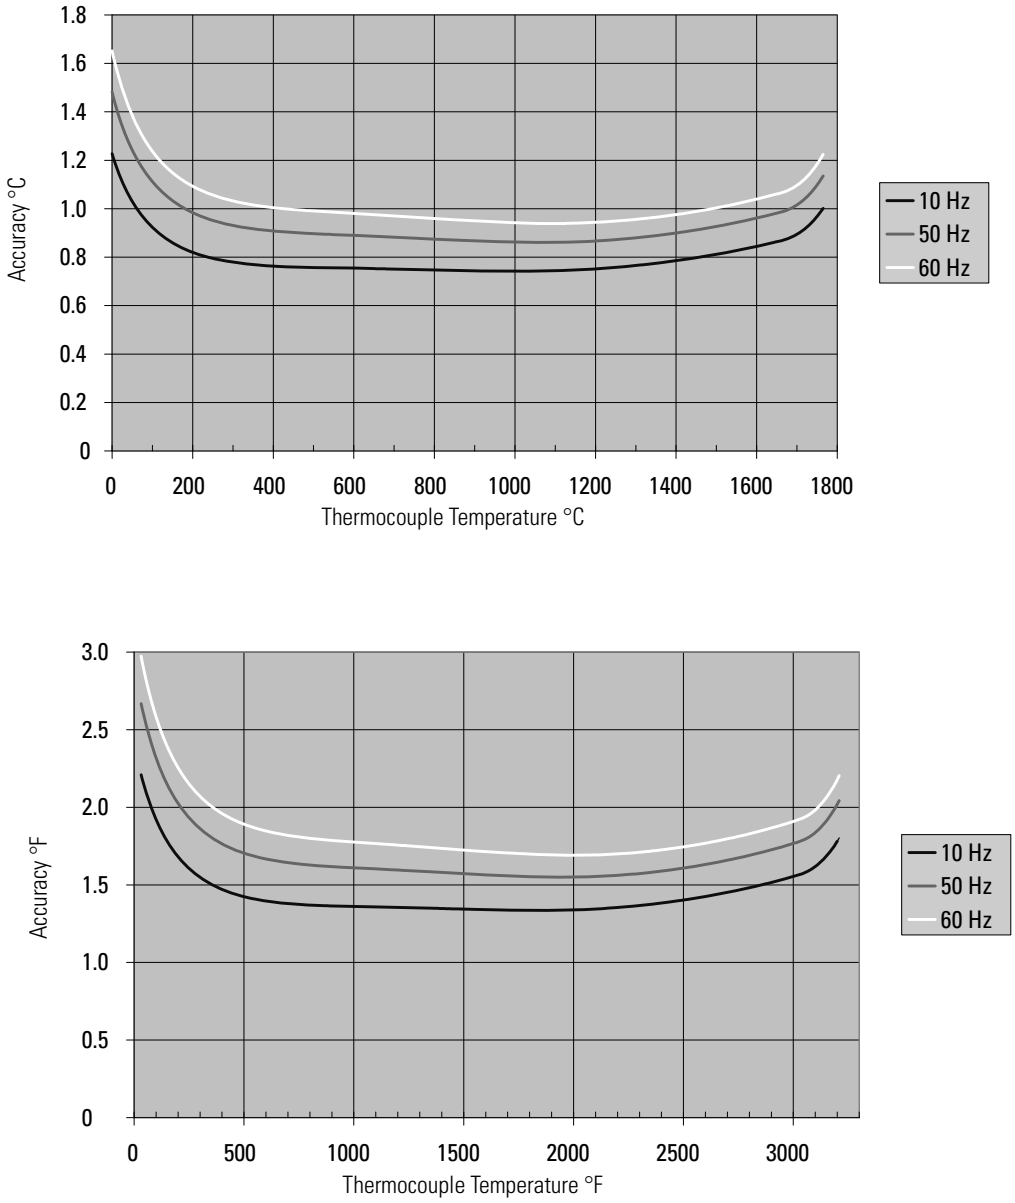

Figure A.16 Module Accuracy at 25°C (77°F) Ambient forType S Thermocouple Using 250, 500, and 1 kHz Filter

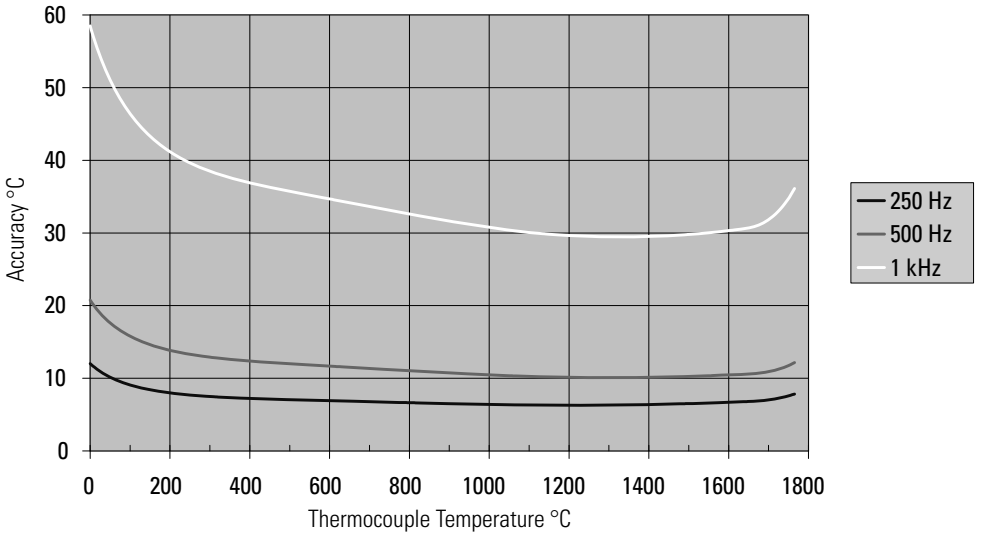

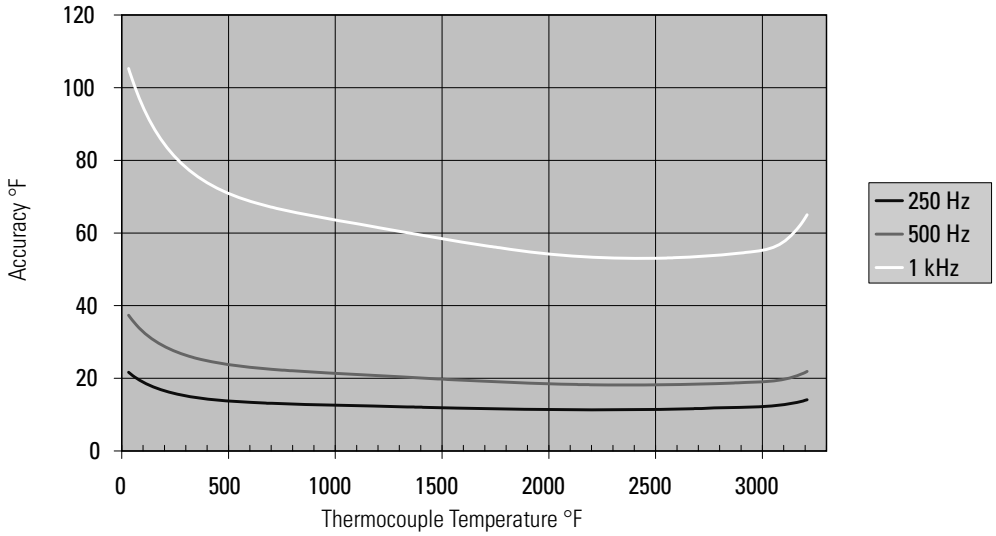

Figure A.17 Module Accuracy at 25°C (77°F) Ambient for Type T Thermocouple Using 10, 50, and 60 Hz Filter

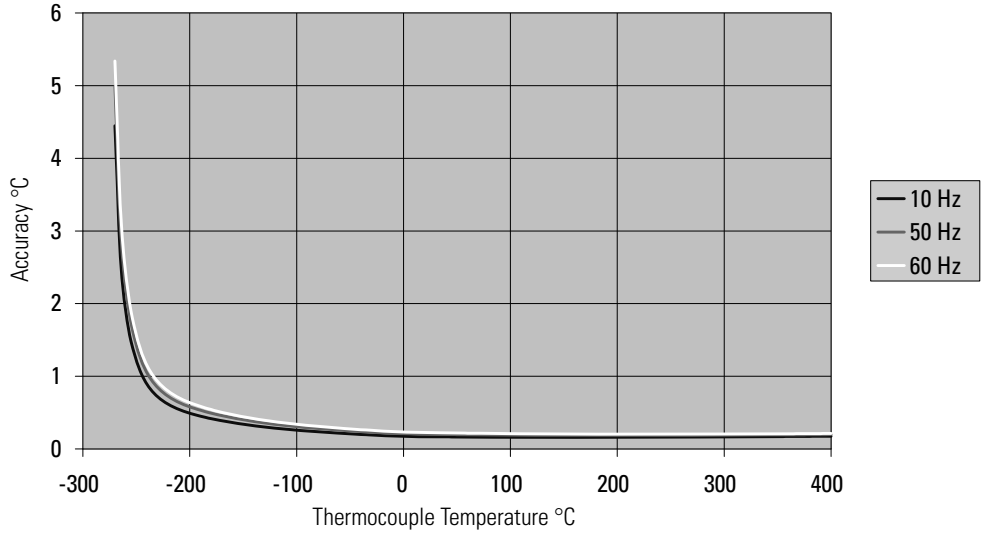

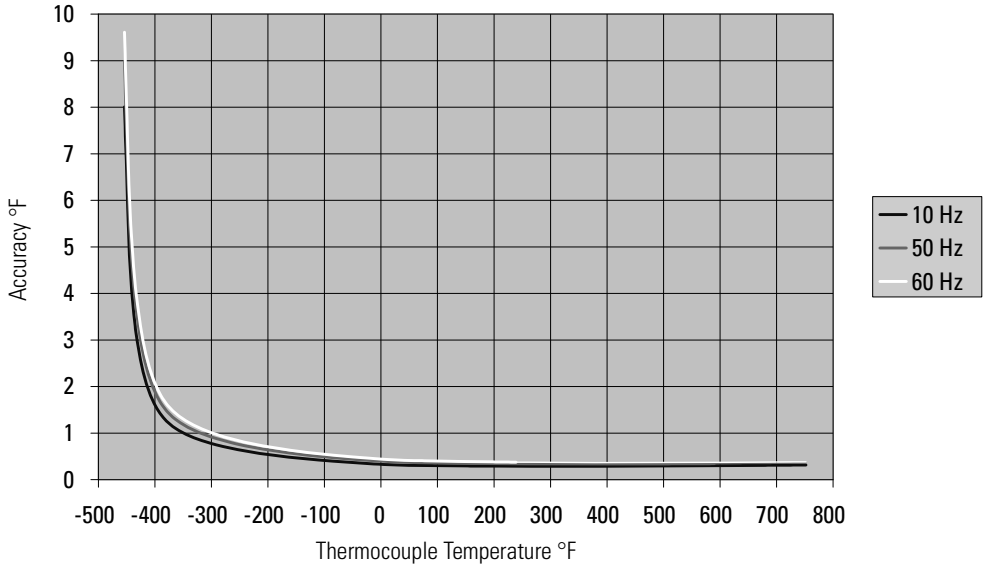

Figure A.18 Module Accuracy at 25°C (77°F) Ambient forType T Thermocouple Using 250, 500, and 1 kHz Filter

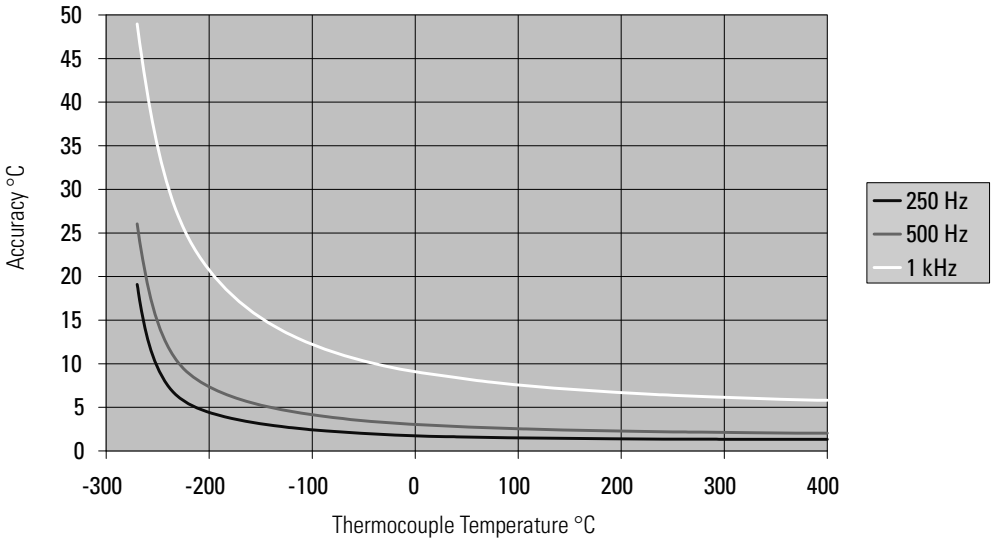

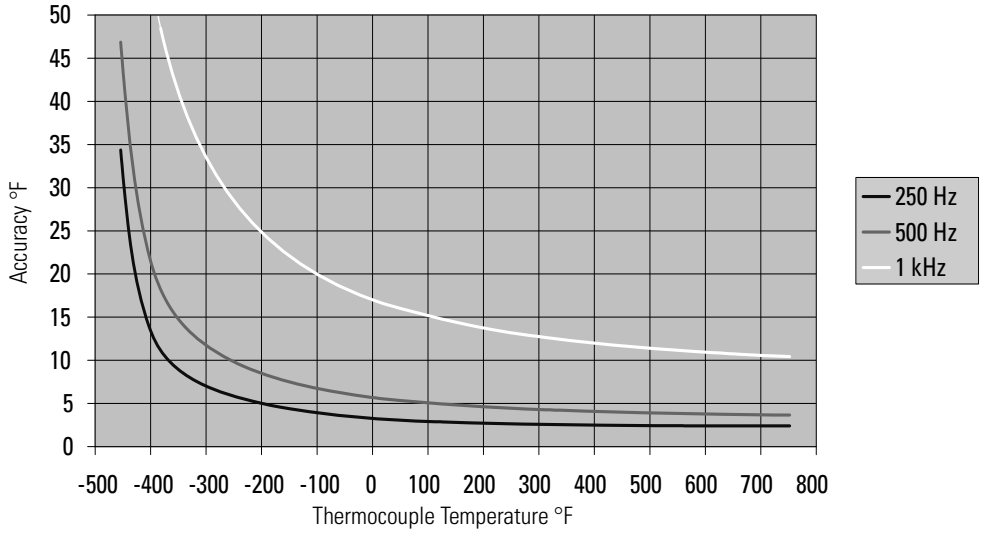

Temperature Drift

The graphs below show the module's temperature drift *without autocalibration* for each thermocouple type over the thermocouple's temperature range, assuming terminal block temperature is stable. *The affects of CJC temperature drift are not included.*

Figure A.19 Module Temperature Drift Using Type B Thermocouple

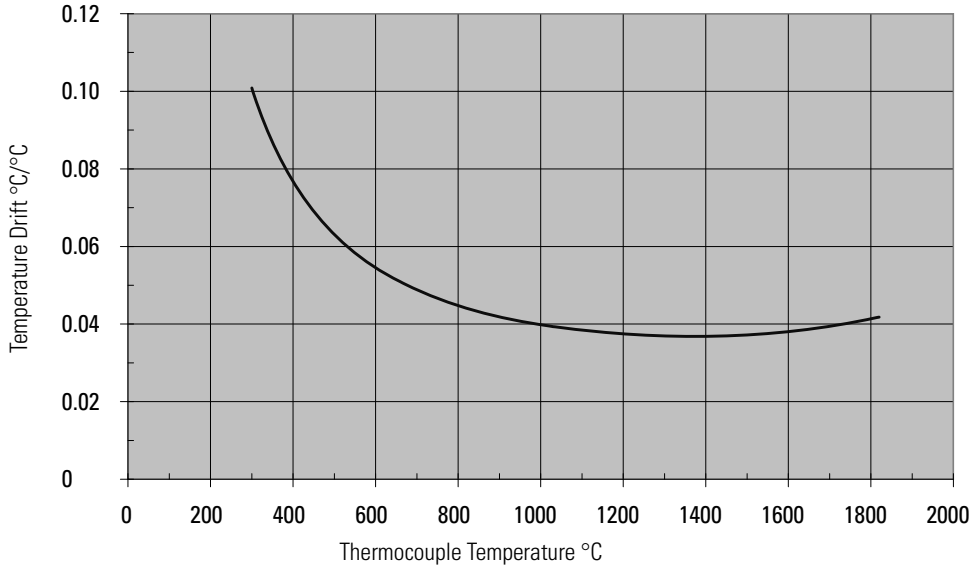

Figure A.20 Module Temperature Drift Using Type C Thermocouple

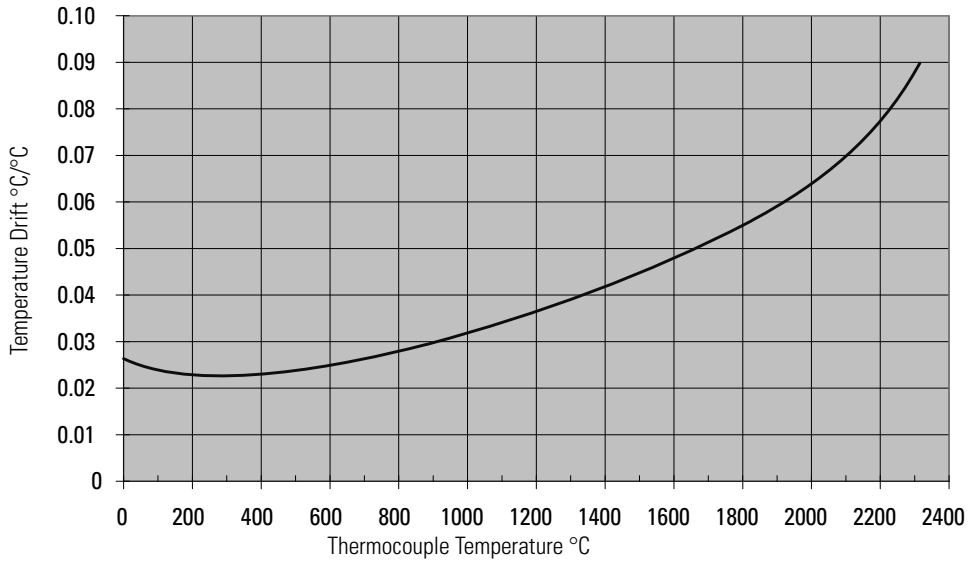

Figure A.21 Module Temperature Drift Using Type E Thermocouple

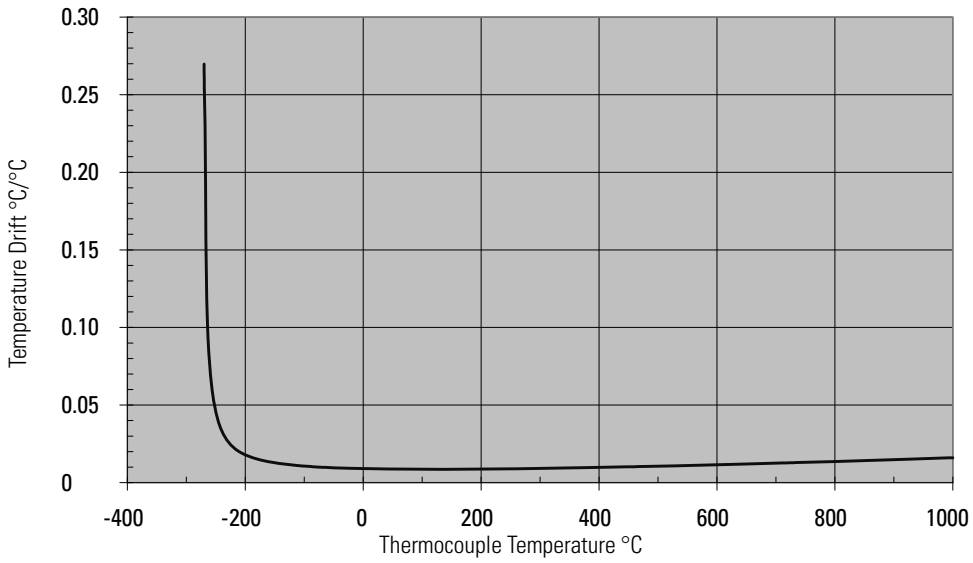

Figure A.22 Module Temperature Drift Using Type J Thermocouple

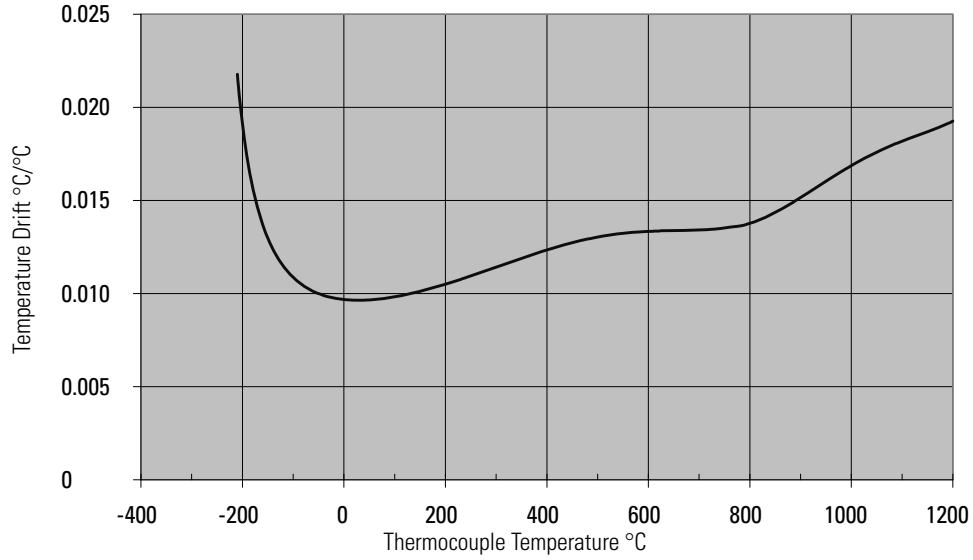

Figure A.23 Module Temperature Drift Using Type K Thermocouple

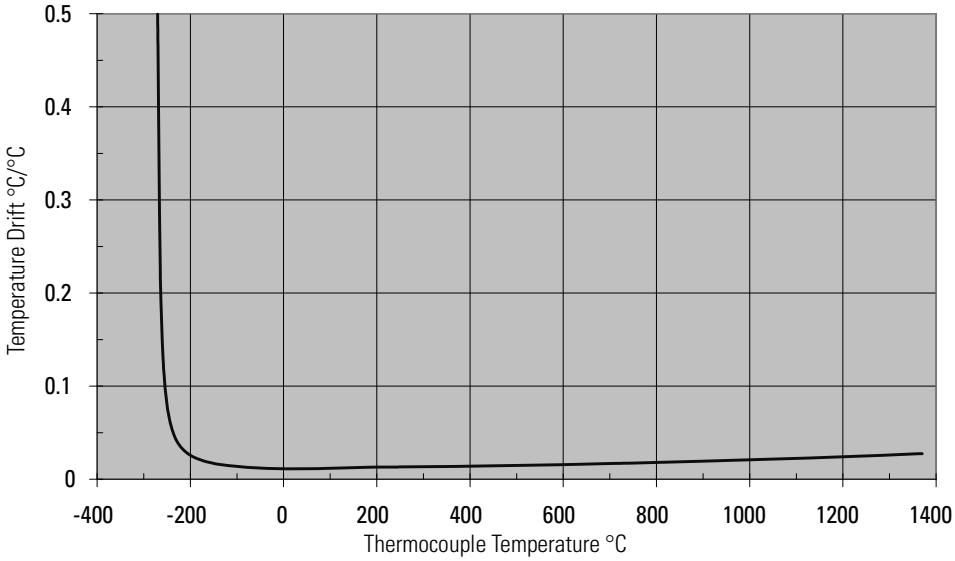

Figure A.24 Module Temperature Drift Using Type N Thermocouple

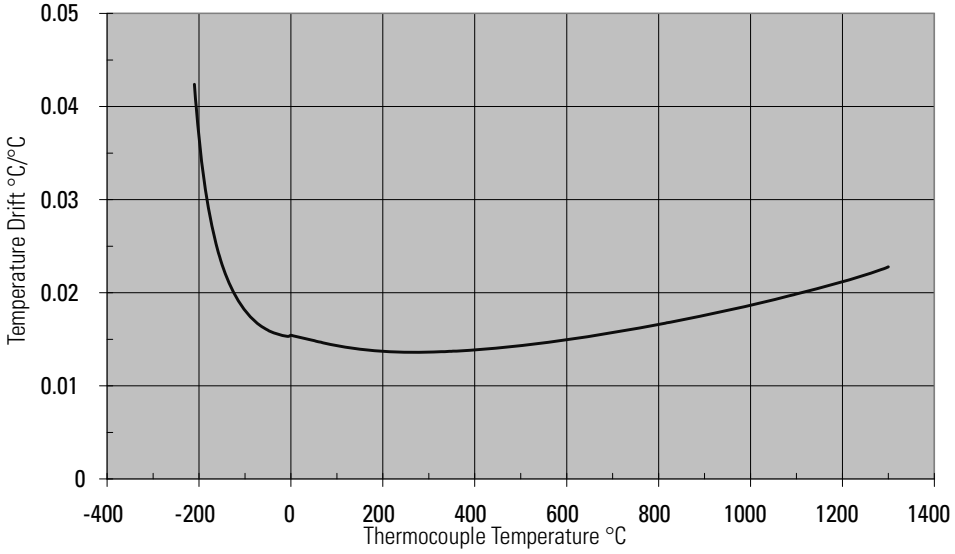

Figure A.25 Module Temperature Drift Using Type R Thermocouple

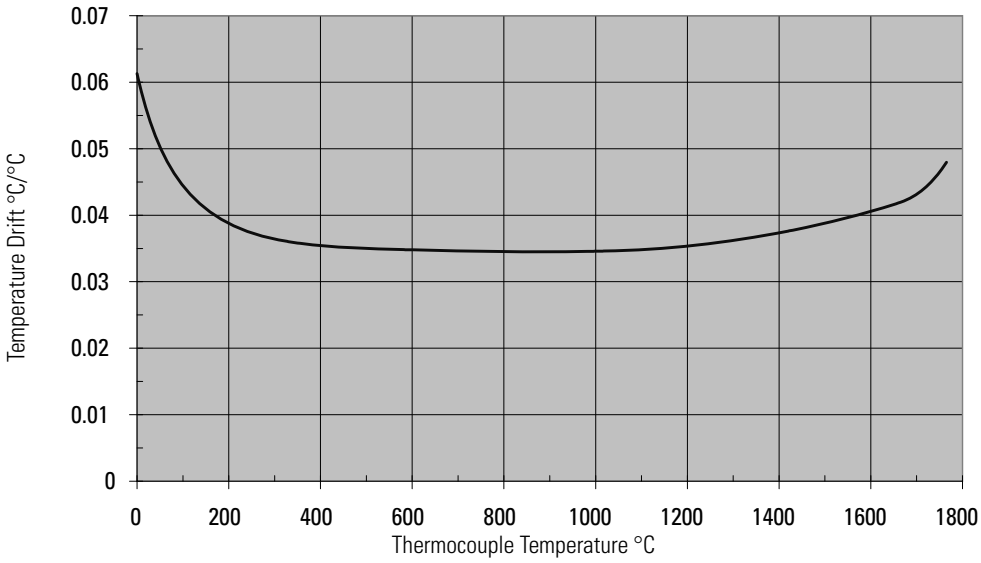

Figure A.26 Module Temperature Drift Using Type S Thermocouple

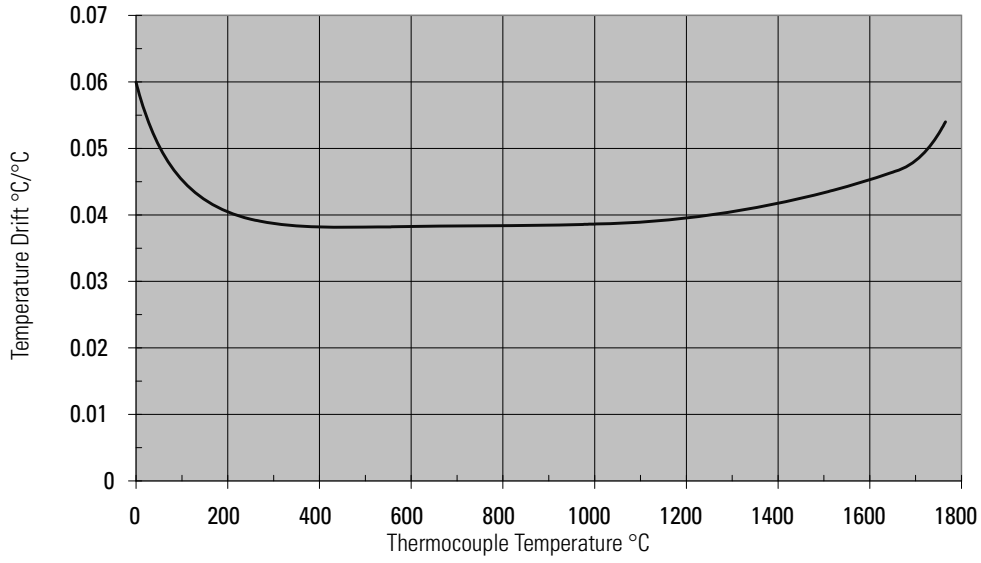

Figure A.27 Module Temperature Drift Using Type T Thermocouple

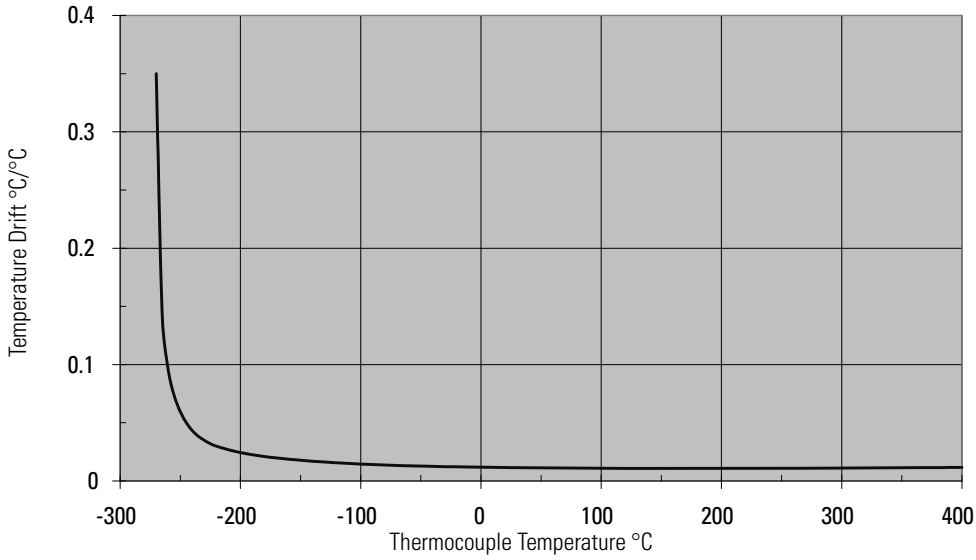

Two's Complement Binary Numbers

The processor memory stores 16-bit binary numbers. Two's complement binary is used when performing mathematical calculations internal to the processor. Analog input values from the analog modules are returned to the processor in 16-bit two's complement binary format. For positive numbers, the binary notation and two's complement binary notation are identical.

As indicated in the figure on the next page, each position in the number has a decimal value, beginning at the right with 2^0 and ending at the left with 2^{15}. Each position can be 0 or 1 in the processor memory. A 0 indicates a value of 0; a 1 indicates the decimal value of the position. The equivalent decimal value of the binary number is the sum of the position values.

Positive Decimal Values

The far left position is always 0 for positive values. As indicated in the figure below, this limits the maximum positive decimal value to 32767 (all positions are 1 except the far left position). For example:

0000 1001 0000 1110 = $2^{11}+2^8+2^3+2^2+2^1$ = 2048+256+8+4+2 = 2318

0010 0011 0010 1000 = $2^{13}+2^9+2^8+2^5+2^3$ = 8192+512+256+32+8 = 9000

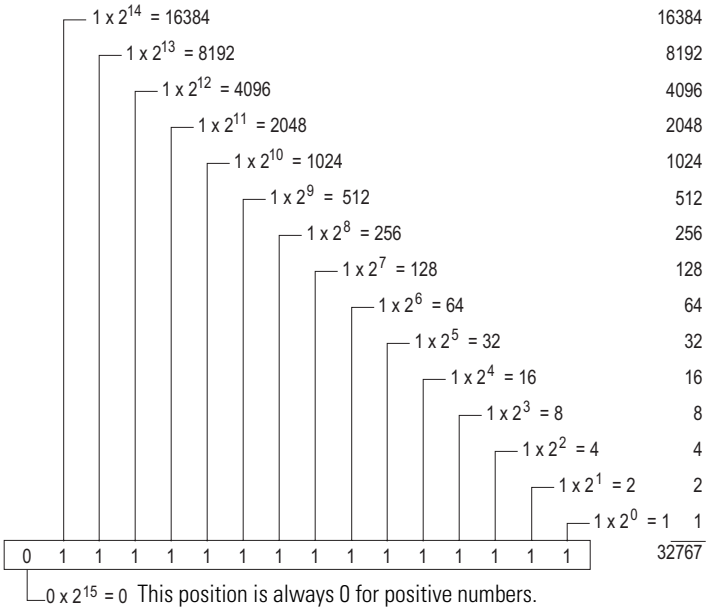

Negative Decimal Values

In two's complement notation, the far left position is always 1 for negative values. The equivalent decimal value of the binary number is obtained by subtracting the value of the far left position, 32768, from the sum of the values of the other positions. In the figure below (all positions are 1), the value is 32767 - 32768 = -1. For example:

$1111\ 1000\ 0010\ 0011 = (2^{14}+2^{13}+2^{12}+2^{11}+2^{5}+2^{1}+2^{0}) - 2^{15} =$

$(16384+8192+4096+2048+32+2+1) - 32768 = 30755 - 32768 = -2013$

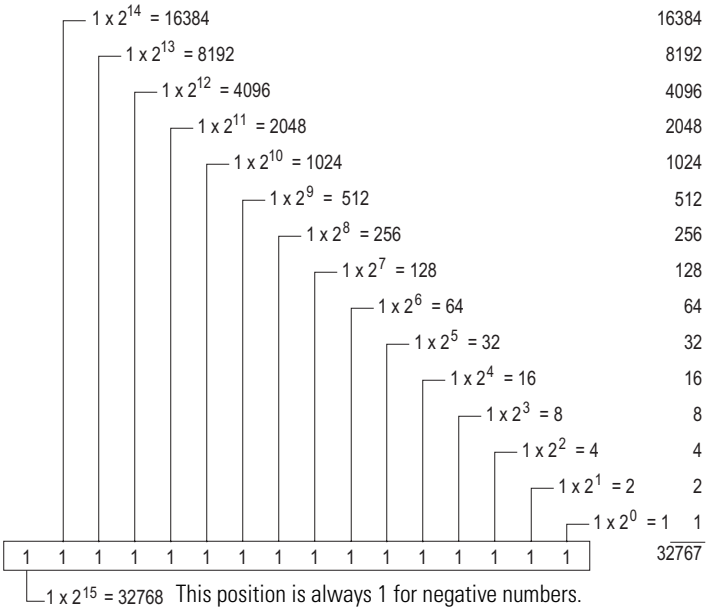

Thermocouple Descriptions

The information in this appendix was extracted from the NIST Monograph 175 issued in January 1990, which supersedes the IPTS-68 Monograph 125 issued in March 1974. NIST Monograph 175 is provided by the United States Department of Commerce, National Institute of Standards and Technology.

International Temperature Scale of 1990

The ITS-90 [1,3] is realized, maintained, and disseminated by NIST to provide a standard scale of temperature for use in science and industry in the United States. This scale was adopted by the International Committee of Weights and Measures (CIPM) at its meeting in September 1989, and it became the official international temperature scale on January 1, 1990. The ITS-90 supersedes the IPTS-68(75) [2] and the 1976 Provisional 0.5 K to 30 K Temperature Scale (EPT-76) [4].

The adoption of the ITS-90 removed several deficiencies and limitations associated with IPTS-68. Temperatures on the ITS-90 are in closer agreement with thermodynamic values than were those of the IPTS-68 and EPT-76. Additionally, improvements have been made in the non-uniqueness and reproducibility of the temperature scale, especially in the temperature range from t68 = 630.74°C to 1064.43°C, where the type S thermocouple was the standard interpolating device on the IPTS-68.

For additional technical information regarding ITS-90, refer to the NIST Monograph 175.

Type B Thermocouples

This section discusses Platinum-30 percent Rhodium Alloy Versus Platinum-6 percent Rhodium Alloy thermocouples, commonly called type B thermocouples. This type is sometimes referred to by the nominal chemical composition of its thermoelements: platinum - 30 percent rhodium versus platinum - 6 percent rhodium or “30-6”. The positive (BP) thermoelement typically contains 29.60 ± 0.2 percent rhodium and the negative (BN) thermoelement usually contains 6.12 ± 0.02 percent rhodium. The effect of differences in rhodium content are described later in this section. An industrial consensus standard [21] (ASTM E1159-87) specifies that rhodium having a purity of 99.98 percent shall be alloyed with platinum of 99.99 percent purity to produce the thermoelements. This consensus standard [21] describes the purity of commercial type B materials that are used in many industrial thermometry applications that meet the calibration tolerances described later in this section. Both thermoelements will typically have significant impurities of elements such as palladium, iridium, iron, and silicon [38].

Studies by Ehringer [39], Walker et al. [25,26], and Glawe and Szaniszlo [24] have demonstrated that thermocouples, in which both legs are platinum-rhodium alloys, are suitable for reliable temperature measurements at high temperatures. Such thermocouples have been shown to offer the following distinct advantages over types R and S thermocouples at high temperatures: (1) improved stability, (2) increased mechanical strength, and (3) higher operating temperatures.

The research by Burns and Gallagher [38] indicated that the 30-6 thermocouple can be used intermittently (for several hours) up to 1790°C and continuously (for several hundred hours) at temperatures up to about 1700°C with only small changes in calibration. The maximum temperature limit for the thermocouple is governed, primarily, by the melting point of the Pt-6 percent rhodium thermoelement which is estimated to be about 1820°C by Acken [40]. The thermocouple is most reliable when used in a clean oxidizing atmosphere (air) but also has been used successfully in neutral atmospheres or vacuum by Walker et al [25,26], Hendricks and McElroy [41], and Glawe and Szaniszlo [24]. The stability of the thermocouple at high temperatures has been shown by Walker et al. [25,26] to depend, primarily, on the quality of the materials used for protecting and insulating the thermocouple. High purity alumina with low iron-content appears to be the most suitable material for the purpose.

Type B thermocouples should not be used in reducing atmospheres, nor those containing deleterious vapors or other contaminants that are reactive with the platinum group metals [42], unless suitably protected with nonmetallic protecting tubes. They should never be used in metallic protecting tubes at high temperatures.

The Seebeck coefficient of type B thermocouples decreases with decreasing temperature below about 1600°C and becomes almost negligible at room temperature. Consequently, in most applications the reference junction temperature of the thermocouple does not need to be controlled or even known, as long as it between 0°C and 50°C. For example, the voltage developed by the thermocouple, with the reference junction at 0°C, undergoes a reversal in sign at about 42°C, and between 0°C and 50°C varies from a minimum of -2.6μV near 21°C to a maximum of 2.3μV at 50°C. Therefore, in use, if the reference junction of the thermocouple is within the range 0°C to 50°C, then a 0°C reference junction temperature can be assumed and the error introduced will not exceed 3μV. At temperatures above 1100°C, an additional measurement error of 3μV (about 0.3°C) would be insignificant in most instances.

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type B commercial thermocouples be ±0.5 percent between 870°C and 1700°C. Type B thermocouples can also be supplied to meet special tolerances of ±0.25 percent. Tolerances are not specified for type B thermocouples below 870°C.

The suggested upper temperature limit of 1700°C given in the ASTM standard [7] for protected type B thermocouples applies to AWG 24 (0.51 mm) wire. This temperature limit applies to thermocouples used in conventional closed-end protecting tubes and it is intended only as a rough guide to the user. It does not apply to thermocouples having compacted mineral oxide insulation.

Type E Thermocouples

This section describes Nickel-Chromium Alloy Versus Copper-Nickel Alloy thermocouples, known as type E thermocouples. This type, and the other base-metal types, do not have specific chemical compositions given in standards; rather, any materials whose emf-temperature relationship agrees with that of the specified reference table within certain tolerances can be considered to be a type E thermocouple. The positive thermoelement, EP, is the same material as KP. The negative thermoelement, EN, is the same material as TN.

The low-temperature research [8] by members of the NBS Cryogenics Division showed that type E thermocouples are very useful down to liquid hydrogen temperatures (n.b.p. about 20.3K) where their Seebeck coefficient is about 8mV/°C. They may even be used down to liquid helium temperatures (4.2°K) although their Seebeck coefficient becomes quite low, only about 2mV/°C at 4K. Both thermoelements of type E thermocouples have a relatively low thermal conductivity, good resistance to corrosion in moist atmospheres, and reasonably good homogeneity. For these three reasons and their relatively high Seebeck coefficients, type E thermocouples have been recommended [8] as the most useful of the letter-designated thermocouple types for low-temperature measurements.

For measurements below 20K, the non-letter-designated thermocouple, KP versus gold-0.07, is recommended. The properties of this thermocouple have been described by Sparks and Powell [12].

Type E thermocouples also have the largest Seebeck coefficient above 0°C for any of the letter-designated thermocouples. For that reason they are being used more often whenever environmental conditions permit.

Type E thermocouples are recommended by the ASTM [5] for use in the temperature range from -200°C to 900°C in oxidizing or inert atmospheres. If used for extended times in air above 500°C, heavy gauge wires are recommended because the oxidation rate is rapid at elevated temperatures. About 50 years ago, Dahl [11] studied the thermoelectric stability of EP and EN type alloys when heated in air at elevated temperatures. His work should be consulted for details. More recent stability data on these alloys in air were reported by Burley et al. [13]. Type E thermocouples should not be used at high temperatures in sulfurous, reducing, or alternately reducing and oxidizing atmospheres unless suitably protected with protecting tubes. They also should not be used in vacuum (at high temperatures) for extended times because the

chromium in the positive thermoelement, a nickel-chromium alloy, vaporizes out of solution and alters the calibration. In addition, their use in atmospheres that promote “green-rot” corrosion of the positive thermoelement should be avoided. Such corrosion results from the preferential oxidation of chromium in atmospheres with low, but not negligible, oxygen content and can lead to a large decrease in the thermoelectric voltage of the thermocouple with time. The effect is most serious at temperatures between 800°C and 1050°C.

The negative thermoelement, a copper-nickel alloy, is subject to composition changes under thermal neutron irradiation since the copper is converted to nickel and zinc.

Neither thermoelement of type E thermocouples is very sensitive to minor changes in composition or impurity level because both are already heavily alloyed. Similarly, they are also not extremely sensitive to minor differences in heat treatment (provided that the treatment does not violate any of the restrictions mentioned above). For most general applications, they may be used with the heat treatment given by the wire manufacturers. However, when the highest accuracy is sought, additional preparatory heat treatments may be desirable in order to enhance their performance. Details on this and other phases of the use and behavior of type KP thermoelements (EP is the same as KP) are given in publications by Pots and McElroy [14], by Burley and Ackland [15], by Burley [16], by Wang and Starr [17,18], by Bentley [19], and by Kollie et al. [20].

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type E commercial thermocouples be ±1.7°C or ±0.5 percent (whichever is greater) between 0°C and 900°C, and ±1.7°C or ±1 percent (whichever is greater) between -200°C and 0°C. Type E thermocouples can also be supplied to meet special tolerances which are equal to ±1°C or ±0.4 percent (whichever is greater) between 0°C and 900°C, and ±1°C or ±0.5 percent (whichever is greater) between -200°C and 0°C. Type E thermocouple materials are normally supplied to meet the tolerances specified for temperatures above 0°C. The same materials, however, may not satisfy the tolerances specified for the -200°C to 0°C range. If materials are required to meet the tolerances below 0°C, this should be specified when they are purchased.

The suggested upper temperature limit, 870°C, given in the ASTM standard [7] for protected type E thermocouples applies to AWG 8 (3.25 mm) wire. It decreases to 650°C for AWG 14 (1.63 mm), 540°C for AWG 20 (0.81 mm), 430°C for AWG 24 or 28 (0.51 mm or 0.33 mm), and 370°C for AWG 30 (0.25 mm). These temperature limits apply to thermocouples used in conventional closed-end protecting tubes and they are intended only as a rough guide to the user. They do not apply to thermocouples having compacted mineral oxide insulation.

Type J Thermocouples

This section discusses Iron Versus Copper-Nickel Alloy (SAMA) thermocouples, called type J thermocouples. A type J thermocouple is one of the most common types of industrial thermocouples, because of its relatively high Seebeck coefficient and low cost. It has been reported that more than 200 tons of type J materials are supplied annually to industry in this country. However, this type is least suitable for accurate thermometry because there are significant nonlinear deviations in the thermoelectric output of thermocouples obtained from different manufacturers. These irregular deviations lead to difficulties in obtaining accurate calibrations based on a limited number of calibration points. The positive thermoelement is commercially pure (99.5 percent Fe) iron, usually containing significant impurity levels of carbon, chromium, copper, manganese, nickel, phosphorus, silicon, and sulfur. Thermocouple wire represents such a small fraction of the total production of commercial iron wire that the producers do not control the chemical composition to maintain constant thermoelectric properties. Instead, instrument companies and thermocouple fabricators select material most suitable for the thermocouple usage. The total and specific types of impurities that occur in commercial iron change with time, location of primary ores, and methods of smelting. Many unusual lots have been selected in the past, for example spools of industrial iron wire and even scrapped rails from an elevated train line. At present, iron wire that most closely fits these tables has about 0.25 percent manganese and 0.12 percent copper, plus other minor impurities.

The negative thermoelement for type J thermocouples is a copper-nickel alloy known ambiguously as constantan. The word constantan has commonly referred to copper-nickel alloys containing anywhere from 45 to 60 percent copper, plus minor impurities of carbon, cobalt, iron, and manganese. Constantan for type J thermocouples usually contains about 55 percent copper, 45 percent nickel, and a small but thermoelectrically significant amount of cobalt, iron, and manganese, about 0.1 percent or more. It should be emphasized that type JN thermoelements are NOT generally interchangeable with type TN (or EN) thermoelements, although they are all referred to as “constantan”. In order to provide some differentiation in nomenclature, type JN is often referred to as SAMA constantan.

Type J thermocouples are recommended by the ASTM [5] for use in the temperature range from 0°C to 760°C in vacuum, oxidizing, reducing, or inert atmospheres. If used for extended times in air above 500°C, heavy gauge wires are recommended because the oxidation rate is rapid at elevated temperatures. Oxidation normally causes a gradual decrease in the thermoelectric voltage of the thermocouple with time. Because iron rusts in moist atmospheres and may become brittle, type J thermocouples are not recommended for use below 0°C. In addition, they should not be used unprotected in sulfurous atmospheres above 500°C.

The positive thermoelement, iron, is relatively insensitive to composition changes under thermal neutron irradiation, but does exhibit a slight

increase in manganese content. The negative thermoelement, a copper-nickel alloy, is subject to substantial composition changes under thermal neutron irradiation since copper is converted to nickel and zinc.

Iron undergoes a magnetic transformation near 769°C and an alpha-gamma crystal transformation near 910°C [6]. Both of these transformations, especially the latter, seriously affect the thermoelectric properties of iron, and therefore of type J thermocouples. This behavior and the rapid oxidation rate of iron are the main reasons why iron versus constantan thermocouples are not recommended as a standardized type above 760°C. If type J thermocouples are taken to high temperatures, especially above 900°C, they will lose the accuracy of their calibration when they are recycled to lower temperatures. If type J thermocouples are used in air at temperatures above 760°C, only the largest wire, AWG 8 (3.3 mm) should be used and they should be held at the measured temperature for 10 to 20 minutes before readings are taken. The thermoelectric voltage of the type J thermocouples may change by as much as 40μV (or 0.6°C equivalent) per minute when first brought up to temperatures near 900°C.

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type J commercial thermocouples be ±2.2°C or ±0.75 percent (whichever is greater) between 0°C and 750°C. Type J thermocouples can also be supplied to meet special tolerances, which are equal to approximately one-half the standard tolerances given above. Tolerances are not specified for type J thermocouples below 0°C or above 750°C.

The suggested upper temperature limit of 760°C given in the above ASTM standard [7] for protected type J thermocouples applies to AWG 8 (3.25 mm) wire. For smaller diameter wires the suggested upper temperature limit decreases to 590°C for AWG 14 (1.63 mm), 480°C for AWG 20 (0.81 mm), 370°C for AWG 24 or 28 (0.51 mm or 0.33 mm), and 320°C for AWG 30 (0.25 mm). These temperature limits apply to thermocouples used in conventional closed-end protecting tubes and they are intended only as a rough guide to the user. They do not apply to sheathed thermocouples having compacted mineral oxide insulation.

Type K Thermocouples

This section describes Nickel-Chromium Alloy Versus Nickel-Aluminum Alloy thermocouples, called type K thermocouples. This type is more resistant to oxidation at elevated temperatures than types E, J, or T thermocouples and, consequently, it finds wide application at temperatures above 500°C. The positive thermoelement, KP, which is the same as EP, is an alloy that typically contains about 89 to 90 percent nickel, 9 to about 9.5 percent chromium, both silicon and iron in amounts up to about 0.5 percent, plus smaller amounts of other constituents such as carbon, manganese, cobalt, and niobium. The negative thermoelement, KN, is typically composed of about 95 to 96 percent nickel, 1 to 1.5

percent silicon, 1 to 2.3 percent aluminum, 1.6 to 3.2 percent manganese, up to about 0.5 percent cobalt and smaller amounts of other constituents such as iron, copper, and lead. Also, type KN thermoelements with modified compositions are available for use in special applications. These include alloys in which the manganese and aluminum contents are reduced or eliminated, while the silicon and cobalt contents are increased.

The low temperature research [8] by members of the NBS Cryogenics Division showed that the type K thermocouple may be used down to liquid helium temperatures (about 4K) but that its Seebeck coefficient becomes quite small below 20K. Its Seebeck coefficient at 20K is only about 4μV/K, being roughly one-half that of the type E thermocouple which is the most suitable of the letter-designated thermocouples types for measurements down to 20K. Type KP and type KN thermoelements do have a relatively low thermal conductivity and good resistance to corrosion in moist atmospheres at low temperatures. The thermoelectric homogeneity of type KN thermoelements, however, was found [8] to be not quite as good as that of type EN thermoelements.

Type K thermocouples are recommended by the ASTM [5] for use at temperatures within the range -250°C to 1260°C in oxidizing or inert atmospheres. Both the KP and the KN thermoelements are subject to deterioration by oxidation when used in air above about 750°C, but even so, type K thermocouples may be used at temperatures up to about 1350°C for short periods with only small changes in calibration. When oxidation occurs it normally leads to a gradual increase in the thermoelectric voltage with time. The magnitude of the change in the thermoelectric voltage and the physical life of the thermocouple will depend upon such factors as the temperature, the time at temperature, the diameter of the thermoelements and the conditions of use.

The ASTM Manual [5] indicates that type K thermocouples should not be used at high temperatures in sulfurous, reducing, or alternately oxidizing and reducing atmospheres unless suitably protected with protecting tubes. They also should not be used in vacuum (at high temperatures) for extended times because the chromium in the positive thermoelement, a nickel-chromium alloy, vaporizes out of solution and alters the calibration. In addition, avoid their use in atmospheres that promote “green-rot” corrosion [9] of the positive thermoelement. Such corrosion results from the preferential oxidation of chromium in atmospheres with low, but not negligible, oxygen content and can lead to a large decrease in the thermoelectric voltage of the thermocouple with time. The effect is most serious at temperatures between 800°C and 1050°C.

Both thermoelements of type K thermocouples are reasonably stable, thermoelectrically, under neutron irradiation since the resulting changes in their chemical compositions due to transmutation are small. The KN thermoelements are somewhat less stable than the KP thermoelements in that they experience a small increase in the iron content accompanied by a slight decrease in the manganese and cobalt contents.

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type K commercial thermocouples be ±2.2°C or ±0.75 percent (whichever is greater) between 0°C and 1250°C, and ±2.2°C or ±2 percent (whichever is greater) between -200°C and 0°C. In the 0°C to 1250°C range, type K thermocouples can be supplied to meet special tolerances that are equal to approximately one-half the standard tolerances given above. Type K thermocouple materials are normally supplied to meet the tolerances specified for temperatures above 0°C. However, the same materials may not satisfy the tolerances specified for the -200°C to 0°C range. If materials are required to meet the tolerances below 0°C, this should be specified when they are purchased.

The suggested upper temperature limit of 1260°C given in the ASTM standard [7] for protected type K thermocouples applies to AWG 8 (3.25 mm) wire. It decreases to 1090°C for AWG 14 (1.63 mm), 980°C for AWG 20 (0.81 mm), 870 for AWG 24 or 28 (0.51 mm or 0.33 mm), and 760°C for AWG 30 (0.25 mm). These temperature limits apply to thermocouples used in conventional closed-end protecting tubes and they are intended only as a rough guide to the user. They do not apply to thermocouples having compacted mineral oxide insulation.

Type N Thermocouples

This section describes Nickel-Chromium-Silicon Alloy Versus Nickel-Silicon-Magnesium Alloy thermocouples, commonly referred to as type N thermocouples. This type is the newest of the letter-designated thermocouples. It offers higher thermoelectric stability in air above 1000°C and better air-oxidation resistance than types E, J, and K thermocouples. The positive thermoelement, NP, is an alloy that typically contains about 84 percent nickel, 14 to 14.4 percent chromium, 1.3 to 1.6 percent silicon, plus small amounts (usually not exceeding about 0.1 percent) of other elements such as magnesium, iron, carbon, and cobalt. The negative thermoelement, NN, is an alloy that typically contains about 95 percent nickel, 4.2 to 4.6 percent silicon, 0.5 to 1.5 percent magnesium, plus minor impurities of iron, cobalt, manganese and carbon totaling about 0.1 to 0.3 percent. The type NP and NN alloys were known originally [16] as nicrosil and nisil, respectively.

The research reported in NBS Monograph 161 showed that the type N thermocouple may be used down to liquid helium temperatures (about 4K) but that its Seebeck coefficient becomes very small below 20K. Its Seebeck coefficient at 20K is about 2.5μV/K, roughly one-third that of type E thermocouples which are the most suitable of the letter-designated thermocouples types for measurements down to 20K. Nevertheless, types NP and NN thermoelements do have a relatively low thermal conductivity and good resistance to corrosion in moist atmospheres at low temperatures.

Type N thermocouples are best suited for use in oxidizing or inert atmospheres. Their suggested upper temperature limit, when used in conventional closed-end protecting tubes, is set at 1260°C by the ASTM [7] for 3.25 mm diameter thermoelements. Their maximum upper temperature limit is defined by the melting temperature of the thermoelements, which are nominally 1410°C for type NP and 1340°C for type NN [5]. The thermoelectric stability and physical life of type N thermocouples when used in air at elevated temperatures will depend upon factors such as the temperature, the time at temperature, the diameter of the thermoelements, and the conditions of use. Their thermoelectric stability and oxidation resistance in air have been investigated and compared with those of type K thermocouples by Burley [16], by Burley and others [13,44-47], by Wang and Starr [17,43,48,49], by McLaren and Murdock [33], by Bentley [19], and by Hess [50].

Type N thermocouples, in general, are subject to the same environmental restrictions as types E and K. They are not recommended for use at high temperatures in sulfurous, reducing, or alternately oxidizing and reducing atmospheres unless suitably protected with protecting tubes. They also should not be used in vacuum (at high temperatures) for extended times because the chromium and silicon in the positive thermoelement, a nickel-chromium-silicon alloy, vaporize out of solution and alter the calibration. In addition, their use in atmospheres with low, but not negligible, oxygen content is not recommended, since it can lead to changes in calibration due to the preferential oxidation of chromium in the positive thermoelement. Nevertheless, Wang and Starr [49] studied the performances of type N thermocouples in reducing atmospheres, as well as in stagnant air, at temperatures in the 870°C to 1180°C range and found them to be markedly more stable thermoelectrically than type K thermocouples under similar conditions.

The performance of type N thermocouples fabricated in metal-sheathed, compacted ceramic insulated form also has been the subject of considerable study. Anderson and others [51], Bentley and Morgan [52], and Wang and Bediones [53] have evaluated the high-temperature, thermoelectric stability of thermocouples insulated with magnesium oxide and sheathed in Inconel and in stainless steel. Their studies showed that the thermoelectric instabilities of such assemblies increase rapidly with temperature above 1000°C. It was found also that the smaller the diameter of the sheath the greater the instability. Additionally, thermocouples sheathed in Inconel showed substantially less instability above 1000°C than those sheathed in stainless steel. Bentley and Morgan [52] stressed the importance of using Inconel sheathing with a very low manganese content to achieve the most stable performance. The use of special Ni-Cr based alloys for sheathing to improve the chemical and physical compatibility with the thermoelements also has been investigated by Burley [54-56] and by Bentley [57-60].

Neither thermoelement of a type N thermocouple is extremely sensitive to minor differences in heat treatment (provided that the treatment does not

violate any of the restrictions mentioned above). For most general applications, they may be used with the heat treatment routinely given by the wire manufacturer. Bentley [61,62], however, has reported reversible changes in the Seebeck coefficient of type NP and NN thermoelements when heated at temperatures between 200°C and 1000°C. These impose limitations on the accuracy obtainable with type N thermocouples. The magnitude of such changes was found to depend on the source of the thermoelements. Consequently, when the highest accuracy and stability are sought, selective testing of materials, as well as special preparatory heat treatments beyond those given by the manufacturer, will usually be necessary. Bentley's articles [61,62] should be consulted for guidelines and details.

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type N commercial thermocouples be ±2.2°C or ±0.75 percent (whichever is greater) between 0°C and 1250°C. Type N thermocouples can also be supplied to meet special tolerances that are equal to approximately one-half the standard tolerances given above. Tolerances are not specified for type N thermocouples below 0°C.

The suggested upper temperature limit of 1260°C given in the ASTM standard [7] for protected type N thermocouples applies to AWG 8 (3.25 mm) wire. It decreases to 1090°C for AWG 14 (1.63 mm), 980°C for AWG 20 (0.81 mm), 870°C for AWG 24 or 28 (0.51 mm or 0.33 mm), and 760°C for AWG 30 (0.25 mm). These temperature limits apply to thermocouples used in conventional closed-end protecting tubes and they are intended only as a rough guide to the user. They do not apply to thermocouples having compacted mineral oxide insulation.

Type R Thermocouples

This section describes Platinum-13 percent Rhodium Alloy Versus Platinum thermocouples, called type R thermocouples. This type is often referred to by the nominal chemical composition of its positive (RP) thermoelement: platinum-13 percent rhodium. The negative (RN) thermoelement is commercially-available platinum that has a nominal purity of 99.99 percent [21]. An industrial consensus standard (ASTM E1159-87) specifies that rhodium having a nominal purity of 99.98 percent shall be alloyed with platinum of 99.99 percent purity to produce the positive thermoelement, which typically contains 13.00 ± 0.05 percent rhodium by weight. This consensus standard [21] describes the purity of commercial type R materials that are used in many industrial thermometry applications and that meet the calibration tolerances described later in this section. It does not cover, however, the higher-purity, reference-grade materials that traditionally were used to construct thermocouples used as transfer standards and reference thermometers in various laboratory applications and to develop reference functions and tables [22,23]. The higher purity alloy material typically contains less than 500 atomic ppm of impurities and the platinum less than 100 atomic ppm of impurities [22].

Differences between such high purity commercial material and the platinum thermoelectric reference standard, Pt-67, are described in [22] and [23].

A reference function for the type R thermocouple, based on the ITS-90 and the SI volt, was determined recently from new data obtained in a collaborative effort by NIST and NPL. The results of this international collaboration were reported by Burns et al [23]. The function was used to compute the reference table given in this monograph.

Type R thermocouples have about a 12 percent larger Seebeck coefficient than do Type S thermocouples over much of the range. Type R thermocouples were not standard interpolating instruments on the IPTS-68 for the 630.74°C to gold freezing-point range. Other than these two points, and remarks regarding history and composition, all of the precautions and restrictions on usage given in the section on type S thermocouples also apply to type R thermocouples. Glawe and Szaniszlo [24], and Walker et al [25,26] have determined the effects that prolonged exposure at elevated temperatures (>1200°C) in vacuum, air, and argon atmospheres have on the thermoelectric voltages of type R thermocouples.

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type R commercial thermocouples be ±1.5°C or ±0.25 percent (whichever is greater) between 0°C and 1450°C. Type R thermocouples can be supplied to meet special tolerances of ±0.6°C or ±0.1 percent (whichever is greater).

The suggested upper temperature limit, 1480°C, given in the ASTM standard [7] for protected type R thermocouples applies to AWG 24 (0.51 mm) wire. This temperature limit applies to thermocouples used in conventional closed-end protecting tubes and it is intended only as a rough guide to the user. It does not apply to thermocouples having compacted mineral oxide insulation.

Type S Thermocouples

This section describes Platinum-10 percent Rhodium Alloy Versus Platinum thermocouples, commonly known as type S thermocouples. This type is often referred to by the nominal chemical composition of its positive (SP) thermoelement: platinum-10 percent rhodium. The negative (SN) thermoelement is commercially available platinum that has a nominal purity of 99.99 percent [21]. An industrial consensus standard (ASTM E1159-87) specifies that rhodium having a nominal purity of 99.98 percent shall be alloyed with platinum of 99.99 percent purity to produce the positive thermoelement, which typically contains 10.00 ± 0.05 percent rhodium by weight. The consensus standard [21] describes the purity of commercial type S materials that are used in many industrial thermometry applications and that meet the calibration tolerances described later in this section. It does not cover, however, the higher-purity, reference-grade

materials that traditionally were used to construct thermocouples used as standard instruments of the IPTS-68, as transfer standards and reference thermometers in various laboratory applications, and to develop reference functions and tables [27,28]. The higher purity alloy material typically contains less than 500 atomic ppm of impurities and the platinum less than 100 atomic ppm of impurities [27]. Difference between such high purity commercial material and the platinum thermoelectric reference standard, Pt-67, are described in [27] and [28].

A reference function for the type S thermocouple, based on the ITS-90 and the SI volt, was determined recently from new data obtained in an international collaborative effort involving eight national laboratories. The results of this international collaboration were reported by Burns et al. [28]. The new function was used to compute the reference table given in this monograph.

Research [27] demonstrated that type S thermocouples can be used from -50°C to the platinum melting-point temperature. They may be used intermittently at temperatures up to the platinum melting point and continuously up to about 1300°C with only small changes in their calibrations. The ultimate useful life of the thermocouples when used at such elevated temperatures is governed primarily by physical problems of impurity diffusion and grain growth, which lead to mechanical failure. The thermocouple is most reliable when used in a clean oxidizing atmosphere (air) but may be used also in inert gaseous atmospheres or in a vacuum for short periods of time. However, type B thermocouples are generally more suitable for such applications above 1200°C. Type S thermocouples should not be used in reducing atmospheres, nor in those containing metallic vapor (such as lead or zinc), nonmetallic vapors (such as arsenic, phosphorus, or sulfur) or easily reduced oxides, unless they are suitably protected with nonmetallic protecting tubes. Also, they should never be inserted directly into a metallic protection tube for use at high temperatures. The stability of type S thermocouples at high temperatures (>1200°C) depends primarily upon the quality of the materials used for protection and insulation, and has been studied by Walker et al. [25,26] and by Bentley [29]. High purity alumina, with low iron content, appears to be the most suitable material for insulating, protecting, and mechanically supporting the thermocouple wires.

Both thermoelements of type S thermocouples are sensitive to impurity contamination. In fact, type R thermocouples were developed essentially because of iron contamination effects in some British platinum-10 percent rhodium wires. The effects of various impurities on the thermoelectric voltages of platinum based thermocouple materials have been described by Rhys and Taimsalu [35], by Cochrane [36] and by Aliotta [37]. Impurity contamination usually causes negative changes [25,26,29] in the thermoelectric voltage of the thermocouple with time, the extent of which will depend upon the type and amount of chemical contaminant. Such changes were shown to be due mainly to the platinum thermoelement [25,26,29]. Volatilization of the rhodium from the positive thermoelement

for the vapor transport of rhodium from the positive thermoelement to the pure platinum negative thermoelement also will cause negative drifts in the thermoelectric voltage. Bentley [29] demonstrated that the vapor transport of rhodium can be virtually eliminated at 1700°C by using a single length of twin-bore tubing to insulate the thermoelements and that contamination of the thermocouple by impurities transferred from the alumina insulator can be reduced by heat treating the insulator prior to its use.

McLaren and Murdock [30-33] and Bentley and Jones [34] thoroughly studied the performance of type S thermocouples in the range 0°C to 1100°C. They described how thermally reversible effects, such as quenched-in point defects, mechanical stresses, and preferential oxidation of rhodium in the type SP thermoelement, cause chemical and physical inhomogeneities in the thermocouple and thereby limit its accuracy in this range. They emphasized the important of annealing techniques.

The positive thermoelement is unstable in a thermal neutron flux because the rhodium converts to palladium. The negative thermoelement is relatively stable to neutron transmutation. Fast neutron bombardment, however, will cause physical damage, which will change the thermoelectric voltage unless it is annealed out.

At the gold freezing-point temperature, 1064.18°C, the thermoelectric voltage of type S thermocouples increases by about 340uV (about 3 percent) per weight percent increase in rhodium content; the Seebeck coefficient increases by about 4 percent per weight percent increase at the same temperature.

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type S commercial thermocouples be ±1.5°C or ±0.25 percent (whichever is greater) between 0°C and 1450°C. Type S thermocouples can be supplied to meet special tolerances of ±0.6°C or ±0.1 percent (whichever is greater).

The suggested upper temperature limit, 1480°C, given in the ASTM standard [7] for protected type S thermocouples applies to AWG 24 (0.51 mm) wire. This temperature limit applies to thermocouples used in conventional closed-end protecting tubes and it is intended only as a rough guide to the user. It does not apply to thermocouples having compacted mineral oxide insulation.

Type T Thermocouples

This section describes Copper Versus Copper-Nickel Alloy thermocouples, called type T thermocouples. This type is one of the oldest and most popular thermocouples for determining temperatures within the range from about 370°C down to the triple point of neon (-248.5939°C). Its positive thermoelement, TP, is typically copper of high electrical conductivity and low oxygen content that conforms to ASTM Specification

B3 for soft or annealed bare copper wire. Such material is about 99.95 percent pure copper with an oxygen content varying from 0.02 to 0.07 percent (depending upon sulfur content) and with other impurities totaling about 0.01 percent. Above about -200°C, the thermoelectric properties of type TP thermoelements, which satisfy the above conditions, are exceptionally uniform and exhibit little variation between lots. Below about -200°C the thermoelectric properties are affected more strongly by the presence of dilute transition metal solutes, particularly iron.

The negative thermoelement, TN or EN, is a copper-nickel alloy known ambiguously as constantan. The word constantan refers to a family of copper-nickel alloys containing anywhere from 45 to 60 percent copper. These alloys also typically contain small percentages of cobalt, manganese and iron, as well as trace impurities of other elements such as carbon, magnesium, silicon, etc. The constantan for type T thermocouples usually contains about 55 percent copper, 45 percent nickel, and small but thermoelectrically significant amounts, about 0.1 percent or larger, of cobalt, iron, or manganese. It should be emphasized that type TN (or EN) thermoelements are NOT generally interchangeable with type JN thermoelements although they are all referred to as “constantan”. In order to provide some differentiation in nomenclature, type TN (or EN) is often referred to as Adams’ (or RP1080) constantan and type JN is usually referred to as SAMA constantan.

The thermoelectric relations for type TN and type EN thermoelements are the same, that is the voltage versus temperature equations and tables for platinum versus type TN thermoelements apply to both types of thermoelements over the temperature range recommended for each thermocouple type. However, if should not be assumed that type TN and type EN thermoelements may be used interchangeably or that they have the same commercial initial calibration tolerances.

The low temperature research [8] by members of the NBS Cryogenics Division showed that the type T thermocouple may be used down to liquid helium temperatures (about 4K) but that its Seebeck coefficient becomes quite small below 20K. Its Seebeck coefficient at 20K is only about 5.6μV/K, being roughly two-thirds that of the type E thermocouple. The thermoelectric homogeneity of most type TP and type TN (or EN) thermoelements is reasonably good. There is considerable variability, however, in the thermoelectric properties of type TP thermoelements below about 70K caused by variations in the amounts and types of impurities present in these nearly pure materials. The high thermal conductivity of the type TP thermoelements can also be troublesome in precise applications. For these reasons, type T thermocouples are generally unsuitable for use below about 20K. Type E thermocouples are recommended as the most suitable of the letter-designated thermocouple types for general low-temperature use, since they offer the best overall combination of desirable properties.

Type T thermocouples are recommended by the ASTM [5] for use in the temperature range from -200°C to 370°C in vacuum or in oxidizing, reducing or inert atmospheres. The suggested upper temperature limit for continuous service of protected type T thermocouples is set at 370°C for AWG 14 (1.63 mm) thermoelements since type TP thermoelements oxidize rapidly above this temperature. However, the thermoelectric properties of type TP thermoelements are apparently not grossly affected by oxidation since negligible changes in the thermoelectric voltage were observed at NBS [10] for AWG 12, 18, and 22 type TP thermoelements during 30 hours of heating in air at 500°C. At this temperature the type TN thermoelements have good resistance to oxidation and exhibit only small voltage changes heated in air for long periods of time, as shown by the studies of Dahl [11]. Higher operating temperatures, up to at least 800°C, are possible in inert atmospheres where the deterioration of the type TP thermoelement is no longer a problem. The use of type T thermocouples in hydrogen atmospheres at temperatures above about 370°C is not recommended since type TP thermoelements may become brittle.

Type T thermocouples are not well suited for use in nuclear environments since both thermoelements are subject to significant changes in composition under thermal neutron irradiation. The copper in the thermoelements is converted to nickel and zinc.

Because of the high thermal conductivity of type TP thermoelements, special care should be exercised when using the thermocouples to ensure that the measuring and reference junctions assume the desired temperatures.

ASTM Standard E230-87 in the 1992 Annual Book of ASTM Standards [7] specifies that the initial calibration tolerances for type T commercial thermocouples be ±1°C or ±0.75 percent (whichever is greater) between 0°C and 350°C, and ±1°C or ±1.5 percent (whichever is greater) between -200°C and 0°C. Type T thermocouples can also be supplied to meet special tolerances which are equal to approximately one-half the standard tolerances given above. Type T thermocouple materials are normally supplied to meet the tolerances specified for temperatures above 0°C. However, the same materials may not satisfy the tolerances specified for the -200°C to 0°C range. If materials are required to meet the tolerances below 0°C, this should be specified when they are purchased.

The suggested upper temperature limit of 370°C given in the ASTM standard [7] for protected type T thermocouples applies to AWG 14 (1.63 mm) wire. It decreases to 260°C for AWG 20 (0.81 mm), 200°C for AWG 24 or 28 (0.51 mm or 0.33 mm), and 150°C for AWG 30 (0.25 mm). These temperature limits apply to thermocouples used in conventional closed-end protecting tubes and they are intended only as a rough guide to the user. They do not apply to thermocouples having compacted mineral oxide insulation.

References

[1] Preston-Thomas, H. The International Temperature Scale of 1990 (ITS-90). *Metrologia* 27, 3-10; 1990. *ibid*. p. 107.

[2] The International Practical Temperature Scale of 1968, Amended Edition of 1975. *Metrologia* 12, 7-17, 1976.

[3] Mangum, B. W.; Furukawa, G. T. Guidelines for realizing the International Temperature Scale of 1990 (ITS-90). *Natl. Inst. Stand. Technol. Tech. Note 1265*; 1990 August. 190 p.

[4] The 1976 Provisional 0.5 to 30 K Temperature Scale. *Metrologia* 15, 65-68; 1979.

[5] ASTM, American Society for Testing and Materials. Manual on the use of thermocouples in temperature measurement. *Special Tech. Publ. 470B*; edited by Benedict, R. P.; Philadelphia: ASTM; 1981. 258p.

[6] Hansen, M.; Anderko, K. Constitution of binary alloys. New York: McGraw-Hill Book Co.; 1958.

[7] ASTM, American Society for Testing and Materials, Standard E230-87, *1992 Annual Book of ASTM Standards*. Vol. 14.03; Philadelphia: ASTM; 1992. 102-230.

[8] Sparks, L. L.; Powell, R. L.; Hall, W. J. Reference tables for low-temperature thermocouples. *Natl. Bur. Stand. (U.S.) Monogr. 124;* 1972 June. 61p.

[9] Starr, C.D.; Wang, T. P. Effect of oxidation on stability of thermocouples, *Proceedings of the American Society for Testing and Materials* Vol. 63, 1185-1194; 1963.

[10] Roeser, W. F.; Dahl, A. I. Reference tables for iron-constantan and copper-constantan thermocouples. *J. Res. Natl. Bur. Stand. (U.S.)* 20, 337-355; RP1080; 1938 March.

[11] Dahl, A. I. Stability of base-metal thermocouples in air from 800 to 2200°F. *J. Res. Natl. Bur. Stand. (U.S.)* 24, 205-224; RP1278; 1940 February.

[12] Sparks, L. L.; Powell, R. L. Low temperatures thermocouples: KP, "normal" silver, and copper versus Au-0.02 at % Fe and Au-0.07 at % Fe. *J. Res. Natl. Bur. Stand. (U.S.)* 76A(3), 263-283; 1972 May-June.

[13] Burley, N. A.; Hess, R. M.; Howie, C. F.; Coleman, J. A. The nicrosil versus nisil thermocouple: A critical comparison with the ANSI standard letter-designated base-metal thermocouples. *Temperature: Its Measurement and Control in Science and Industry*; Vol. 5, Schooley, J. F., ed.; New York: American Institute of Physics; 1982. 1159-1166.

[14] Potts, J. F. Jr.; McElroy, D. L. The effects of cold working, heat treatment, and oxidation on the thermal emf of nickel-base thermoelements. Herzfeld, C. M.; Brickwedde, F. G.; Dahl, A. I.; Hardy, J. D., ed. *Temperature: Its Measurement and Control in Science and Industry;* Vol. 3, Part 2; New York: Reinhold Publishing Corp.; 1962. 243-264.

[15] Burley, N. A.; Ackland, R. G. The stability of the thermo-emf/ temperature characteristics of nickel-base thermocouples. *Jour. of Australian Inst. of Metals* 12(1), 23-31; 1967.

[16] Burley, N. A. Nicrosil and nisil: Highly stable nickel-base alloys for thermocouples. *Temperature: Its Measurement and Control in Science and Industry;* Vol. 4, Plumb, H. H., ed.; Pittsburgh: Instrument Society of America; 1972. 1677-1695.

[17] Wang, T. P.; Starr, C. D. Electromotive force stability of nicrosil-nisil. *Journal of Testing and Evaluation* 8(4), 192-198; 1980.

[18] Starr, C. D.; Wang, T. P. Effect of oxidation on stability of thermocouples, *Proceedings of the American Society for Testing and Materials* Vol. 63 1185-1194; 1963.

[19] Bentley, R. E. Short-term instabilities in thermocouples containing nickel-based alloys. *High Temperatures- High Pressures* 15, 599-611; 1983.

[20] Kollie, T. G.; Horton, J. L.; Carr, K. R.; Herskovitz, M. B.; Mossman, C. A. Temperature measurement errors with type K (Chromel vs. Alumel) thermocouples due to short-ranged ordering in Chromel. *Rev. Sci. Instrum.* 46, 1447-1461; 1975.

[21] ASTM, American Society for Testing and Materials, Standard E1159-87, *1992 Annual Book of ASTM Standards.* Vol. 14.03; Philadelphia: ASTM; 1992. 388-389.

[22] Bedford, R. E.; Ma, C. K.; Barber, C. R.; Chandler, T. R.; Quinn, T. J.; Burns, G. W.; Scroger, M. New reference tables for platinum 10% rhodium/platinum and platinum 13% rhodium/platinum thermocouples. *Temperature: Its Measurement and Control in Science and Industry;* Vol. 4, Part 3, p. 1585; Plumb, H. H., ed.; Pittsburgh: Instrument Society of America; 1972.

[23] Burns, G. W.; Strouse, G. F.; Mangum, B. W.; Croarkin, M. C.; Guthrie, W. F.; Chattle, M. New reference functions for platinum-13% rhodium versus platinum (type R) and platinum-30% rhodium versus platinum-6% rhodium (type B) thermocouples based on the ITS-90. in *Temperature: Its Measurement and Control in Science and Industry;* Vol. 6; Schooley, J. F., ed.; New York: American Institute of Physics; 1992. 559-564.

[24] Glawe, G. E.; Szaniszlo, A. J. Long-term drift of some noble- and refractory-metal thermocouples at 1600K in air, argon, and vacuum. *Temperature: Its Measurement and Control in Science and Industry;* Vol. 4; Plumb, H. H., ed.; Pittsburgh: Instrument Society of America; 1972. 1645-1662.

[25] Walker, B. E.; Ewing, C. T.; Miller, R. R. Thermoelectric instability of some noble metal thermocouples at high temperatures. *Rev. Sci. Instrum.* 33, 1029-1040; 1962.

[26] Walker, B. E.; Ewing, C. T.; Miller, R. R. Study of the instability of noble metal thermocouples in vacuum. *Rev. Sci. Instrum.* 36, 601-606; 1965.

[27] Bedford, R. E.; Ma, C. K.; Barber, C. R.; Chandler, T. R.; Quinn, T. J.; Burns, G. W.; Scroger, M. New reference tables for platinum 10% rhodium/platinum and platinum 13% rhodium/platinum thermocouples. *Temperature: Its Measurement and Control in Science and Industry;* Vol. 4; Plumb, H. H., ed.; Pittsburgh: Instrument Society of America; 1972. 1585-1603.

[28] Burns, G. W.; Strouse, G. F.; Mangum, B. W.; Croarkin, M. C.; Guthrie, W. F.; Marcarino, P.; Battuello, M.; Lee, H. K.; Kim, J. C.; Gam, K. S.; Rhee, C.; Chattle, M.; Arai, M.; Sakurai, H.; Pokhodun, A. I.; Moiseeva, N. P.; Perevalova, S. A.; de Groot, M. J.; Zhang, J.; Fan, K.; Wu, S. New reference functions for platinum-10% rhodium versus platinum (type S) thermocouples based on the ITS-90, Part I and Part II. in Temperature: Its Measurement and Control *in Science and Industry;* Vol. 6; Schooley, J. F., ed.; New York: American Institute of Physics; 1992. 537-546.

[29] Bentley, R. E. Changes in Seebeck coefficient of Pt and Pt 10% Rh after use to 1700C in high-purity polycrystalline alumina. *Int. J. Thermophys.* 6(1), 83-99; 1985.

[30] McLaren, E. H.; Murdock, E. G. New considerations on the preparation, properties and limitations of the standard thermocouple for thermometry. *Temperature: Its Measurement and Control in Science and Industry*; Vol. 4; Plumb, H. H., ed.; Pittsburgh: Instrument Society of America; 1972. 1543-1560.

[31] McLaren, E. H.; Murdock, E. G. The properties of Pt/PtRh thermocouples for thermometry in the range 0-1100°C: I. Basic measurements with standard thermocouples. *National Research Council of Canada Publication APH 2212/NRCC 17407*; 1979.

[32] McLaren, E. H.; Murdock, E. G. The properties of Pt/PtRh thermocouples for thermometry in the range 0-1100°C: II. Effect of heat treatment on standard thermocouples. *National Research Council of Canada Publication APH 2213/NRCC 17408*; 1979.

[33] McLaren, E. H.; Murdock, E. G. Properties of some noble and base metal thermocouples at fixed points in the range 0-1100°C. *Temperature: Its Measurement and Control in Science and Industry*; Vol. 5; Schooley, J. F., ed.; New York: American Institute of Physics; 1982. 953-975.

[34] Bentley, R. E.; Jones, T. P. Inhomogeneities in type S thermocouples when used to 1064°C. *High Temperatures- High Pressures* 12, 33-45; 1980.

[35] Rhys, D. W.; Taimsalu, P. Effect of alloying additions on the thermoelectric properties of platinum. *Engelhard Tech. Bull.* 10, 41-47; 1969.

[36] Cochrane, J. Relationship of chemical composition to the electrical properties of platinum. *Engelhard Tech. Bull.* 11, 58-71; 1969. Also in *Temperature: Its Measurement and Control in Science and Industry;* Vol. 4; Plumb, H. H., ed.; Pittsburgh: Instrument Society of America; 1972. 1619-1632.

[37] Aliotta, J. Effects of impurities on the thermoelectric properties of platinum. *Inst. and Control Systems,* 106-107; March 1972.

[38] Burns, G. W.; Gallagher, J. S. Reference tables for the Pt-30 percent Rh versus Pt-6 percent Rh thermocouple. *J. Res. Natl. Bur. Stand. (U.S.)* 70C, 89-125; 1966.

[39] Ehringer, H. Uber die lebensdauer von PtRh-thermoelementen. *Metall* 8, 596-598; 1954.

[40] Acken, J. S. Some properties of platinum-rhodium alloys. *J. Res. Natl. Bur. Stand. (U.S.)* 12, 249; RP650; 1934.

[41] Hendricks, J. W.; McElroy, D. L. High temperature- high vacuum thermocouple drift tests. *Environmental Quarterly,* 34-38; March 1967.

[42] Zysk, E. D. Platinum metal thermocouples. *Temperature: Its Measurement and Control in Science and Industry;* Vol. 3; Herzfeld, C. M., ed.; New York: Reinhold Publishing Corp.; 1962. Part 2, pp. 135-156.

[43] Starr, C. D.; Wang, T. P. A new stable nickel-base thermocouple. *Journal of Testing and Evaluation* 4(1), 42-56; 1976.

[44] Burley, N. A.; Powell, R. L.; Burns, G. W.; Scroger, M. G. The nicrosil versus nisil thermocouple: properties and thermoelectric reference data. *Natl. Bur. Stand. (U.S.) Monogr. 161;* 1978 April. 167p.

[45] Burley, N. A.; Jones, T. P. Practical performance of nicrosil-nisil thermocouples. *Temperature Measurement, 1975;* Billing, B. F.; Quinn, T. J., ed.; London and Bristol: Institute of Physics; 1975. 172-180.

[46] Burley, N. A.; Hess, R. M.; Howie, C. F. Nicrosil and nisil: new nickel-based thermocouple alloys of ultra-high thermoelectric stability. *High Temperatures- High Pressures* 12, 403-410; 1980.

[47] Burley, N. A.; Cocking, J. L.; Burns, G. W.; Scroger, M. G. The nicrosil versus nisil thermocouple: the influence of magnesium on the thermoelectric stability and oxidation resistance of the alloys. *Temperature: Its Measurement and Control in Science and Industry*; Vol. 5, Schooley, J. F., ed.; New York: American Institute of Physics; 1982. 1129-1145.

[48] Wang, T. P.; Starr, C. D. Nicrosil-nisil thermocouples in production furnaces in the 538°C (1000°F) to 1177°C (2150°F) range. *ISA Transactions* 18(4), 83-99; 1979.

[49] Wang, T. P.; Starr, C. D. Oxidation resistance and stability of nicrosil-nisil in air and in reducing atmospheres. *Temperature: Its Measurement and Control in Science and Industry*; Vol. 5, Schooley, J. F., ed.; New York: American Institute of Physics; 1982. 1147-1157.

[50] Hess, T. G. Nicrosil-nisil: high-performance thermocouple alloys. *ISA Transactions* 16(3), 81-84; 1977.

[51] Anderson, R. L.; Lyons, J. D.; Kollie, T. G.; Christie, W. H.; Eby, R. Decalibration of sheathed thermocouples. *Temperature: Its Measurement and Control in Science and Industry*; Vol. 5., Schooley, J. F., ed.; New York: American Institute of Physics; 1982. 977-1007.

[52] Bentley, R. E.; Morgan, T. L. Ni-based thermocouples in the mineral-insulated metal-sheathed format: thermoelectric instabilities to 1100°C. *J. Phys. E: Sci. Instrum.* 19, 262-268; 1986.

[53] Wang, T. P.; Bediones, D. 10,000 hr. stability test of types K, N, and a Ni-Mo/Ni-Co thermocouple in air and short-term tests in reducing atmospheres. *Temperature: Its Measurement and Control in Science and Industry;* Vol. 6; Schooley, J. F., ed.; New York: American Institute of Physics; 1992. 595-600.

[54] Burley, N. A. N-CLAD-N: A novel advanced type N integrally-sheathed thermocouple of ultra-high thermoelectric stability. *High Temperatures- High Pressures* 8, 609-616; 1986.

[55] Burley, N. A. A novel advanced type N integrally-sheathed thermocouple of ultra-high thermoelectric stability. *Thermal and Temperature Measurement in Science and Industry*; 3rd Int. IMEKO Conf.; Sheffield; Sept. 1987. 115-125.

[56] Burley, N. A. "N-CLAD-N" A novel integrally sheathed thermocouple: optimum design rationale for ultra-high thermoelectric stability. T*emperature: Its Measurement and Control in Science and Industry*; Vol.

6; Schooley, J. F., ed.; New York: American Institute of Physics; 1992. 579-584.

[57] Bentley, R. E. The new nicrosil-sheathed type N MIMS thermocouple: an assessment of the first production batch. *Mater. Australas.* 18(6), 16-18; 1986.

[58] Bentley, R. E.; Russell, Nicrosil sheathed mineral-insulated type N thermocouple probes for short-term variable-immersion applications to 1100°C. *Sensors and Actuators* 16, 89-100; 1989.

[59] Bentley, R. E. Irreversible thermoelectric changes in type K and type N thermocouple alloys within nicrosil-sheathed MIMS cable. *J. Phys. D.* 22, 1908-1915; 1989.

[60] Bentley, R. E. Thermoelectric behavior of Ni-based ID-MIMS thermocouples using the nicrosil-plus sheathing alloy. *Temperature: Its Measurement and Control in Science and Industry*; Vol. 6; Schooley, J. F., ed.; New York: American Institute of Physics; 1992. 585-590.

[61] Bentley, R. E. Thermoelectric hysteresis in nicrosil and nisil. *J. Phys. E: Sci. Instrum.* 20, 1368-1373; 1987.

[62] Bentley, R. E. Thermoelectric hysteresis in nickel-based thermocouple alloys. *J. Phys. D.* 22, 1902-1907; 1989.

Using Thermocouple Junctions

This appendix describes the types of thermocouple junctions available, and explains the trade-offs in using them with the 1769-IT6 thermocouple/mV analog input module.

ATTENTION

Take care when choosing a thermocouple junction, and connecting it from the environment to the module. If you do not take adequate precautions for a given thermocouple type, the electrical isolation of the module might be compromised.

Available thermocouple junctions are:

- grounded
- ungrounded (isolated)
- exposed

Using a Grounded Junction Thermocouple

With a grounded junction thermocouple, the measuring junction is physically connected to the protective sheath, forming a completely sealed integral junction. If the sheath is metal (or electrically conductive), there is electrical continuity between the junction and sheath. The junction is protected from corrosive or erosive conditions. The response time approaches that of the exposed junction type described in Using an Exposed Junction Thermocouple on page D-3.

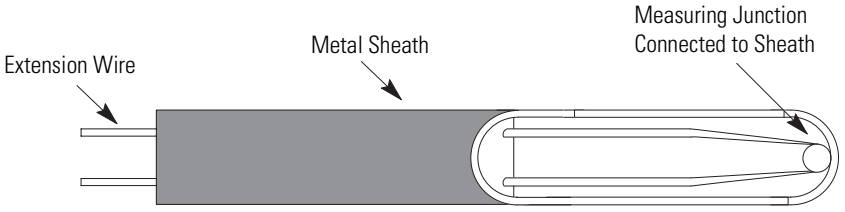

The shield input terminals for a grounded junction thermocouple are connected together and then connected to chassis ground. Use of this thermocouple with an electrically conductive sheath removes the thermocouple signal to chassis ground isolation of the module. In addition, if multiple grounded junction thermocouples are used, the module channel-to-channel isolation is removed, since there is no isolation between signal and sheath (sheaths are tied together). It should be noted that the isolation is removed even if the sheaths are connected to chassis ground at a location other than the module, since the module is connected to chassis ground.

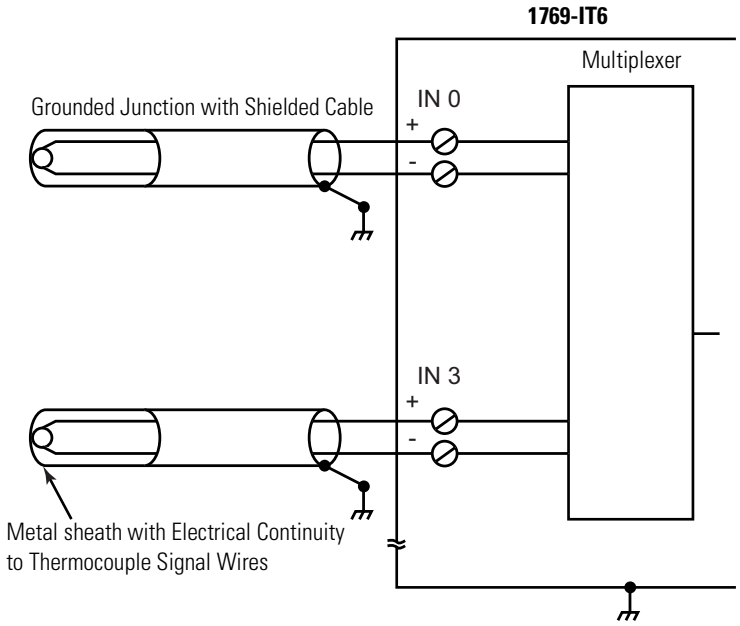

Rockwell Automation recommends that a grounded junction thermocouple have a protective sheath made of electrically insulated material (for example, ceramic). An alternative is to float the metal sheath with respect to any path to chassis ground or to another thermocouple metal sheath. Thus, the metal sheath must be insulated from electrically conductive process material, and have all connections to chassis ground broken. Note that a floated sheath can result in a less noise-immune thermocouple signal.

Using an Ungrounded (Isolated) Junction Thermocouple

An ungrounded (isolated) junction thermocouple uses a measuring junction that is electrically isolated from the protective metal sheath. This junction type is often used in situations when noise will affect readings, as well as situations using frequent or rapid temperature cycling. For this type of thermocouple junction, the response time is longer than for the grounded junction.

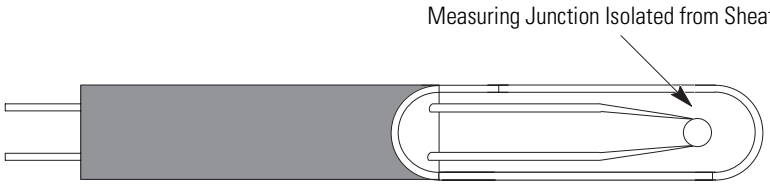

Using an Exposed Junction Thermocouple

An exposed junction thermocouple uses a measuring junction that does not have a protective metal sheath. A thermocouple with this junction type provides the fastest response time but leaves thermocouple wires unprotected against corrosive or mechanical damage.

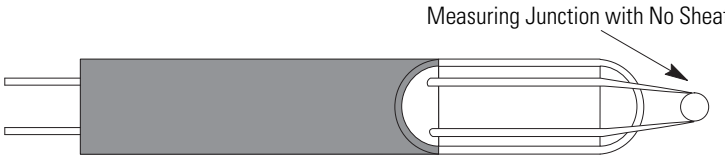

As shown in the next illustration, using an exposed junction thermocouple can result in removal of channel-to-channel isolation. Isolation is removed if multiple exposed thermocouples are in direct contact with electrically conductive process material.

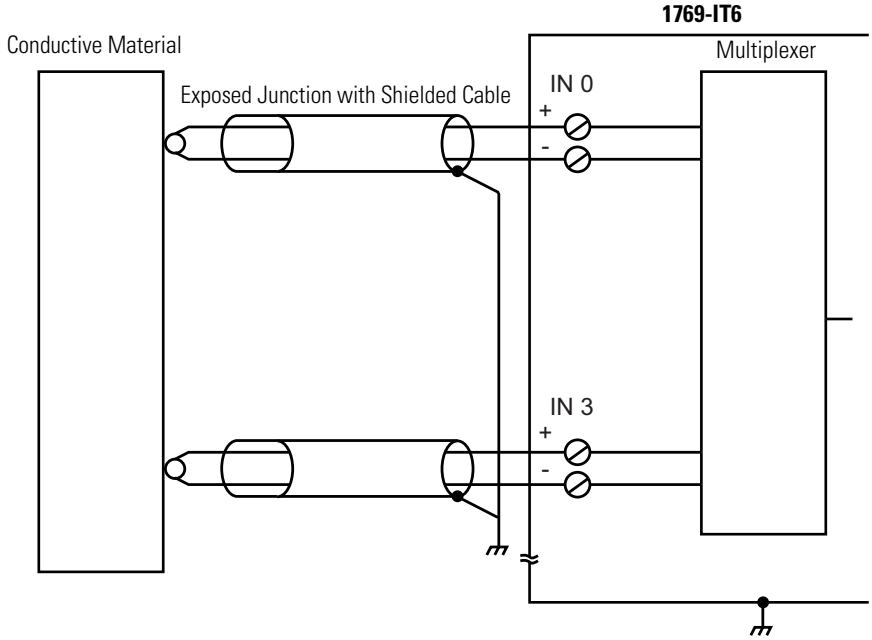

To prevent violation of channel-to-channel isolation:

- For multiple exposed junction thermocouples, do not allow the measuring junctions to make direct contact with electrically conductive process material.
- Preferably use a single exposed junction thermocouple with multiple ungrounded junction thermocouples.
- Consider using all ungrounded junction thermocouples instead of the exposed junction type.

Module Configuration Using MicroLogix 1500 and RSLogix 500

This appendix examines the 1769-IT6 module's addressing scheme and describes module configuration using RSLogix 500 and a MicroLogix 1500 controller.

Module Addressing

The following memory map shows the input and configuration image tables for the module. Detailed information on the image table is located in Chapter 4.

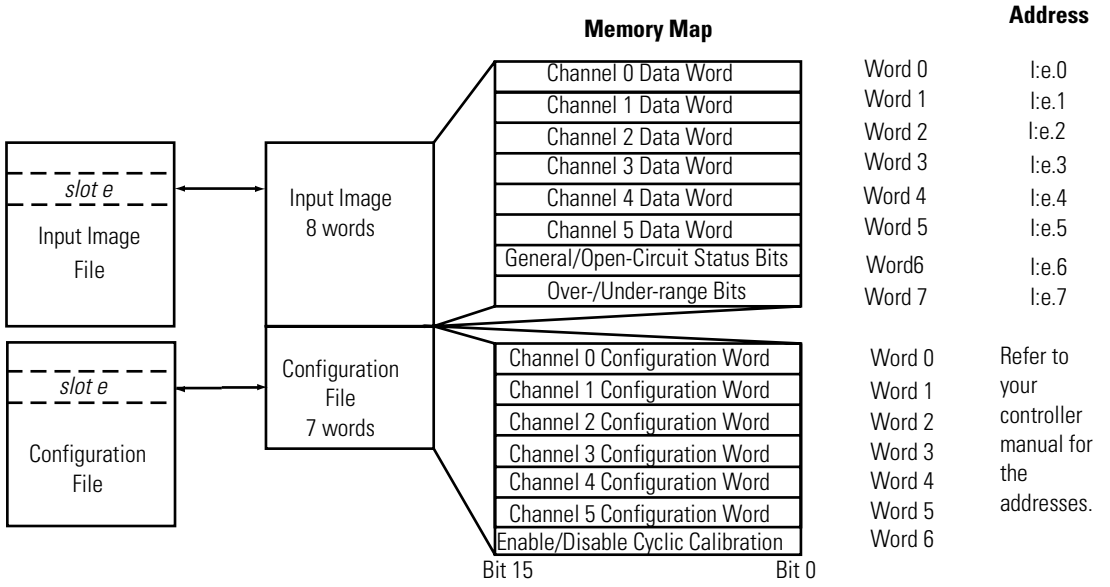

For example, to obtain the general status of channel 2 of the module located in slot e, use address I:e.6/2.

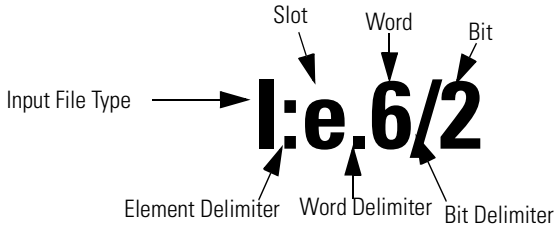

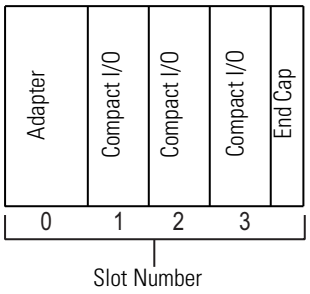

NOTE The end cap does not use a slot address.

1769-IT6 Configuration File

The configuration file contains information you use to define the way a specific channel functions. The configuration file is explained in more detail in Configuring Channels on page 4-4.

The configuration file is modified using the programming software configuration screen. For an example of module configuration using RSLogix 500, see Configuring the 1769-IT6 in a MicroLogix 1500 System on page E-3.

Table 5.1 Software Configuration Channel Defaults(1)

Parameter	Default Setting
Disable/Enable Channel	Disable
Filter Frequency	60 Hz
Input Type	Thermocouple Type J
Data Format	Raw/Proportional
Temperature Units	°C
Open-Circuit Response	Upscale
Disable Cyclic Calibration	Enable

(1) May be overridden by the software.

Configuring the 1769-IT6 in a MicroLogix 1500 System

This example takes you through configuring your 1769-IT6 thermocouple/mV input module with RSLogix 500 programming software, assumes your module is installed as expansion I/O in a MicroLogix 1500 system, and that RSLinx™ is properly configured and a communications link has been established between the MicroLogix processor and RSLogix 500.

Start RSLogix and create a MicroLogix 1500 application. The following screen appears:

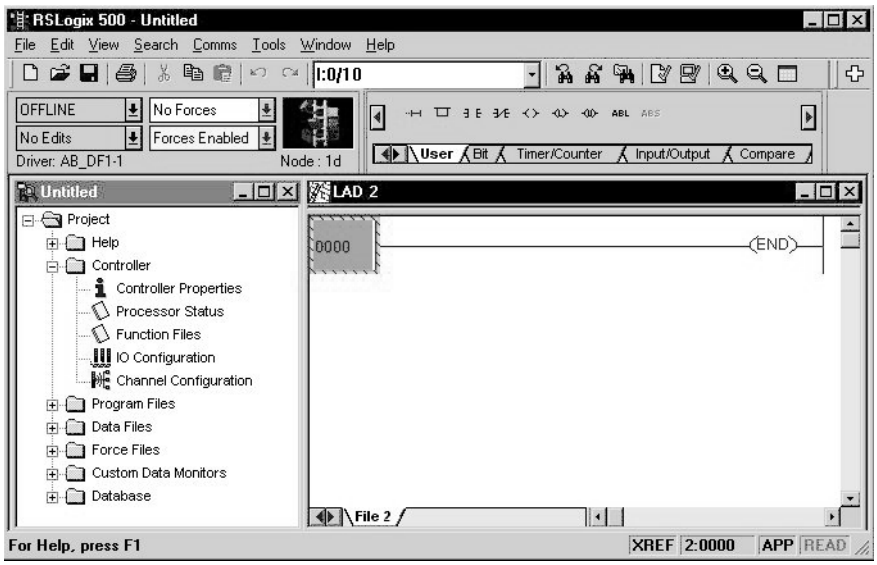

While offline, double-click on the IO Configuration icon under the controller folder and the following IO Configuration screen appears.

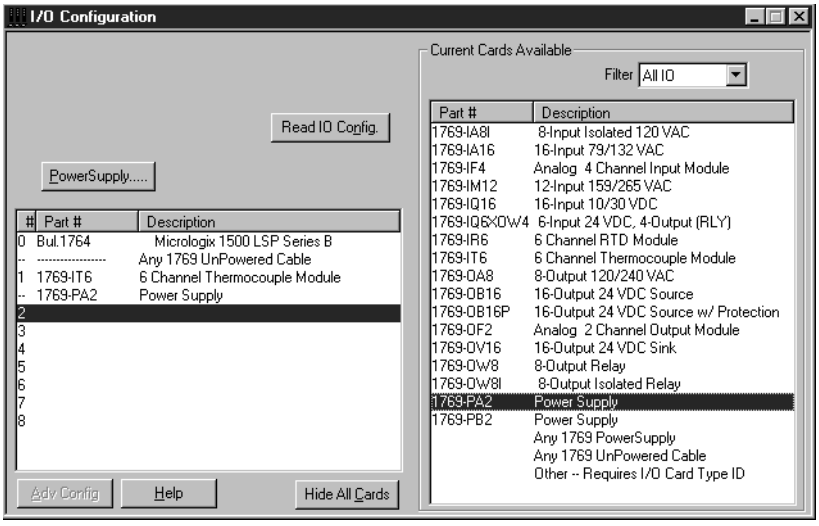

This screen allows you to manually enter expansion modules into expansion slots, or to automatically read the configuration of the controller. To read the existing controller configuration, click on the Read IO Config button.

A communications dialog appears, identifying the current communications configuration so that you can verify the target controller. If the communication settings are correct, click on Read IO Config.

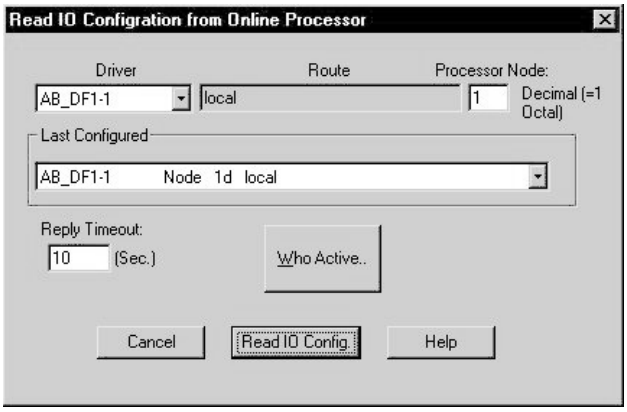

The actual I/O configuration is displayed. In this example, a second tier of I/O is attached to the MicroLogix 1500 processor.

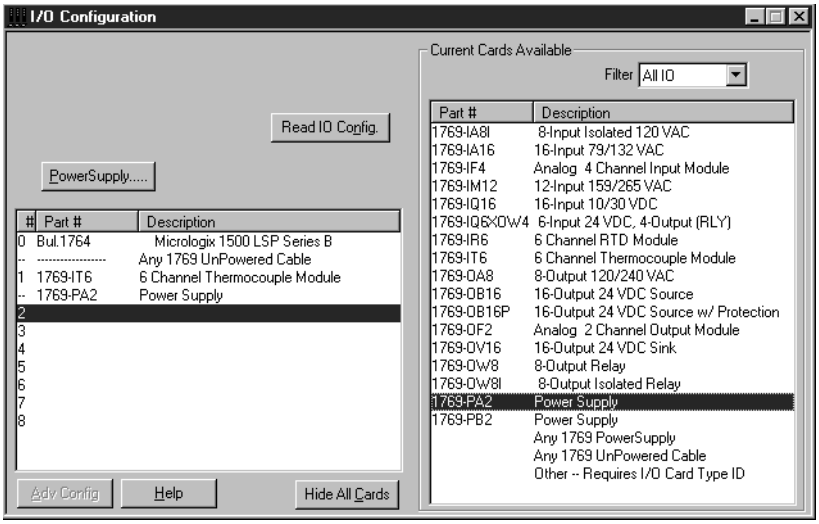

The 1769-IT6 module is installed in slot 1. To configure the module, double-click on the module/slot. The general configuration screen appears.

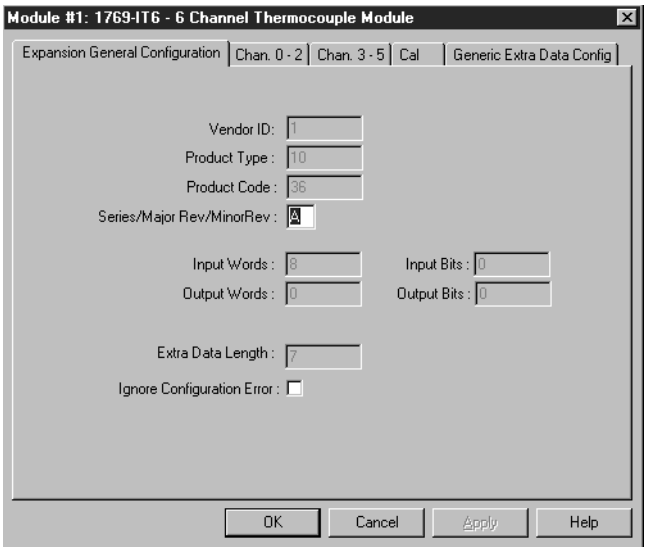

Configuration options for channels 0 to 2 are located on a separate tab from channels 3 to 5, as shown below. To enable a channel, click its Enable box so that a check mark appears in it. For optimum module performance, disable any channel that is not hardwired to a real input. Then, choose your Data Format, Input Type, Filter Frequency, Open Circuit response, and Units for each channel.

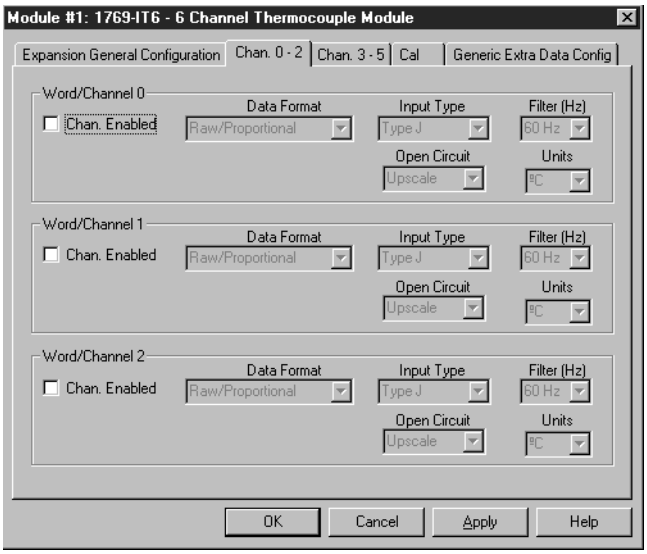

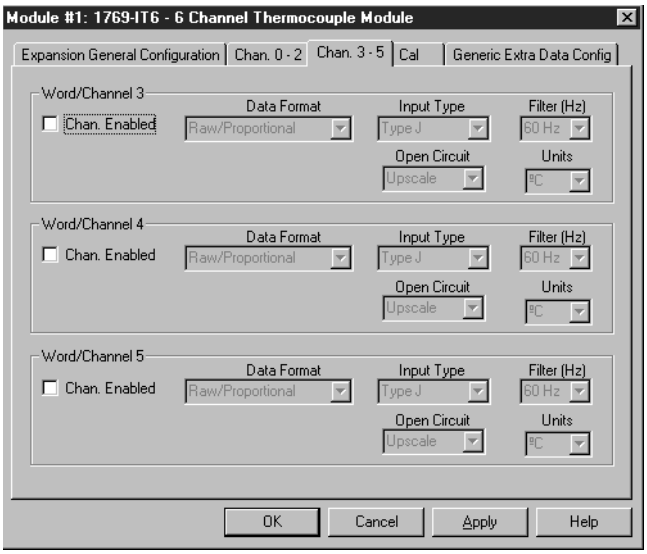

NOTE For a complete description of each of these parameters and the choices available for each of them, see Configuration Data File on page 4-5.

Configuring Cyclic Calibration

The Cal tab contains a check box for disabling cyclic calibration. See Selecting Enable/Disable Cyclic Calibration (Word 6, Bit 0) on page 4-14 for more information.

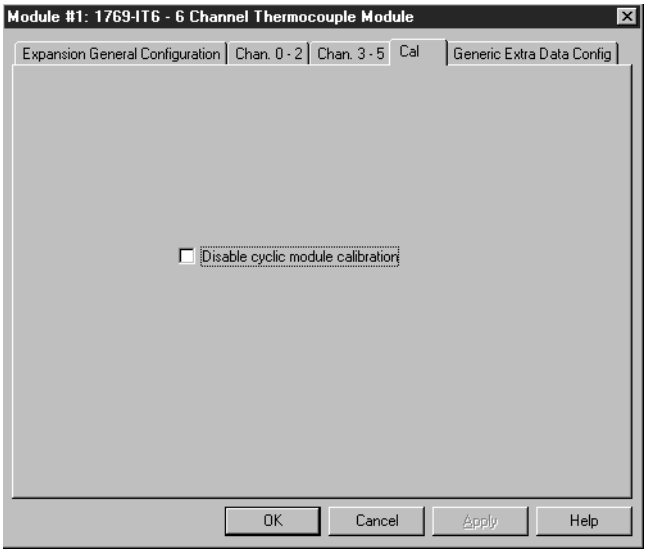

Generic Extra Data Configuration

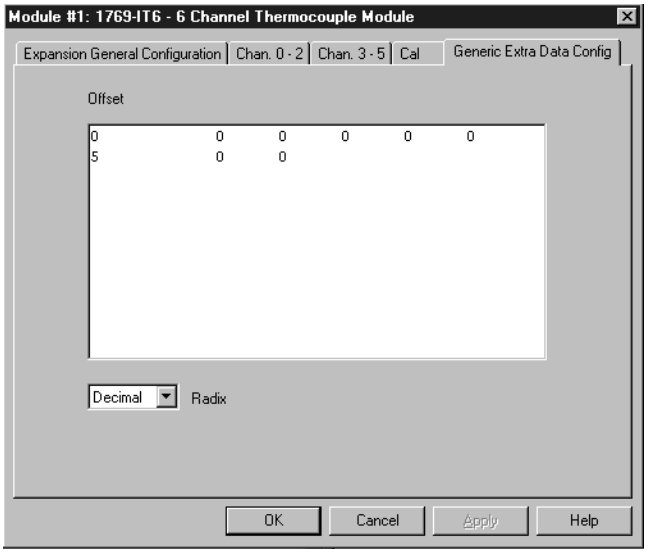

This tab redisplays the configuration information entered on the Analog Input Configuration screen in a raw data format. You have the option of entering the configuration using this tab instead of the configuration tabs. You do not have to enter data in both places.

Configuring Your 1769-IT6 Module with the Generic Profile for CompactLogix Controllers in RSLogix 5000

The procedure in this example is used only when your 1769-IT6 Thermocouple module profile is not available in RSLogix 5000 Programming Software. The initial release of the CompactLogix5320 controller includes the 1769 Generic I/O Profile, with individual 1769 I/O module profiles to follow.

To configure a 1769-IT6 Thermocouple module for a CompactLogix Controller using RSLogix 5000 with the 1769 Generic Profile, begin a new project in RSLogix 5000. Click on the new project icon or on the FILE pull-down menu and select NEW. The following screen appears:

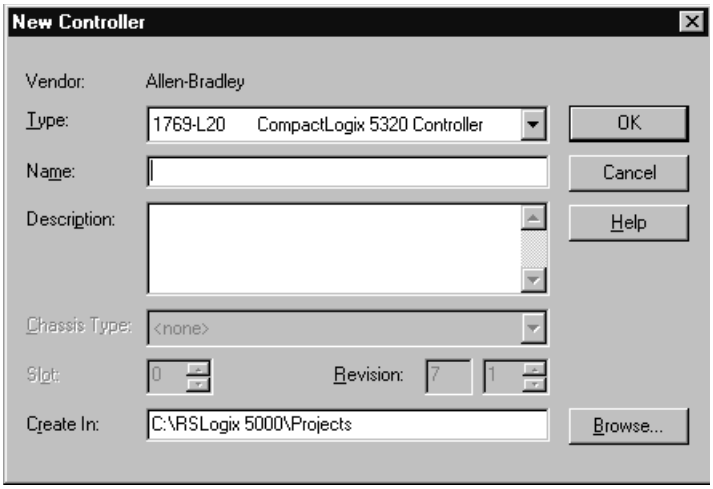

Choose your controller type and enter a name for your project, then click OK. The following main RSLogix 5000 screen appears:

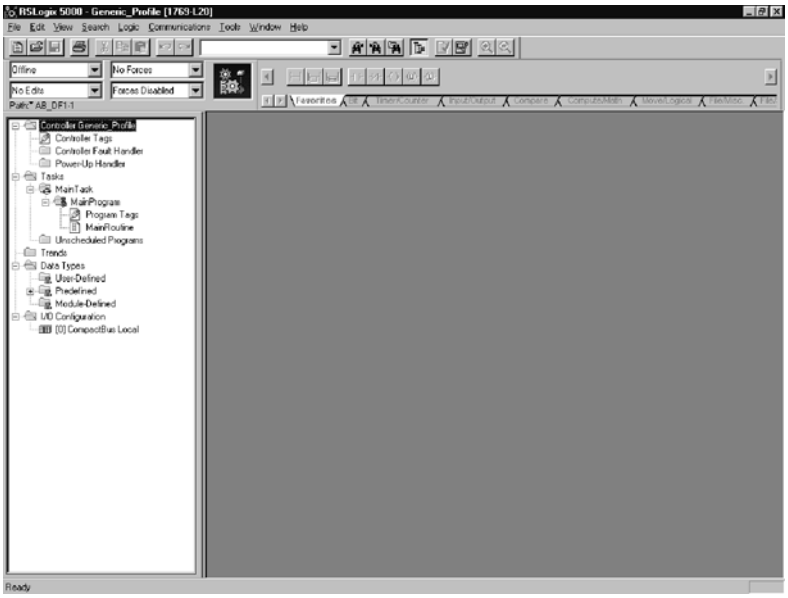

In the Controller Organizer on the left of the screen, right click on "[0] CompactBus Local", select New Module, and the following screen appears:

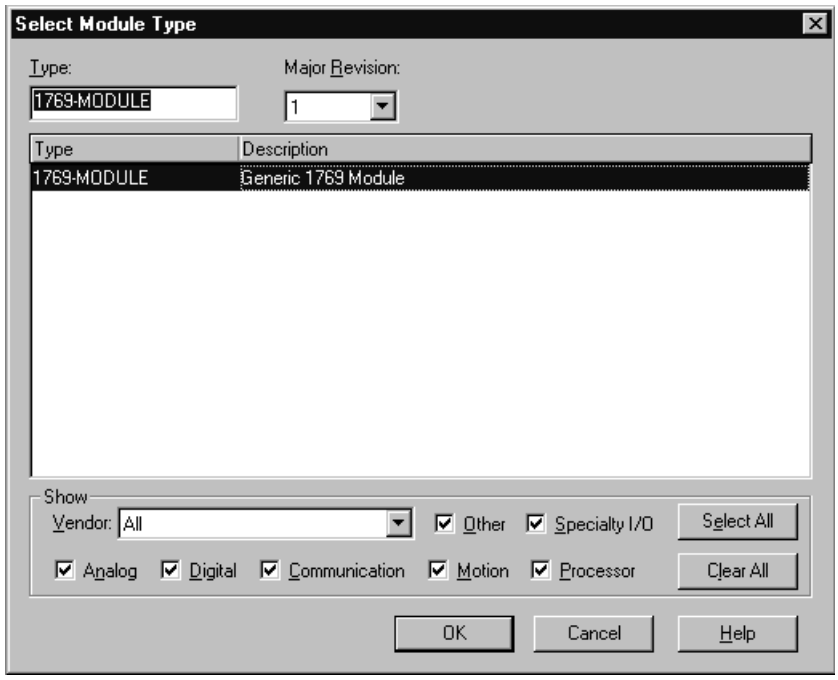

This screen is used to narrow your search for I/O modules to configure into your system. With the initial release of the CompactLogix5320 controller, this screen only includes the "Generic 1769 Module". Click the OK button and the following default Generic Profile screen appears:

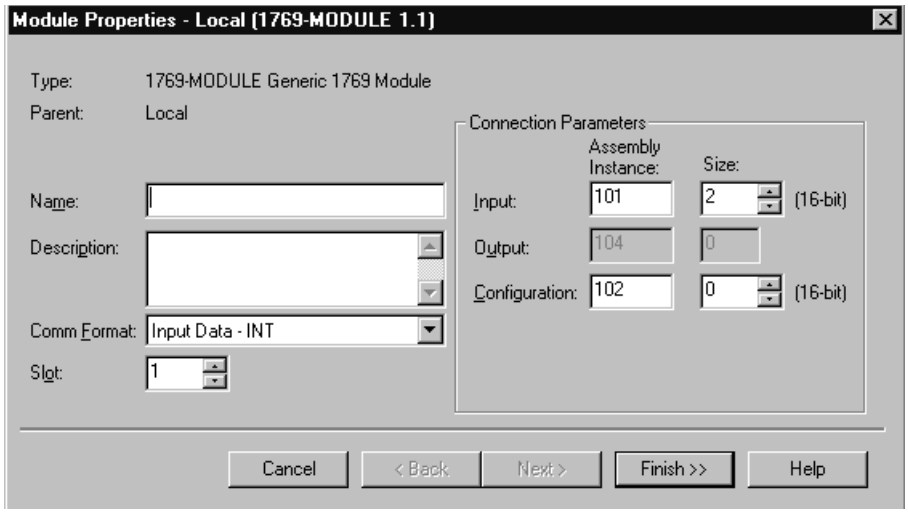

First, select the Comm Format ("Input Data – INT" for the 1769-IT6), then fill in the name field. For this example, "IT6" is used to help identify the module type in the Controller Organizer. The Description field is optional and may be used to provide more details concerning this I/O module in your application.

The slot number must be selected next, although it will begin with the first available slot number, 1, and increments automatically for each subsequent Generic Profile you configure. For this example, the 1769-IT6 Thermocouple module is located in slot 1.

The Comm Format, Assembly Instance and Size values are listed in the following table for the 1769-IT6 Thermocouple module:

1769 I/O Module	Comm Format	Parameter	Assembly Instance	Size (16-bit)
IT6	Input Data – INT	Input	101	8
		Output	104	0
		Config	102	8

Enter the Assembly Instance numbers and their associated sizes for the 1769-IT6 module into the Generic Profile. When complete, the Generic Profile for a 1769-IT6 module should look like the following:

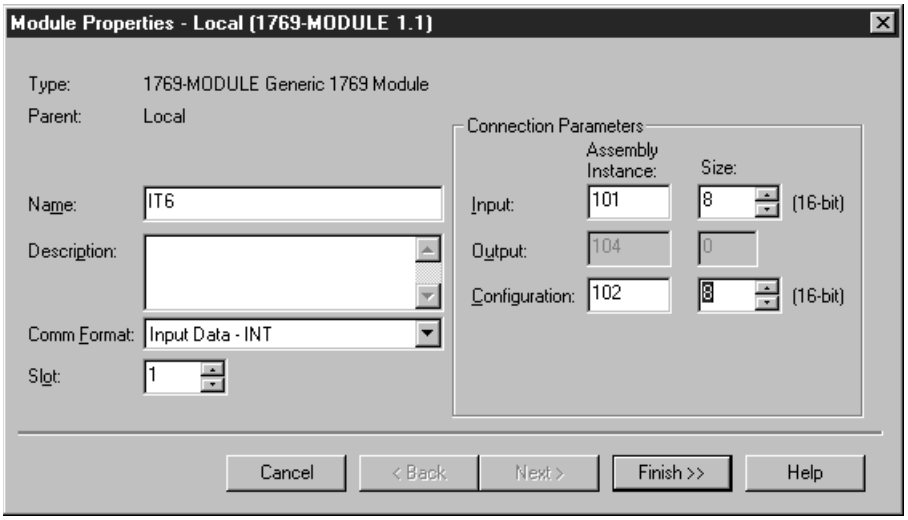

At this point you may click “Finish” to complete the configuration of your I/O module.

Configure each I/O module in this manner. The CompactLogix5320 controller supports a maximum of 8 I/O modules. The valid slot numbers to select when configuring I/O modules are 1 through 8.

Configuring I/O Modules

Once you have created a Generic Profile for 1769-IT6 Thermocouple module, you must enter configuration information into the Tag database that is automatically created from the Generic Profile information you entered. This configuration information is downloaded to each module at program download, at power up, and when an inhibited module is uninhibited.

First, enter the Controller Tag database by double-clicking on Controller Tags in the upper portion of the Controller Organizer.

Based on the Generic Profile created earlier for 1769- IT6 module, the Controller Tags screen looks like the following:

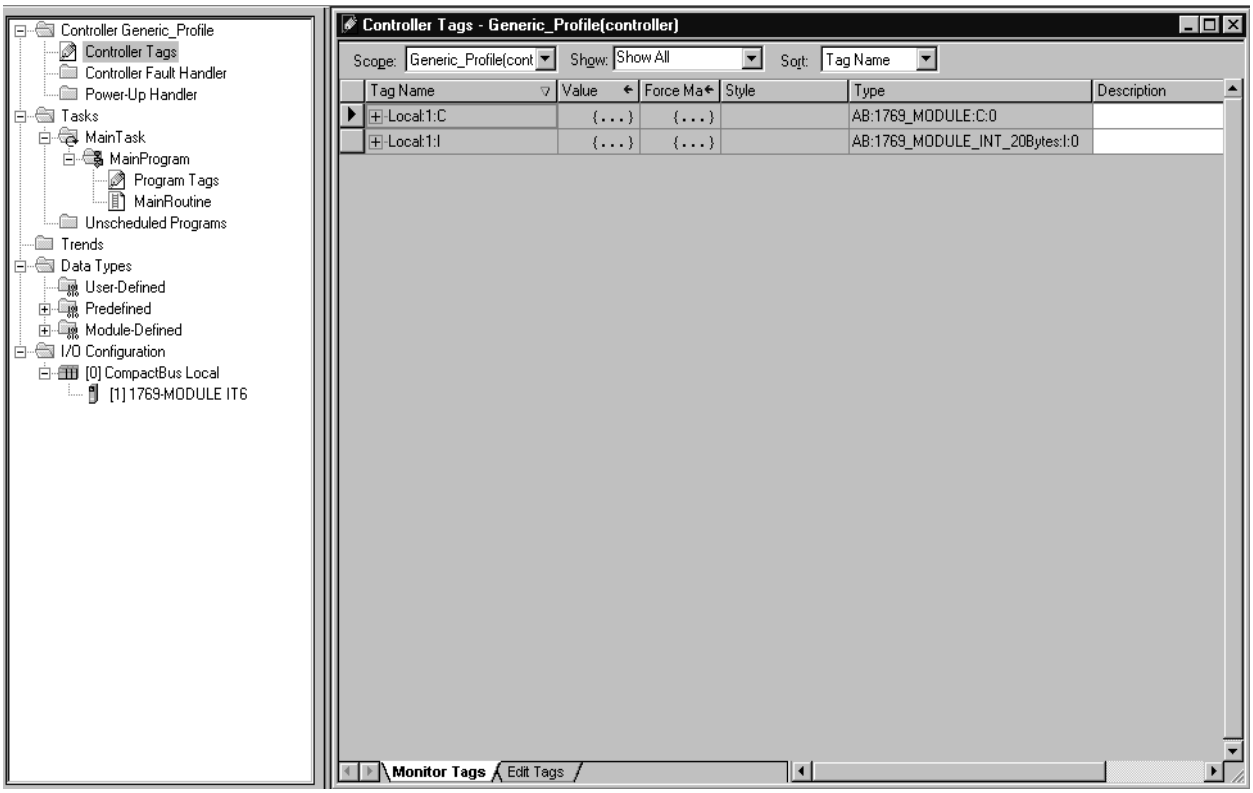

Tag addresses are automatically created for configured I/O modules. All local I/O addresses are preceded by the word Local. These addresses have the following format:

- Input Data: Local:*s*:I
- Configuration Data: Local:*s*:C

  Where *s* is the slot number assigned the I/O modules in the Generic Profiles.

In order to configure an I/O module, you must open up the configuration tag for that module by clicking on the plus sign to the left of its configuration tag in the Controller Tag data base.

Configuring a 1769-IT6 Thermocouple Module

To configure the 1769-IT6 module in slot 1, click on the plus sign left of Local:1:C. Configuration data is entered under the Local:1:C.Data tag. Click the plus sign to the left of Local:1:C.Data to reveal the 8 integer data words where configuration data may be entered for the 1769-IT6 module. The tag addresses for these 8 words are Local:1:C.Data[0] through Local:1:C.Data[7]. Only the first 7 words of the configuration file apply. The last word must exist but should contain a value of 0 decimal.

The first 6 configuration words, 0 through 5, apply to 1769-IT6 channels 0 through 5 respectively. All 6 words configure the same parameters for the 6 different channels. The seventh configuration word is used for enabling or disabling cyclic calibration. The following table shows the various parameters to configure in each channel configuration word. For a complete description of each of these parameters and the choices available for each of them, see Configuration Data File on page 4-5.

Bit(s) (Words 0 to 5)	Parameter
0 to 2	Filter Frequency
4	Not Used
5 and 6	Open Circuit Condition
7	Temperature Units Bit
8 to 11	Input Type
12 to 14	Data Format
15	Enable Channel Bit

Once you have entered your configuration selections for each channel, enter your program logic, save your project, and download it to your CompactLogix Controller. Your module configuration data is downloaded to your I/O modules at this time. Your 1769-IT6 module input data is located in the following tag addresses when the controller is in Run mode.

1769-IT6 Channel	Tag Address
0	Local:1:I.Data[0]
1	Local:1:I.Data[1]
2	Local:1:I.Data[2]
3	Local:1:I.Data[3]
4	Local:1:I.Data[4]
5	Local:1:I.Data[5]
where 1 represents the slot number of the 1769-IT6 module	

Configuring Your 1769-IT6 Module in a Remote DeviceNet System with a 1769-ADN DeviceNet Adapter

This application example assumes your 1769-IT6 thermocouple input module is in a remote DeviceNet system controlled by a 1769-ADN DeviceNet adapter. RSNetworx for DeviceNet is not only used to configure your DeviceNet network, but is also used to configure individual I/O modules in remote DeviceNet adapter systems.

For additional information on configuring your DeviceNet scanners and adapters, please refer to the documentation for these products, including the *Compact™ I/O 1769-ADN DeviceNet Adapter* user's manual, publication 1769-UM001A-US-P. The adapter manual also contains examples on how to modify I/O module configuration with Explicit Messages while the system is running. Whether you are configuring an I/O module offline and downloading to the adapter or you accomplish the configuration online, the 1769-IT6 Thermocouple module must be configured prior to configuring the DeviceNet adapter in the DeviceNet scanner's scanlist. The only ways to configure or re-configure I/O modules after the adapter is placed in the scanners scanlist are via Explicit Messages or by removing the adapter from the scanner's scanlist, modifying the configuration of the I/O module, then adding the adapter back into the scanner's scanlist.

This example takes you through configuring your 1769-IT6 Thermocouple Input module with RSNetworx for DeviceNet, version 3.00 or later, prior to adding your adapter to the scanlist of your DeviceNet scanner.

Start RSNetworx for DeviceNet. The following screen appears:

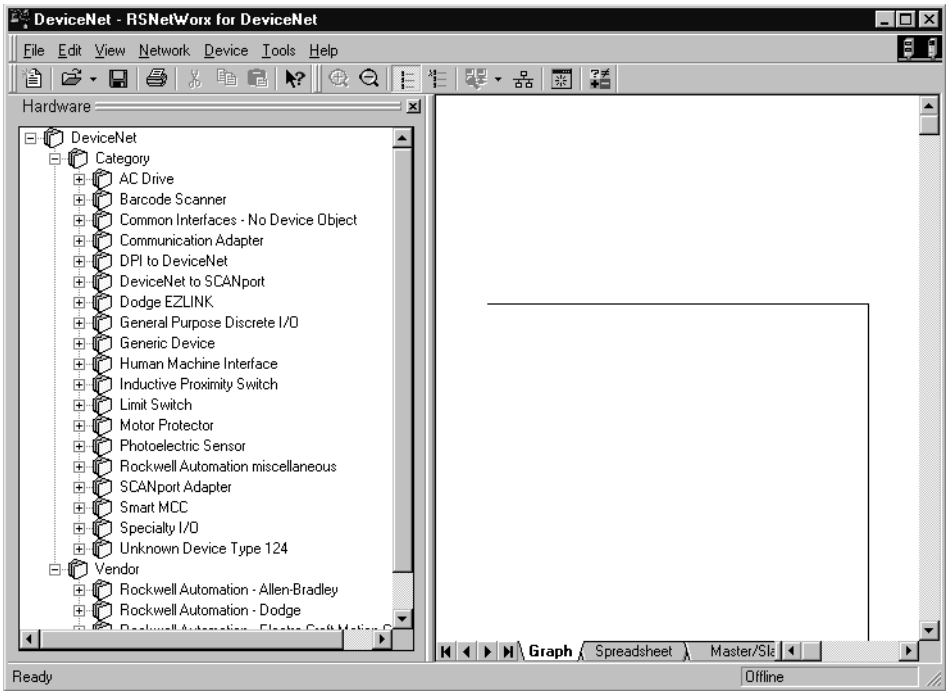

In the left column under Category, click on the “+” sign next to Communication Adapters. The list of products under Communication Adapters contains the 1769-ADN/A. Should this adapter not appear under Communication Adapters, your RSNetworx for DeviceNet software is not version 3.00 or later. To continue, you will need to obtain an upgrade for your software. If the 1769-ADN/A does appear, double-click it and it will be placed on the network to the right as shown below.

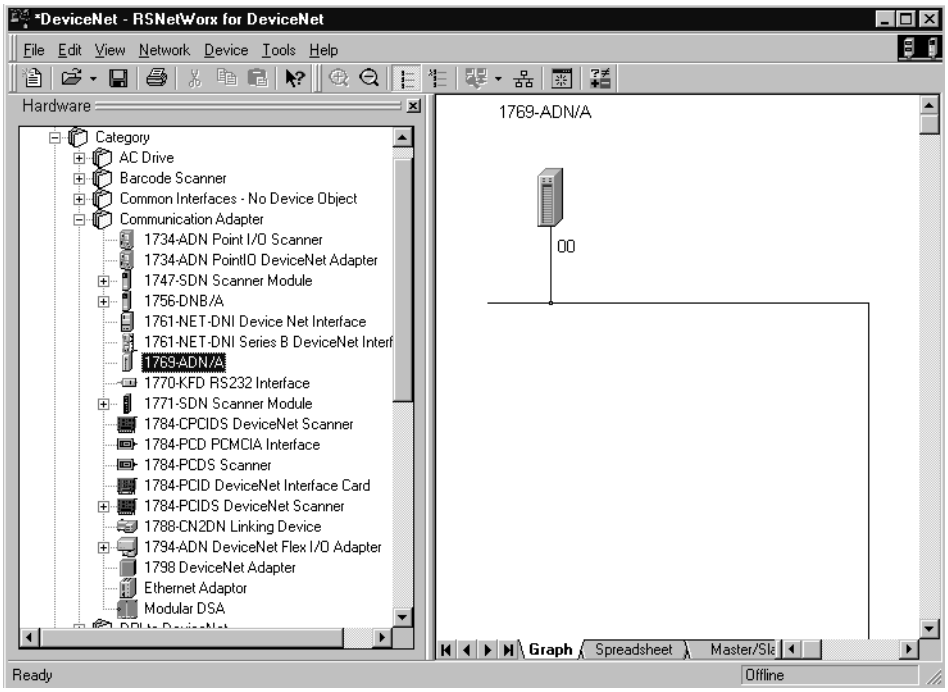

To configure I/O for the adapter, double-click on the adapter that you just placed on the network, and the following screen appears:

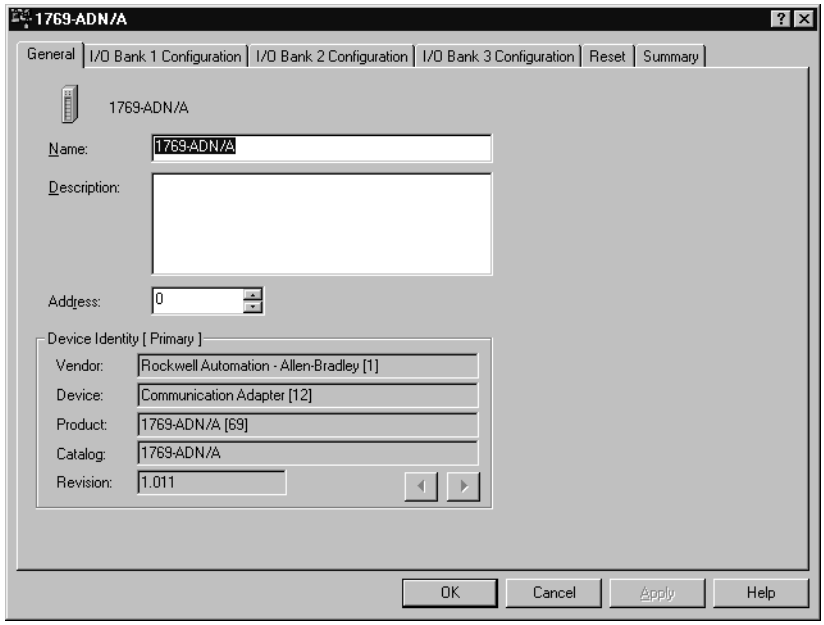

At this point, you may modify the adapters DeviceNet node address, if desired.

Next, click on the I/O Bank 1 Configuration tab. The following screen appears:

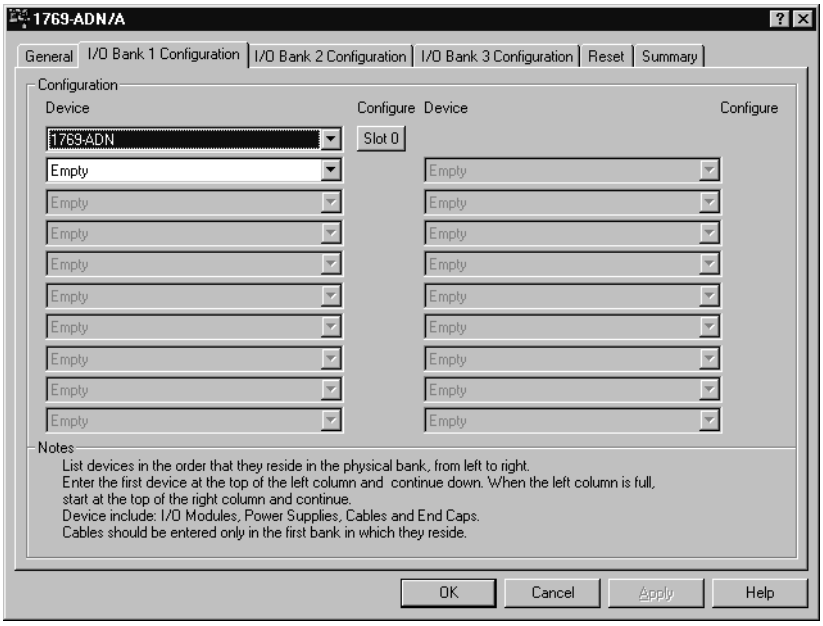
1769-ADN/A
General
I/O Bank 1 Configuration
I/O Bank 2 Configuration
I/O Bank 3 Configuration
Reset
Summary
Configuration
Device
Configure
Device
Configure
1769-ADN
Slot 0
Empty
Notes
List devices in the order that they reside in the physical bank, from left to right.
Enter the first device at the top of the left column and continue down. When the left column is full, start at the top of the right column and continue.
Device include: I/O Modules, Power Supplies, Cables and End Caps.
Cables should be entered only in the first bank in which they reside.
OK
Cancel
Apply
Help

Configuring the 1769-IT6

The 1769-ADN appears in slot 0. Your I/O modules, power supplies, end cap and interconnect cables must be entered in the proper order, following the 1769 I/O rules contained in the 1769-ADN user's manual. For simplicity sake, we placed the 1769-IT6 in slot 1 to show how it is configured. As a minimum, a power supply and end cap must also be placed after the 1769-IT6 module, even though they do not have a slot number associated with them. To place the 1769-IT6 into Bank 1, click the arrow next to the first empty slot after the 1769-ADN. A list of all possible 1769 products appears. Select the 1769-IT6. Slot 1 appears to the right of the 1769-IT6. Click this Slot 1 box and the following 1769-IT6 configuration screen appears:

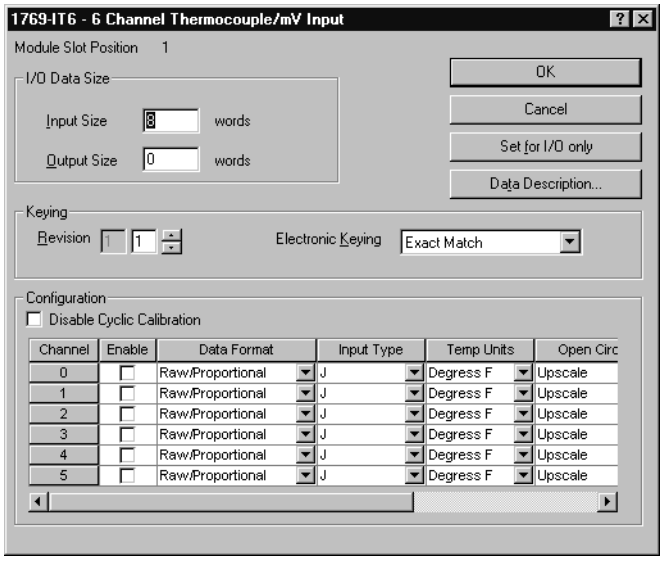
1769-IT6 - 6 Channel Thermocouple/mV Input
Module Slot Position 1
I/O Data Size
Input Size 8 words
Output Size 0 words
OK
Cancel
Set for I/O only
Data Description...
Keying
Revision 1
Electronic Keying Exact Match
Configuration
Disable Cyclic Calibration
Channel Enable Data Format Input Type Temp Units Open Circ
0 Raw/Proportional J Degress F Upscale
1 Raw/Proportional J Degress F Upscale
2 Raw/Proportional J Degress F Upscale
3 Raw/Proportional J Degress F Upscale
4 Raw/Proportional J Degress F Upscale
5 Raw/Proportional J Degress F Upscale

By default, the 1769-IT6 module contains eight input words and no output words. Click on the “Data Description…” button. This shows what the 8 input words represent, i.e. the first six words are the actual thermocouple input data, while the following two words contain status, open-circuit bits and over- and under- range bits for the six channels. Click OK or CANCEL to exit this screen and return to the Configuration screen.

If your application only requires the 6 data words and not the status information, click the “Set for I/O only” button and the Input Size will change to 6 words. You may leave the Electronic Keying to “Exact Match”. It is not recommended to Disable Keying, but if you are not sure of the exact revision of your module, selecting Compatible Module will allow your system to operate and the system will still require a 1769-IT6 in slot 1.

Each of the 6 thermocouple input channels are disabled by default. To enable a channel, click its Enable box so a check mark appears in it. Then, choose your Data Format, Input Type, Temperature Units, Open-Circuit Condition and Filter Frequency for each channel you are using. See Channel Configuration on page 4-6 for a complete description of each of these configuration categories.

In this example, channels 0 through 5 are being used. All 6 channels have J-type thermocouples connected. A 60Hz Filter Frequency (the default) is used for all 6 channels, along with receiving the thermocouple input data in Engineering Units x 10. We also chose °F for the Temperature Units. This selection, coupled with choosing Engineering Units x 10 for the data format allows us to receive the data into the controllers tag database as actual temperature data in °F. The Open-Circuit Detection is Upscale. This means that if an open-circuit condition should occur at any of the 6

thermocouple input channels, the input value for that channel is the full-scale value selected by the input type and data format. We can therefore monitor each channel for full scale (open-circuit) as well as monitor the Open-Circuit bits in Input word 6, for each channel. When complete, the configuration screen looks like the following:

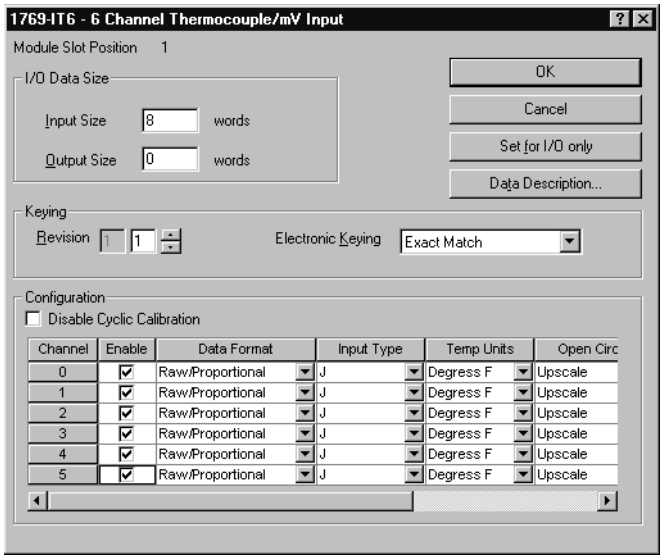
1769-IT6 - 6 Channel Thermocouple/mV Input
Module Slot Position 1
I/O Data Size
Input Size 8 words
Output Size 0 words
OK
Cancel
Set for I/O only
Data Description...
Keying
Revision 1
Electronic Keying Exact Match
Configuration
Disable Cyclic Calibration
Channel Enable Data Format Input Type Temp Units Open Circ
0 Raw/Proportional J Degress F Upscale
1 Raw/Proportional J Degress F Upscale
2 Raw/Proportional J Degress F Upscale
3 Raw/Proportional J Degress F Upscale
4 Raw/Proportional J Degress F Upscale
5 Raw/Proportional J Degress F Upscale

Click OK and your configuration for the 1769-IT6 Thermocouple Input module is complete.

Refer to your *Compact™ I/O 1769-ADN DeviceNet Adapter* user's manual, publication number 1769-UM001A-US-P, for information concerning DeviceNet network configuration and operation.

The following terms and abbreviations are used throughout this manual. For definitions of terms not listed here refer to *Allen-Bradley's Industrial Automation Glossary*, Publication AG-7.1.

A/D Converter– Refers to the analog to digital converter inherent to the module. The converter produces a digital value whose magnitude is proportional to the magnitude of an analog input signal.

attenuation – The reduction in the magnitude of a signal as it passes through a system.

bus connector – A 16-pin male and female connector that provides electrical interconnection between the modules.

channel – Refers to input interfaces available on the module's terminal block. Each channel is configured for connection to a thermocouple or millivolt input device, and has its own data and diagnostic status words.

channel update time – The time required for the module to sample and convert the input signals of one enabled input channel and update the channel data word.

CJC – Cold junction compensation. CJC is the means by which the module compensates for the offset voltage error introduced by the temperature at the junction between a thermocouple lead wire and the module terminal block (the cold junction).

common mode rejection – For analog inputs, the maximum level to which a common mode input voltage appears in the numerical value read by the processor, expressed in dB.

common mode rejection ratio (CMMR) – The ratio of a device's differential voltage gain to common mode voltage gain. Expressed in dB, CMRR is a comparative measure of a device's ability to reject interference caused by a voltage common to its input terminals relative to ground. CMRR=20 Log_{10} (V1/V2)

common mode voltage – The voltage difference between the negative terminal and analog common during normal differential operation.

common mode voltage range – The largest voltage difference allowed between either the positive or negative terminal and analog common during normal differential operation.

configuration word –Word containing the channel configuration information needed by the module to configure and operate each channel.

cut-off frequency – The frequency at which the input signal is attenuated 3 dB by a digital filter. Frequency components of the input signal that are below the cut-off frequency are passed with under 3 dB of attenuation for low-pass filters.

data word – A 16-bit integer that represents the value of the input channel. The channel data word is valid only when the channel is enabled and there are no channel errors. When the channel is disabled the channel data word is cleared (0).

dB – (decibel) A logarithmic measure of the ratio of two signal levels.

digital filter – A low-pass filter incorporated into the A/D converter. The digital filter provides very steep roll-off above it's cut-off frequency, which provides high frequency noise rejection.

effective resolution – The number of bits in a channel configuration word that do not vary due to noise.

filter – A device that passes a signal or range of signals and eliminates all others.

filter frequency – The user-selectable frequency for a digital filter.

full-scale – The magnitude of input over which normal operation is permitted.

full-scale range – The difference between the maximum and minimum specified analog input values for a device.

gain drift – Change in full-scale transition voltage measured over the operating temperature range of the module.

input data scaling – Data scaling that depends on the data format selected for a channel configuration word. Scaling is selected to fit the temperature or voltage resolution for your application.

input image – The input from the module to the controller. The input image contains the module data words and status bits.

linearity error – Any deviation of the converted input or actual output from a straight line of values representing the ideal analog input. An analog input is composed of a series of input values corresponding to digital codes. For an ideal analog input, the values lie in a straight line spaced by inputs corresponding to 1 LSB. Linearity is expressed in percent

full-scale input. See the variation from the straight line due to linearity error (exaggerated) in the example below.

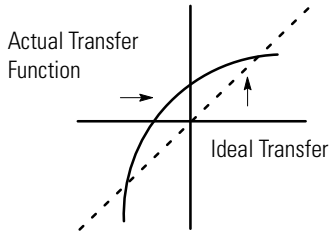

LSB – Least significant bit. The LSB represents the smallest value within a string of bits. For analog modules, 16-bit, two's complement binary codes are used in the
I/O image. For analog inputs, the LSB is defined as the rightmost bit of the 16-bit field (bit 0). The weight of the LSB value is defined as the full-scale range divided by the resolution.

module scan time – same as *module update time*

module update time – The time required for the module to sample and convert the input signals of all enabled input channels and make the resulting data values available to the processor.

multiplexer – An switching system that allows several signals to share a common A/D converter.

normal mode rejection – (differential mode rejection) A logarithmic measure, in dB, of a device's ability to reject noise signals between or among circuit signal conductors. The measurement does not apply to noise signals between the equipment grounding conductor or signal reference structure and the signal conductors.

number of significant bits – The power of two that represents the total number of completely different digital codes to which an analog signal can be converted or from which it can be generated.

overall accuracy – The worst-case deviation of the digital representation of the input signal from the ideal over the full input range is the overall accuracy. Overall accuracy is expressed in percent of full scale.

repeatability – The closeness of agreement among repeated measurements of the same variable under the same conditions.

resolution – The increment of change represented by one unit.
For example, the resolution of engineering units x1 is 0.1° and the resolution of raw/proportional data is equal to (maximum_value - minimum_value)/65534.

sampling time – The time required by the A/D converter to sample an input channel.

status word – Contains status information about the channel's current configuration and operational state. You can use this information in your ladder program to determine whether the channel data word is valid.

step response time – The time required for the channel data word signal to reach a specified percentage of its expected final value, given a full-scale step change in the input signal.

thermocouple – A temperature sensing device consisting of a pair of dissimilar conductors welded or fused together at one end to form a measuring junction. The free ends are available for connection to the reference (cold) junction. A temperature difference between the junctions must exist for the device to function.

update time – see "module update time"

Numerics

-3 dB frequency *4-12*

A

A/D
  definition *Glossary-1*
abbreviations *Glossary-1*
accuracy *A-4*
analog input module
  overview *1-1*, *5-1*
attenuation
  cut-off frequency *4-12*
  definition *Glossary-1*
autocalibration
  module update time *4-34*

B

before you begin *2-1*
bus connector
  definition *Glossary-1*
  locking *3-5*
bus interface *1-4*

C

calibration *1-5*
calibration, cyclic *4-14*
channel
  definition *Glossary-1*
channel configuration *4-4*
channel configuration word *4-6*
channel diagnostics *5-3*
channel status LED *1-4*
channel step response
  effects of filter frequency *4-12*
channel update time
  definition *Glossary-1*
CJC
  definition *Glossary-1*
CJC sensors
  error indication *4-3*
  general status bits *4-2*
  input frequency *4-11*
  location *1-3*
  module operation *1-4*
  open-circuit condition *4-10*
  over-range flag *4-3*
  terminal connections *2-5*
  under-range flag *4-4*
  wiring *3-13*
CMRR. See common mode rejection ratio
common mode rejection *4-11*
  definition *Glossary-1*
common mode rejection ratio
  definition *Glossary-1*
common mode voltage
  definition *Glossary-1*
common mode voltage range
  definition *Glossary-1*
common mode voltage rating *4-11*
configuration errors *5-5*
configuration word
  definition *Glossary-1*
contacting Rockwell Automation *5-8*
cut-off frequency *4-12*
  definition *Glossary-2*

D

data not valid condition *4-3*
data word
  definition *Glossary-2*
dB
  definition *Glossary-2*
decibel. See dB.
definition of terms *Glossary-1*
differential mode rejection. See normal mode rejection.
digital filter
  definition *Glossary-2*
DIN rail mounting *3-7*

E

effective resolution
  at available filter frequencies *4-14-4-33*
  definition *Glossary-2*
electrical noise *3-4*
EMC Directive *3-1*
end cap terminator *2-3*, *3-5*
equipment required for installation *2-1*
error codes *5-6*
error definitions *5-4*

errors
configuration *5-5*
critical *5-4*
extended error information field *5-5*
hardware *5-5*
module error field *5-4*
non-critical *5-4*
European Union Directives *3-1*
extended error codes *5-6*
extended error information field *5-5*

F

fault condition
at power-up *1-4*
filter
definition *Glossary-2*
filter frequency
definition *Glossary-2*
effect on effective resolution *4-14*
effect on noise rejection *4-11*
effect on step response *4-12*
selecting *4-11*
finger-safe terminal block *3-11*
full-scale
definition *Glossary-2*
full-scale range
definition *Glossary-2*

G

gain drift
definition *Glossary-2*
general status bits *4-2*
grounding *2-5, 3-9*

H

hardware errors *5-5*
heat considerations *3-4*

I

input data formats
engineering units x 1 *4-8*
engineering units x 10 *4-8*
percent range *4-9*
raw/proportional data *4-8*
scaled for PID *4-9*
input data scaling
definition *Glossary-2*
input filter selection *4-11*
input image
definition *Glossary-2*
input module
channel configuration *4-6*
enable channel *4-7*
input module status
general status bits *4-2*
over-range flag bits *4-3*
under-range flag bits *4-4*
input type/range selection *4-9*
installation
getting started *2-1*
grounding *2-5, 3-9*
heat and noise considerations *3-4*
International Temperature Scale 1990 *C-1*
ITS-90 *C-1*

L

LED *5-1*
linearity error
definition *Glossary-2*
LSB
definition *Glossary-3*

M

millivolt inputs
range *1-1*
module error field *5-4*
module inhibit function *5-8*
module scan time
definition *Glossary-3*
module status
data not valid *4-3*
module update time *4-33*
definition *Glossary-3*
mounting *3-6-3-7*
multiplexer
definition *Glossary-3*

N

negative decimal values *B-2*
noise rejection *4-11*
normal mode rejection
definition *Glossary-3*
number of significant bits
definition *Glossary-3*

O

open-circuit
detection *5-3*
error bits *4-3*
operation
system *1-4*
out-of range detection *5-3*
overall accuracy
definition *Glossary-3*
over-range flag bits *4-3*

P

panel mounting *3-6-3-7*
positive decimal values *B-1*
power-up diagnostics *5-2*
power-up sequence *1-4*
program alteration *5-2*

R

removing terminal block *3-10*
replacing a module *3-7*
resolution
definition *Glossary-3*

S

safety circuits *5-2*
sampling time
definition *Glossary-3*
scan time *Glossary-3*
spacing *3-6*
specifications *A-1*
start-up instructions *2-1*
status word
definition *Glossary-4*
step response time
definition *Glossary-4*
system operation *1-4*

T

terminal block
removing *3-10*
wiring *3-11*
terminal door label *3-10*
terminal screw torque *3-11*
thermocouple
accuracy *A-4*
definition *Glossary-4*
descriptions *C-1*
exposed junction *D-3*
grounded junction *D-1*
junction types *D-1*
repeatability *A-3*
ungrounded junction *D-2*
using junctions *D-1*
tools required for installation *2-1*
troubleshooting
safety considerations *5-1*
two's complement binary numbers *B-1*
type B
description *C-1*
temperature range *1-1*
type C
temperature range *1-1*
type E
description *C-3*
temperature range *1-1*
type J
description *C-5*
temperature range *1-1*
type K
description *C-6*
temperature range *1-1*
type N
description *C-8*
temperature range *1-1*
type R
description *C-10*
temperature range *1-1*
type S
description *C-11*
temperature range *1-1*
type T
description *C-13*
temperature range *1-1*

U

under-range flag bits *4-4*
update time *4-33*
update time. See channel update time.
update time. See module update time.

W

wire size *3-11*
wiring *3-1*
  module *3-11*
  modules *3-12*
  routing considerations *3-4*
  terminal block *3-11*

www.rockwellautomation.com

Power, Control and Information Solutions Headquarters

Americas: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444
Europe/Middle East/Africa: Rockwell Automation, Vorstlaan/Boulevard du Souverain 36, 1170 Brussels, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640
Asia Pacific: Rockwell Automation, Level 14, Core F, Cyberport 3, 100 Cyberport Road, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846

Publication 1769-UM004A-EN-P - February 2001

© 2001 Rockwell International Corporation. Printed in the U.S.A.